


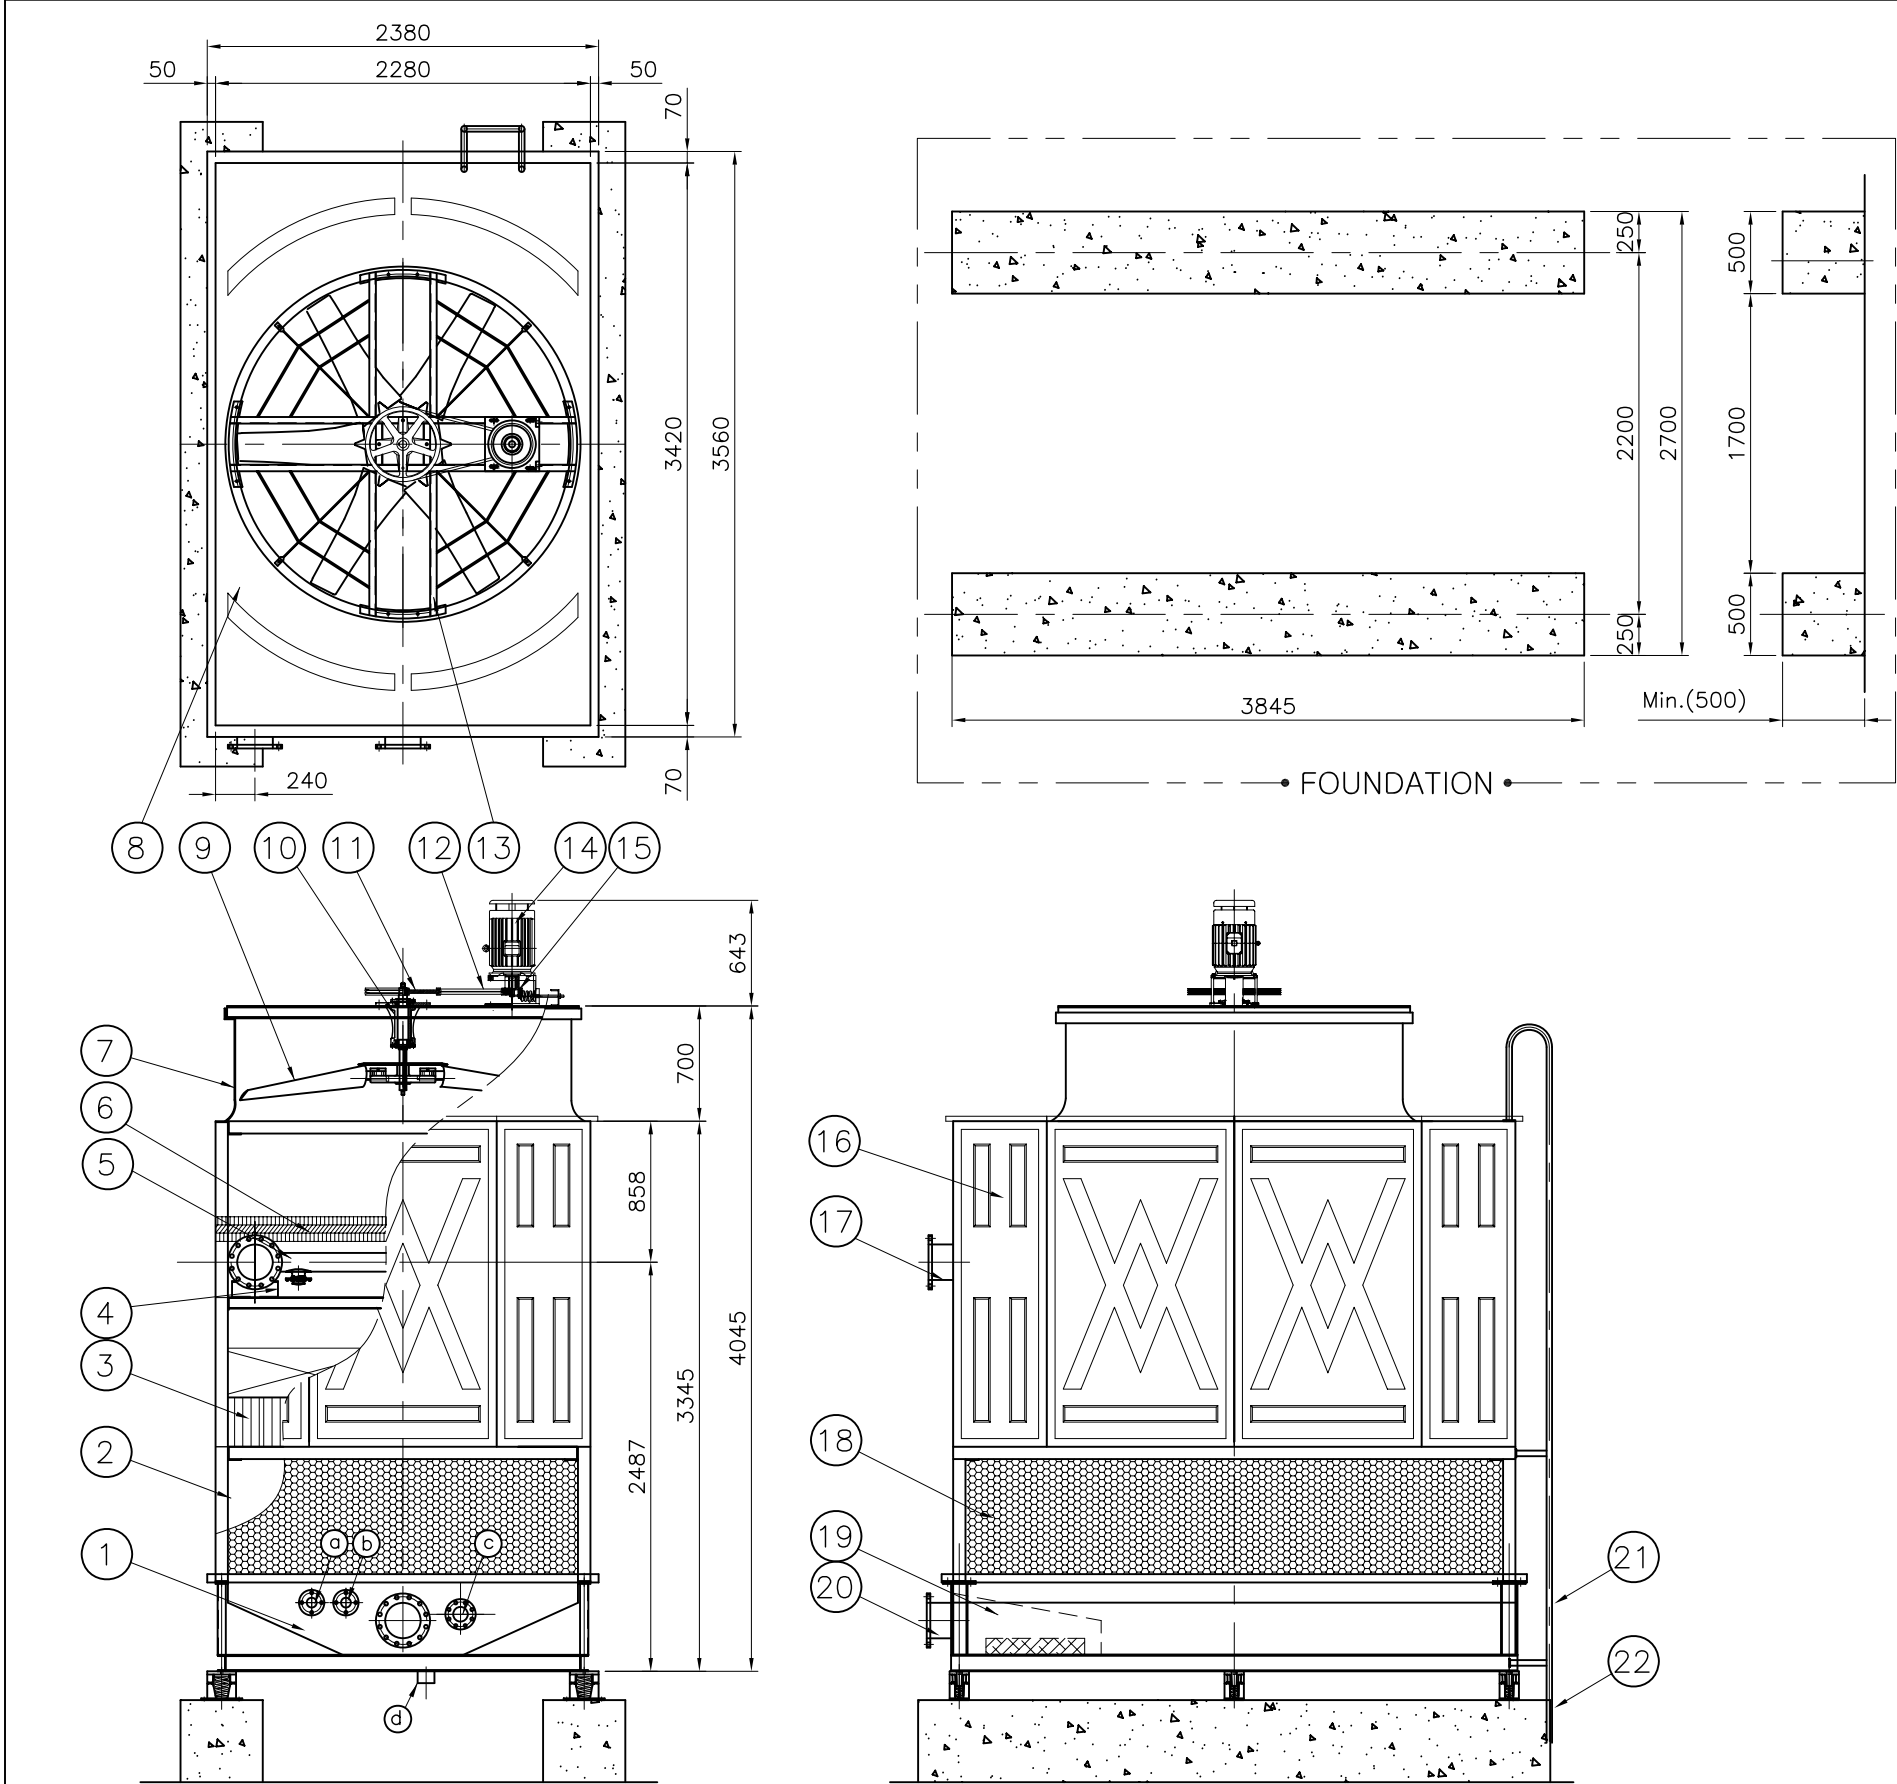



NO.	DESCRIPTIONS	MAT'L	IDENTIFICATION	Q'TY	REMARKS
1	COLD WATER BASIN	FRP	—	1 EA	
2	FRAMEWORK	SS400	75x75	1 EA	HDG
3	FILL	PVC	—	1 LOT	
4	WATER SPRAY NOZZLE	ABS	DK-D	12 EA	
5	LATERAL PIPE	PVC	100A	1 LOT	
6	DRIFT ELIMINATOR	PVC	—	1 LOT	
7	FAN CYLINDER	FRP	ø2030 $\pm_{-0}^{+10}$	1 EA	
8	FAN DECK	FRP	—	1 EA	
9	FAN ASSEMBLY	AL-ALLOY	ø2000	1 SET	
10	FAN DRIVE SHAFT PULLEY	FC200	5V1802	1 EA	
11	SPEED REDUCER	FC200	10HP	1 SET	
12	V-BELT	RUBBER	5VX900	2 EA	
13	MECH. EQUIPMENT BASE	SS400	—	1 EA	HDG
14	ELECTRIC MOTOR	TEFC	10HPx4P	1 EA	
15	MOTOR SHAFT PULLEY	FC200	5V502	1 EA	
16	CASING	FRP	—	1 LOT	
17	INLET PIPE	PVC	200A	1 EA	
18	AIR INLET SCREEN	PVC	—	1 LOT	
19	ANTI VORTEX BOX	FRP	—	1 EA	HDG
20	OUTLET PIPE	SPP	200A	1 EA	HDG
21	LADDER	SPP	25A	1 EA	HDG
22	FOUNDATION	RF CON'C	—	1 LOT	BY OWNER

- 상기 수량은 1 CELL에 대한 것임.
- 본 기기와 연결되는 전선자재, 배관자재 및 공사는 공급범위에서 제외됨.
- 기초 공사 제외.

△					
▽					
NO.	DATE	REVISIONS	REVIEWED	CHECKED	APPROVED




DESIGN CONDITIONS		NOZZLE SPECIFICATIONS						
WATER FLOW RATE	195 M ³ /HR	SYMBOL	DESCRIPTIONS	MAT'L	SIZE	Q'TY	REMARK	
NO. OF CELLS	1 CELL	a	MANUAL MAKE-UP	SPP	50 A	1 EA	FLANGE	
TEMP.	INLET	37 °C	b	AUTO. MAKE-UP	SPP	50 A	1 EA	FLANGE
	OUTLET	32 °C	c	OVERFLOW	SPP	80 A	1 EA	FLANGE
	WET BULB	27 °C	d	DRAIN	SPP	80 A	1 EA	FLANGE

NO.	DESCRIPTIONS	MAT'L	SIZE	Q'TY	REMARKS
DAEIL AQUA CO.,LTD.		TITLE ASSEMBLY & FOUNDATION		PROJECTION	
COOLING TOWER (주) 대 일 아 쿠 아		(250 CT)			
DWG.	DSN.	CHK.	APPR.	SCALE 1 / 45	P.J.T NAME
S.C.I.	S.S.H.	J.J.M.	R.H.H.	UNIT mm	REF. NO.
		DATE		DWG. NO.	DI-LCP-250-01

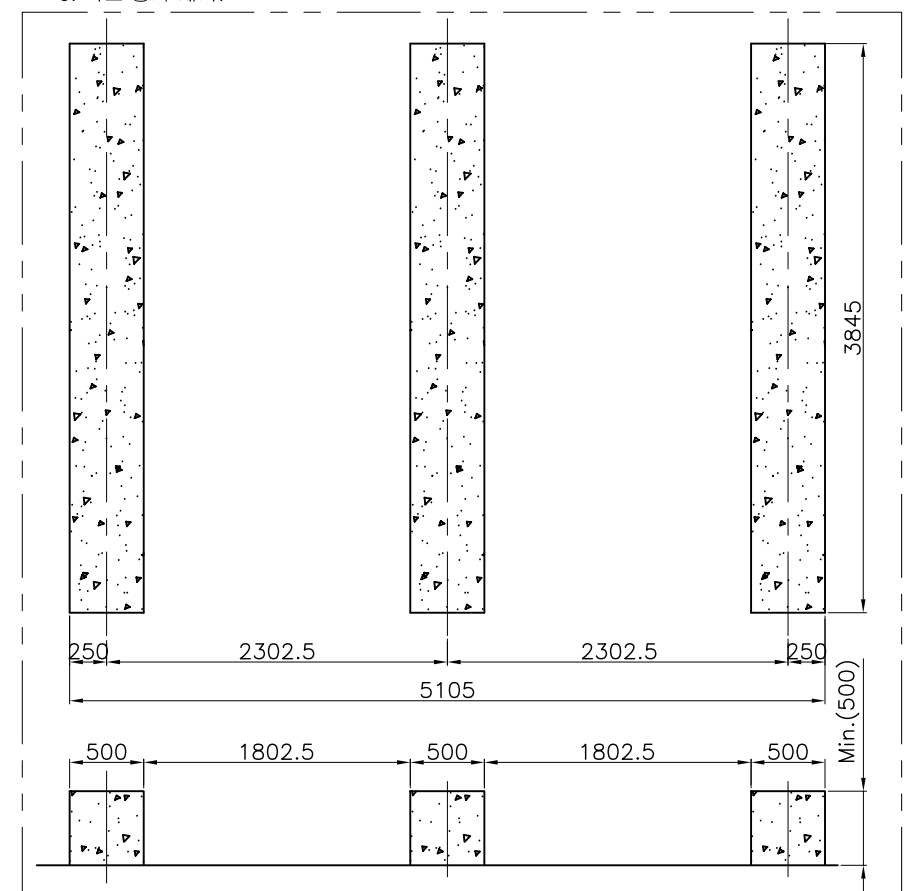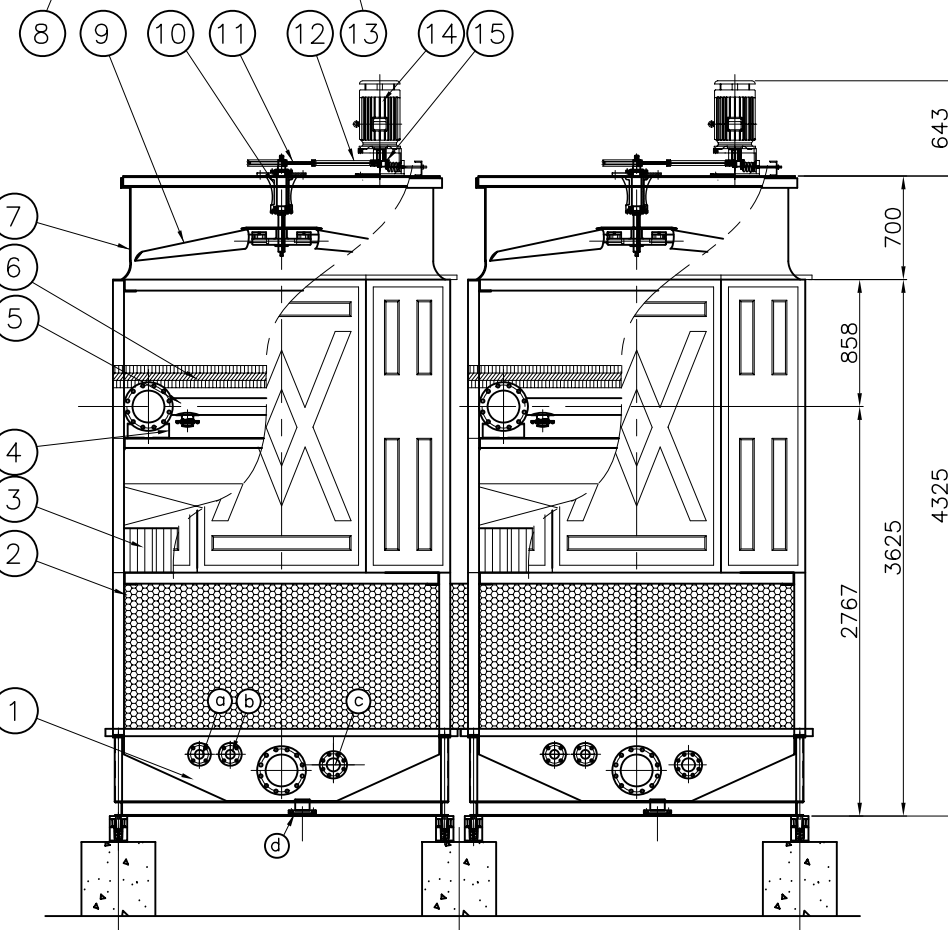

1. 상기 수량은 1 CELL에 대한 것임.
2. 본 기기와 연결되는 전선자재, 배관자재 및 공사는 공급범위에서 제외됨.
3. 기초 공사 제외.


						DESIGN CONDITIONS		NOZZLE SPECIFICATIONS					NO.	DESCRIPTIONS			MAT'L	SIZE		Q'TY	REMARKS						
						WATER FLOW RATE		390	M ³ /HR	SYMBOL	DESCRIPTIONS		MAT'L	SIZE	Q'TY	REMARK											
						NO. OF CELLS		2	CELL	a	MANUAL MAKE-UP		SPP	50 A	2 EA	FLANGE											
						TEMP.	INLET	37	°C	b	AUTO. MAKE-UP		SPP	50 A	2 EA	FLANGE											
							OUTLET	32	°C	c	OVERFLOW		SPP	80 A	2 EA	FLANGE											
NO.	DATE	REVISIONS		REVIEWED	CHECKED		APPROVED	WET BULB	27	°C	d	DRAIN		SPP	80 A	2 EA	FLANGE										
																		 DAEIL AQUA CO.,LTD. COOLING TOWER (주) 대 일 아 쿨 이 어			TITLE ASSEMBLY & FOUNDATION (250 CT x 2 CELLS)						
DWG.		DSN.	CHK.	APPR.	SCALE	1 / 50		P.J.T NAME																			
S.C.I.		S.S.H.	J.J.M.	R.H.H.	UNIT DATE	mm		REF. NO.		DWG. NO.		DI-LCP-250-2-01															

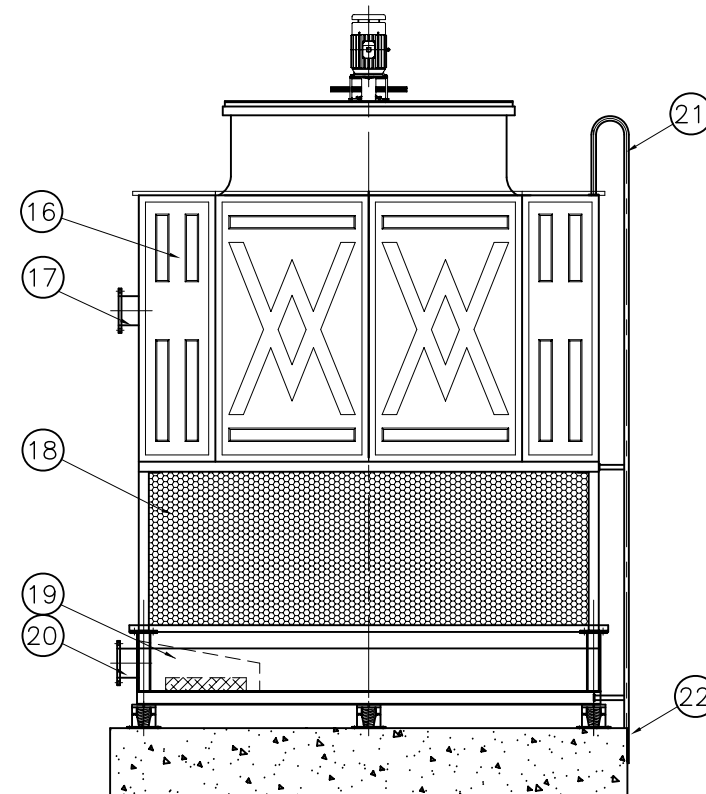
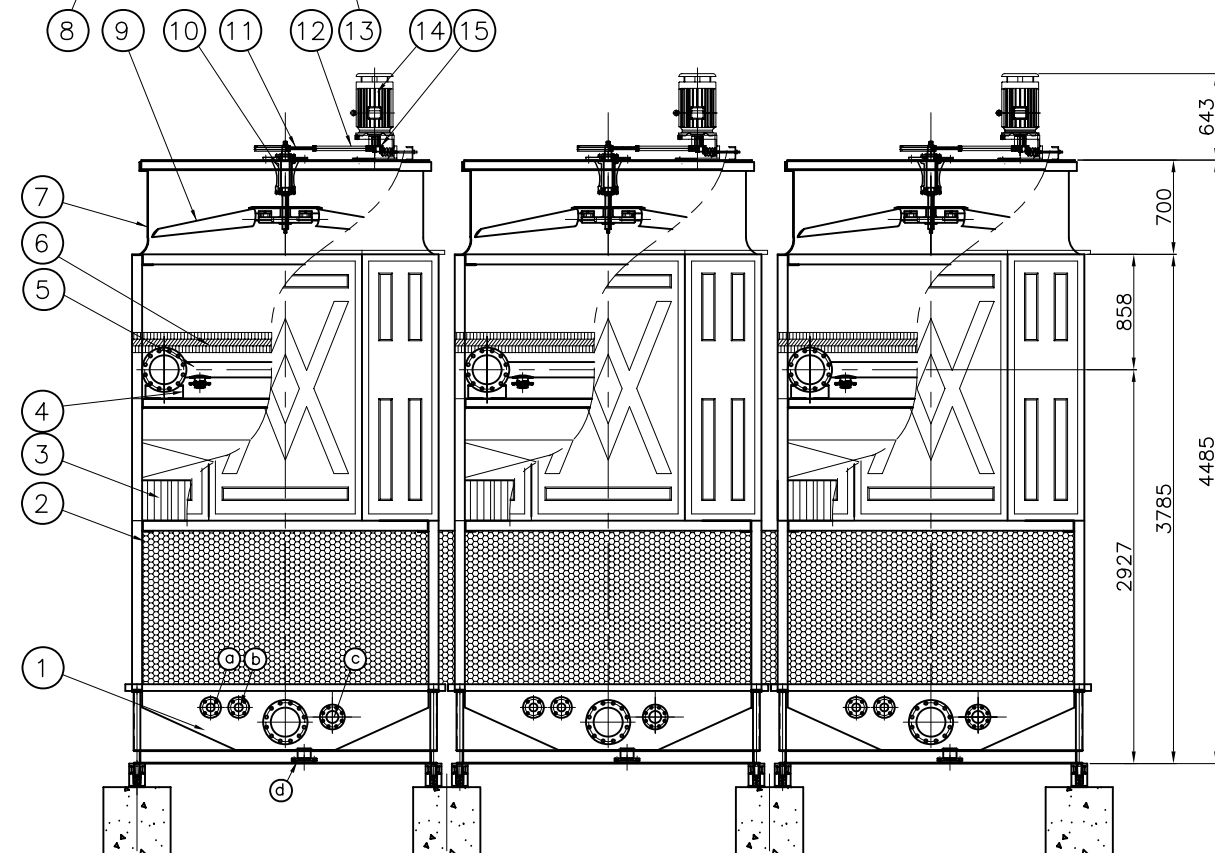
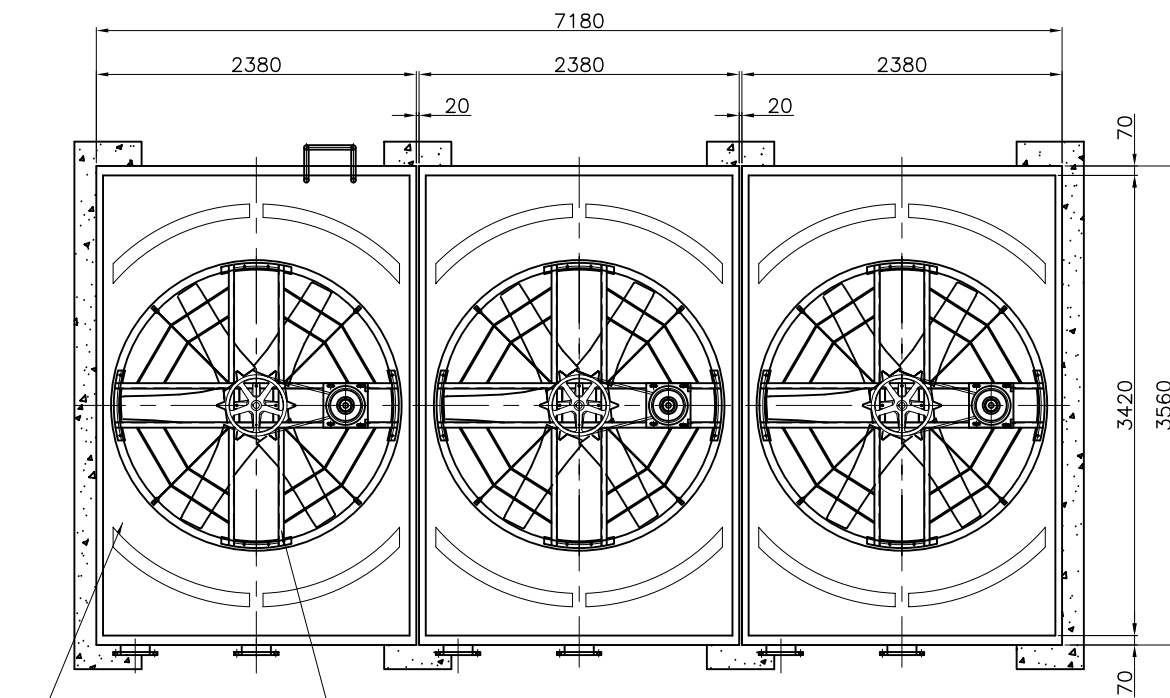


NO.	DESCRIPTIONS	MAT'L	IDENTIFICATION	Q'TY	REMARKS
1	COLD WATER BASIN	FRP	—	1 EA	
2	FRAMEWORK	SS400	75x75	1 EA	HDG
3	FILL	PVC	—	1 LOT	
4	WATER SPRAY NOZZLE	ABS	DK—D	12 EA	
5	LATERAL PIPE	PVC	100A	1 LOT	
6	DRIFT ELIMINATOR	PVC	—	1 LOT	
7	FAN CYLINDER	FRP	$\phi 2030 \begin{smallmatrix} +10 \\ -0 \end{smallmatrix}$	1 EA	
8	FAN DECK	FRP	—	1 EA	
9	FAN ASSEMBLY	AL—ALLOY	$\phi 2000$	1 SET	
10	FAN DRIVE SHAFT PULLEY	FC200	5V1802	1 EA	
11	SPEED REDUCER	FC200	10HP	1 SET	
12	V—BELT	RUBBER	5VX900	2 EA	
13	MECH. EQUIPMENT BASE	SS400	—	1 EA	HDG
14	ELECTRIC MOTOR	TEFC	10HPx4P	1 EA	
15	MOTOR SHAFT PULLEY	FC200	5V502	1 EA	
16	CASING	FRP	—	1 LOT	
17	INLET PIPE	PVC	200A	1 EA	
18	AIR INLET SCREEN	PVC	—	1 LOT	
19	ANTI VORTEX BOX	FRP	—	1 EA	
20	OUTLET PIPE	SPP	200A	1 EA	HDG
21	LADDER	SPP	25A	1 EA	HDG
22	FOUNDATION	RF CON'C	—	1 LOT	BY OWNER

1. 상기 수량은 1 CELL에 대한 것임.
2. 본 기기와 연결되는 전선자재, 배관자재 및 공사는 공급범위에서 제외됨.
3. 기초 공사 제외.

						DESIGN CONDITIONS		NOZZLE SPECIFICATIONS						NO.		DESCRIPTIONS			MAT'L		SIZE		Q'TY	REMARKS			
						WATER FLOW RATE		585 M ³ /HR		SYMBOL	DESCRIPTIONS		MAT'L	SIZE	Q'TY		REMARK	 DAEIL AQUA CO.,LTD. COOLING TOWER (주) 대 일 아 쿠 이 TITLE ASSEMBLY & FOUNDATION (250 CT x 3 CELLS) PROJECTION 									
						NO. OF CELLS		3 CELL		a	MANUAL MAKE-UP		SPP	50 A	3 EA		FLANGE										
						TEMP.	INLET	37 °C	b	AUTO. MAKE-UP		SPP	50 A	3 EA		FLANGE	DWG.	DSN.	CHK.	APPR.	SCALE	1 / 55		P.J.T NAME			
							OUTLET	32 °C	c	OVERFLOW		SPP	80 A	3 EA		FLANGE					UNIT	mm		REF. NO.			
NO.	DATE	REVISIONS		REVIEWED	CHECKED		APPROVED	WET BULB	27 °C	d	DRAIN		SPP	80 A	3 EA						FLANGE	DATE			DI-LCP-250-3-01		

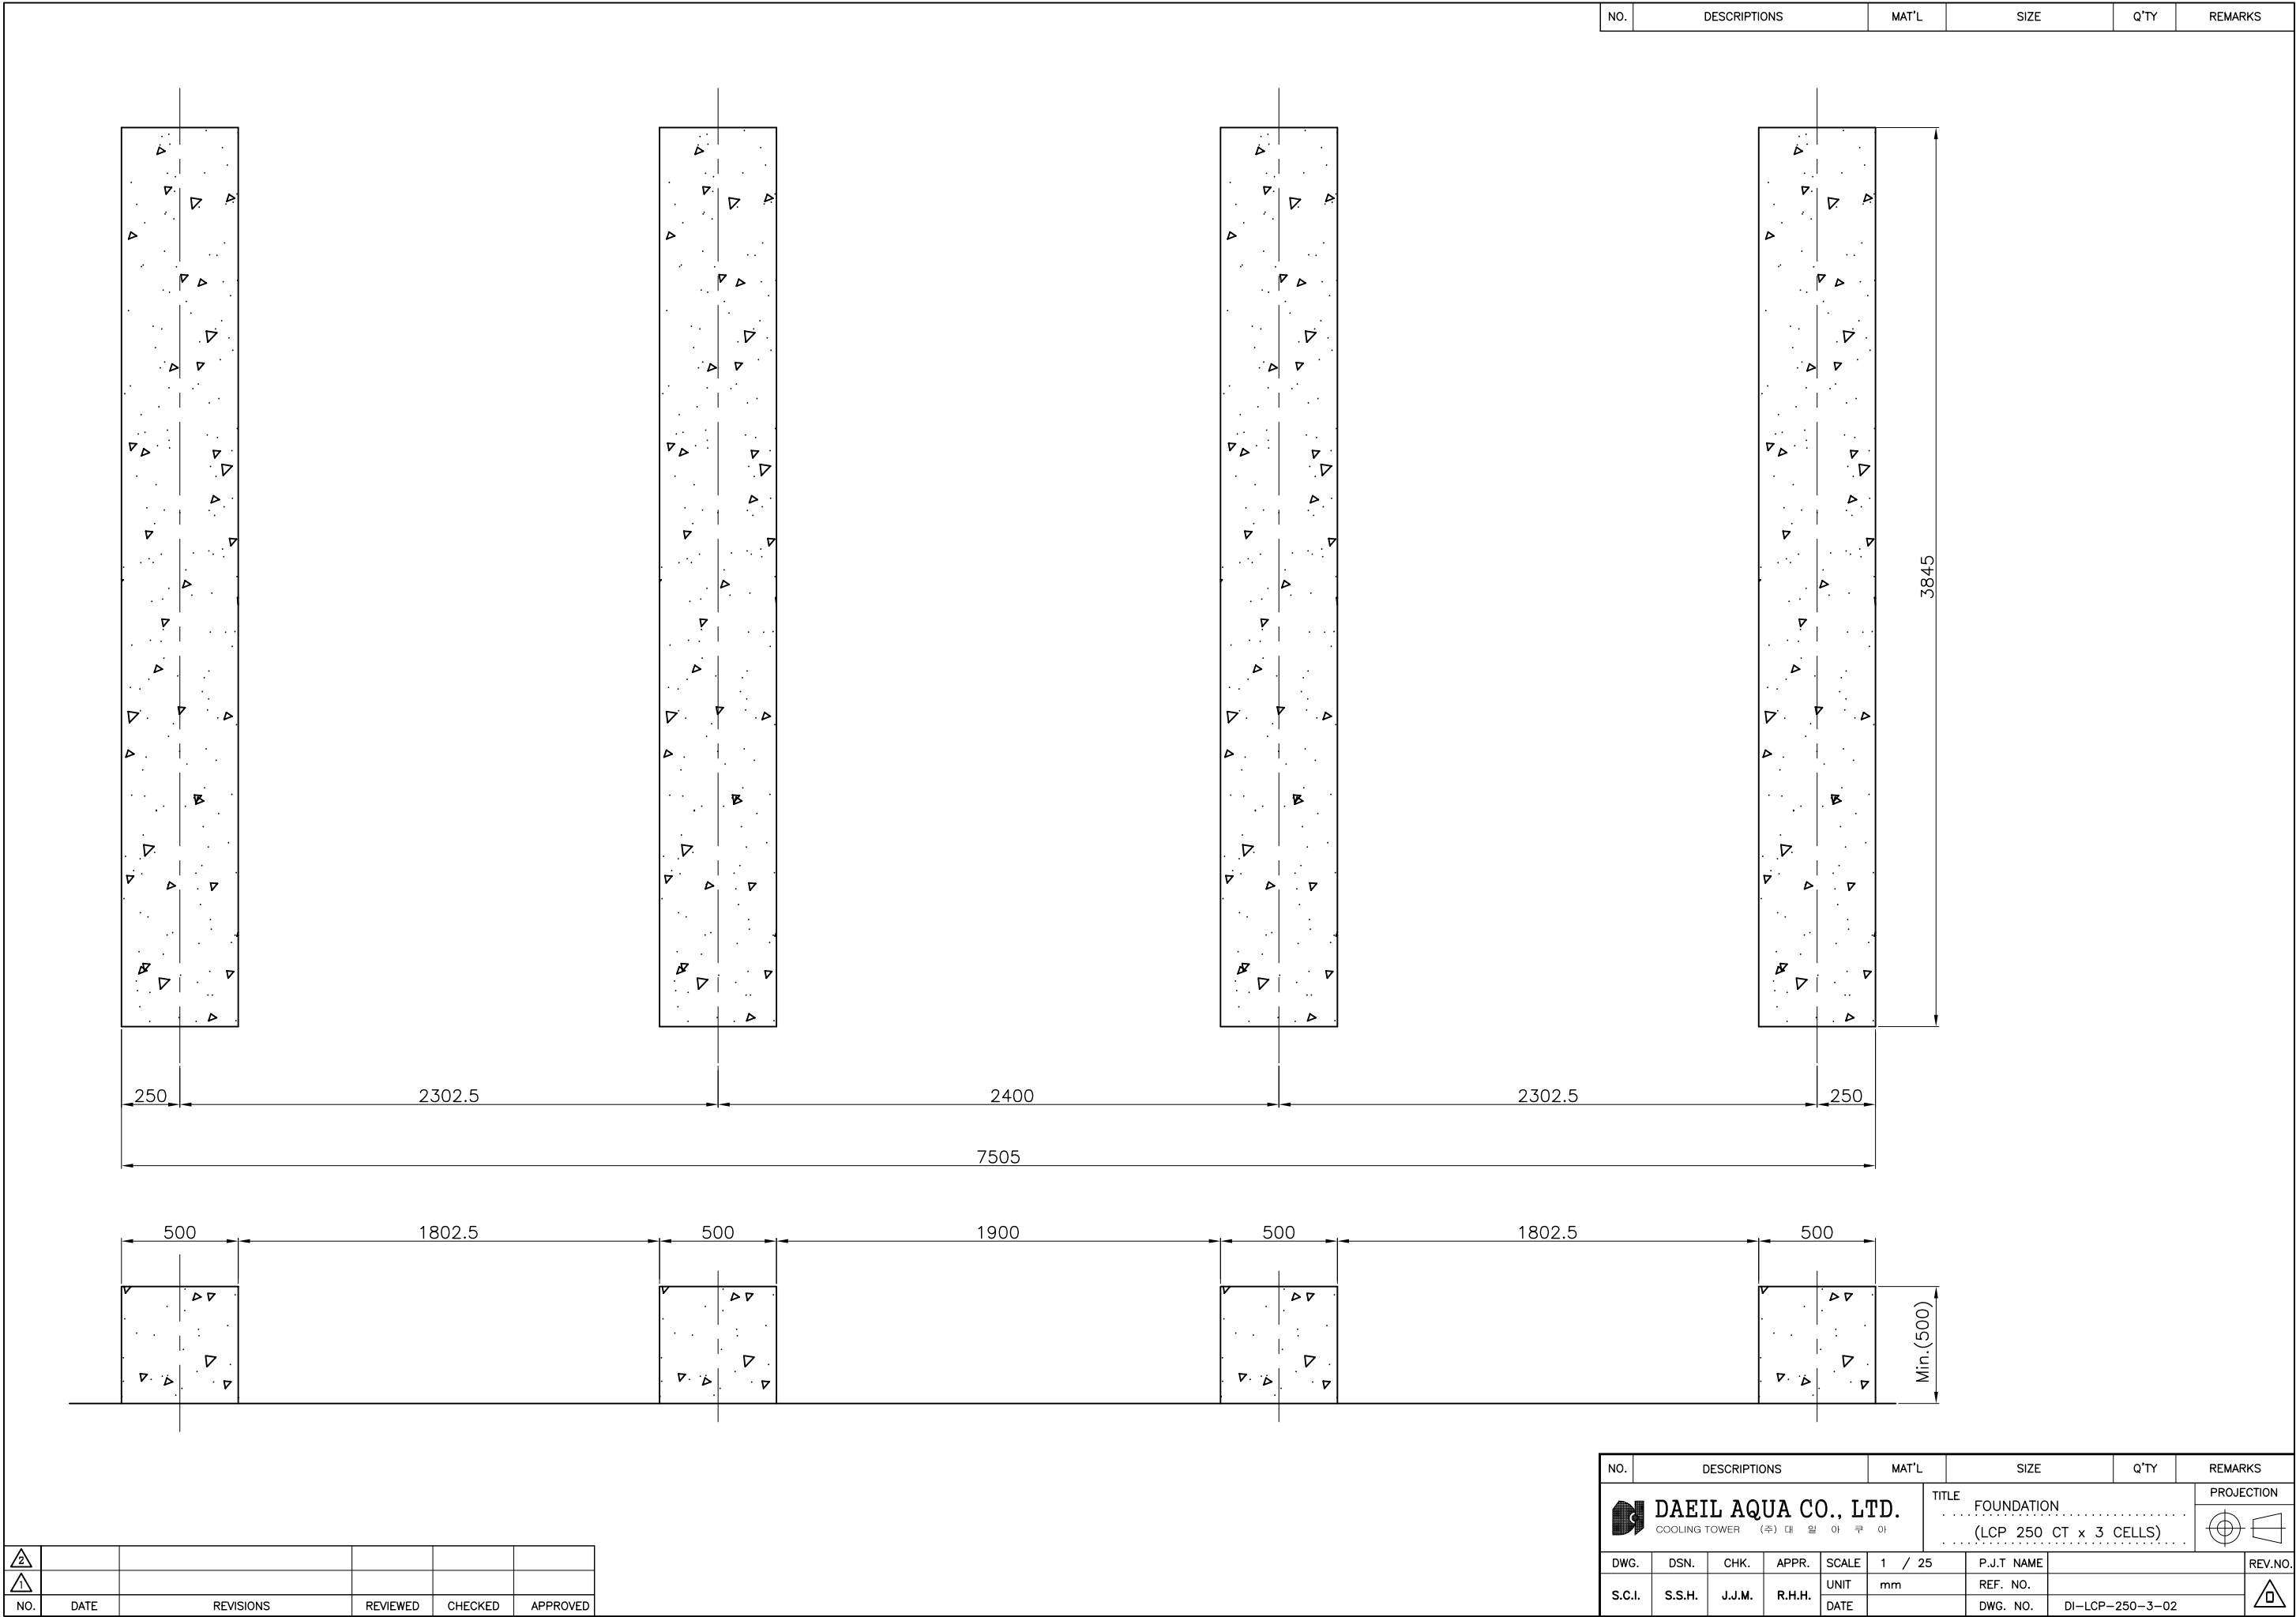

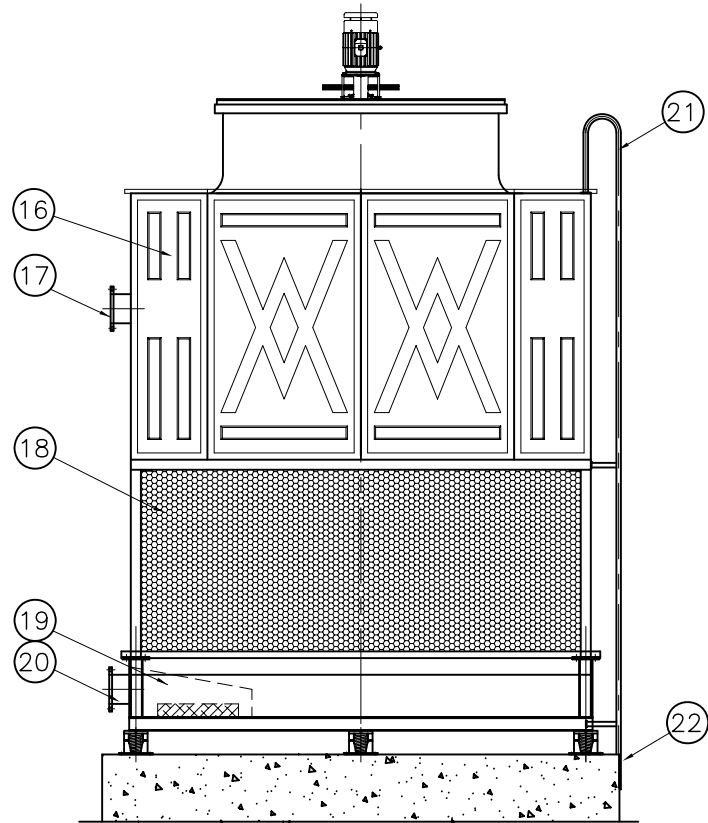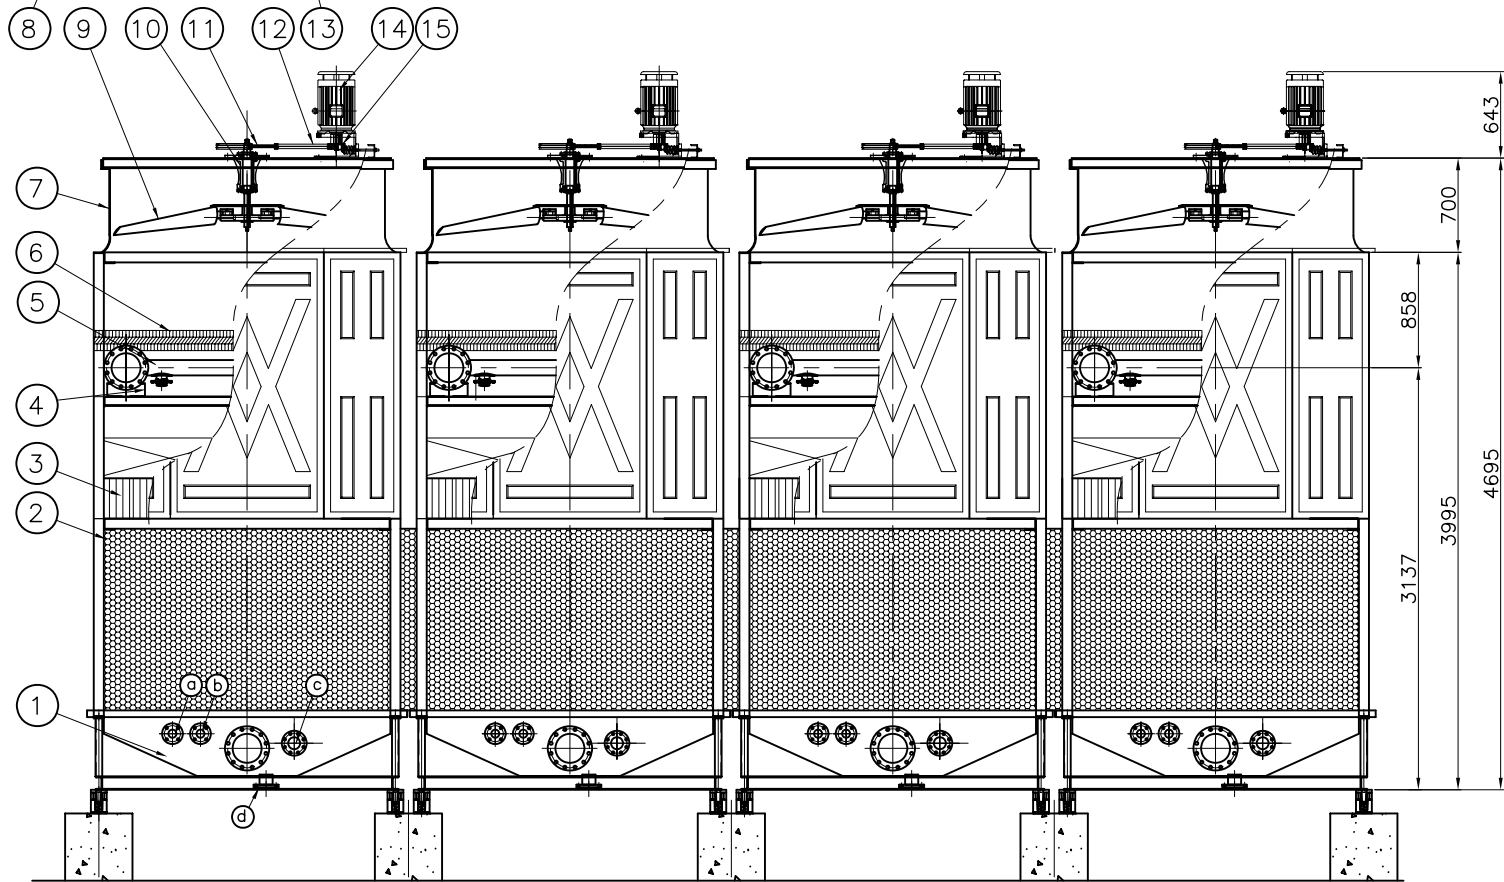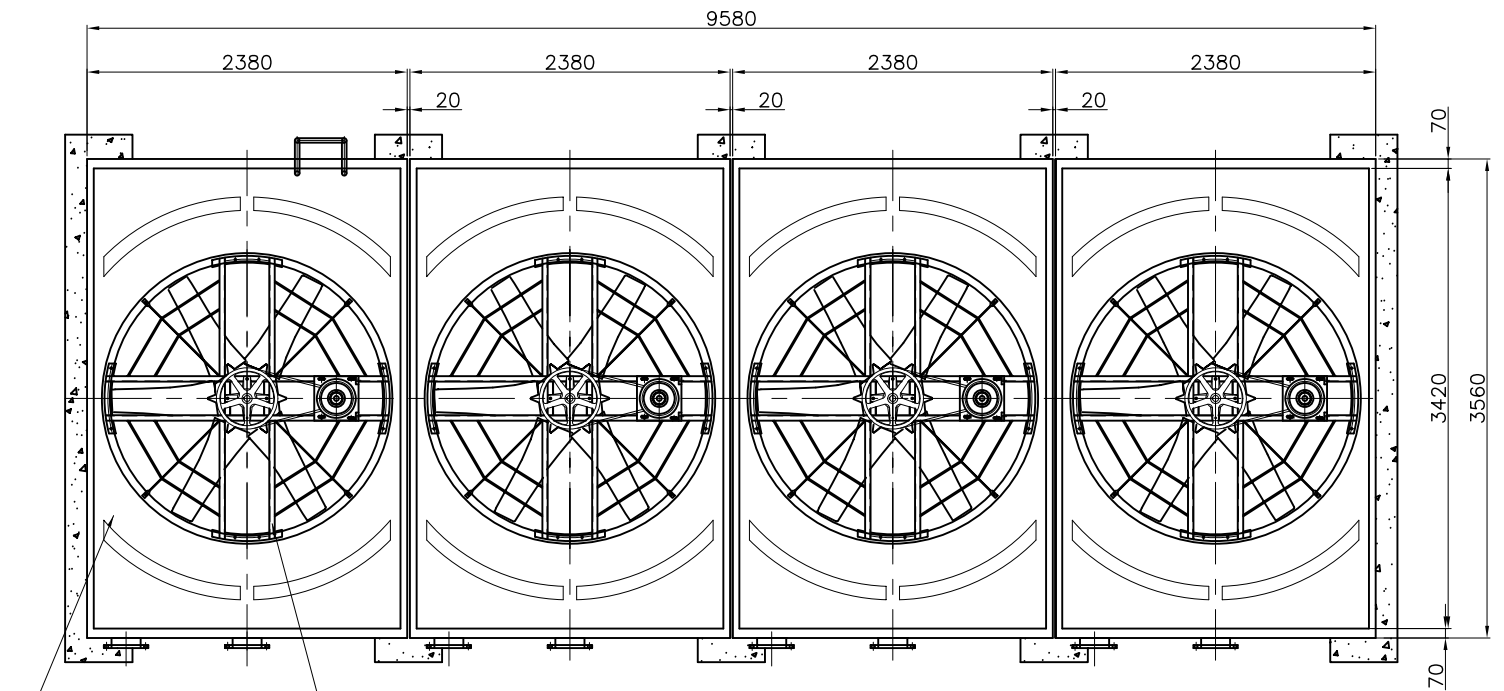


NO.	DESCRIPTIONS	MAT'L	IDENTIFICATION	Q'TY	REMARKS
1	COLD WATER BASIN	FRP	—	1 EA	
2	FRAMEWORK	SS400	75x75	1 EA	HDG
3	FILL	PVC	—	1 LOT	
4	WATER SPRAY NOZZLE	ABS	DK-D	12 EA	
5	LATERAL PIPE	PVC	100A	1 LOT	
6	DRIFT ELIMINATOR	PVC	—	1 LOT	
7	FAN CYLINDER	FRP	ø2030 $\pm_{-0}^{+10}$	1 EA	
8	FAN DECK	FRP	—	1 EA	
9	FAN ASSEMBLY	AL-ALLOY	ø2000	1 SET	
10	FAN DRIVE SHAFT PULLEY	FC200	5V1802	1 EA	
11	SPEED REDUCER	FC200	10HP	1 SET	
12	V-BELT	RUBBER	5VX900	2 EA	
13	MECH. EQUIPMENT BASE	SS400	—	1 EA	HDG
14	ELECTRIC MOTOR	TEFC	10HPx4P	1 EA	
15	MOTOR SHAFT PULLEY	FC200	5V502	1 EA	
16	CASING	FRP	—	1 LOT	
17	INLET PIPE	PVC	200A	1 EA	
18	AIR INLET SCREEN	PVC	—	1 LOT	
19	ANTI VORTEX BOX	FRP	—	1 EA	
20	OUTLET PIPE	SPP	200A	1 EA	HDG
21	LADDER	SPP	25A	1 EA	HDG
22	FOUNDATION	RF CON'C	—	1 LOT	BY OWNER

1. 상기 수량은 1 CELL에 대한 것임.
2. 본 기기와 연결되는 전선자재, 배관자재 및 공사는 공급범위에서 제외됨.
3. 기초 공사 제외.

△					
▽					
NO.	DATE	REVISIONS	REVIEWED	CHECKED	APPROVED

DESIGN CONDITIONS		NOZZLE SPECIFICATIONS						
WATER FLOW RATE	780 M ³ /HR	SYMBOL	DESCRIPTIONS	MAT'L	SIZE	Q'TY	REMARK	
NO. OF CELLS	4 CELL	a	MANUAL MAKE-UP	SPP	50 A	4 EA	FLANGE	
TEMP.	INLET 37 °C	b	AUTO. MAKE-UP	SPP	50 A	4 EA	FLANGE	
	OUTLET 32 °C	c	OVERFLOW	SPP	80 A	4 EA	FLANGE	
	WET BULB 27 °C	d	DRAIN	SPP	80 A	4 EA	FLANGE	




NO.	DESCRIPTIONS	MAT'L	SIZE	Q'TY	REMARKS
		TITLE ASSEMBLY & FOUNDATION			PROJECTION
		(250 CT x 4 CELLS)			
DWG.	DSN.	CHK.	APPR.	SCALE 1 / 55	P.J.T NAME
S.C.I.	S.S.H.	J.J.M.	R.H.H.	UNIT mm	REF. NO.
				DATE	DWG. NO. DI-LCP-250-4-01

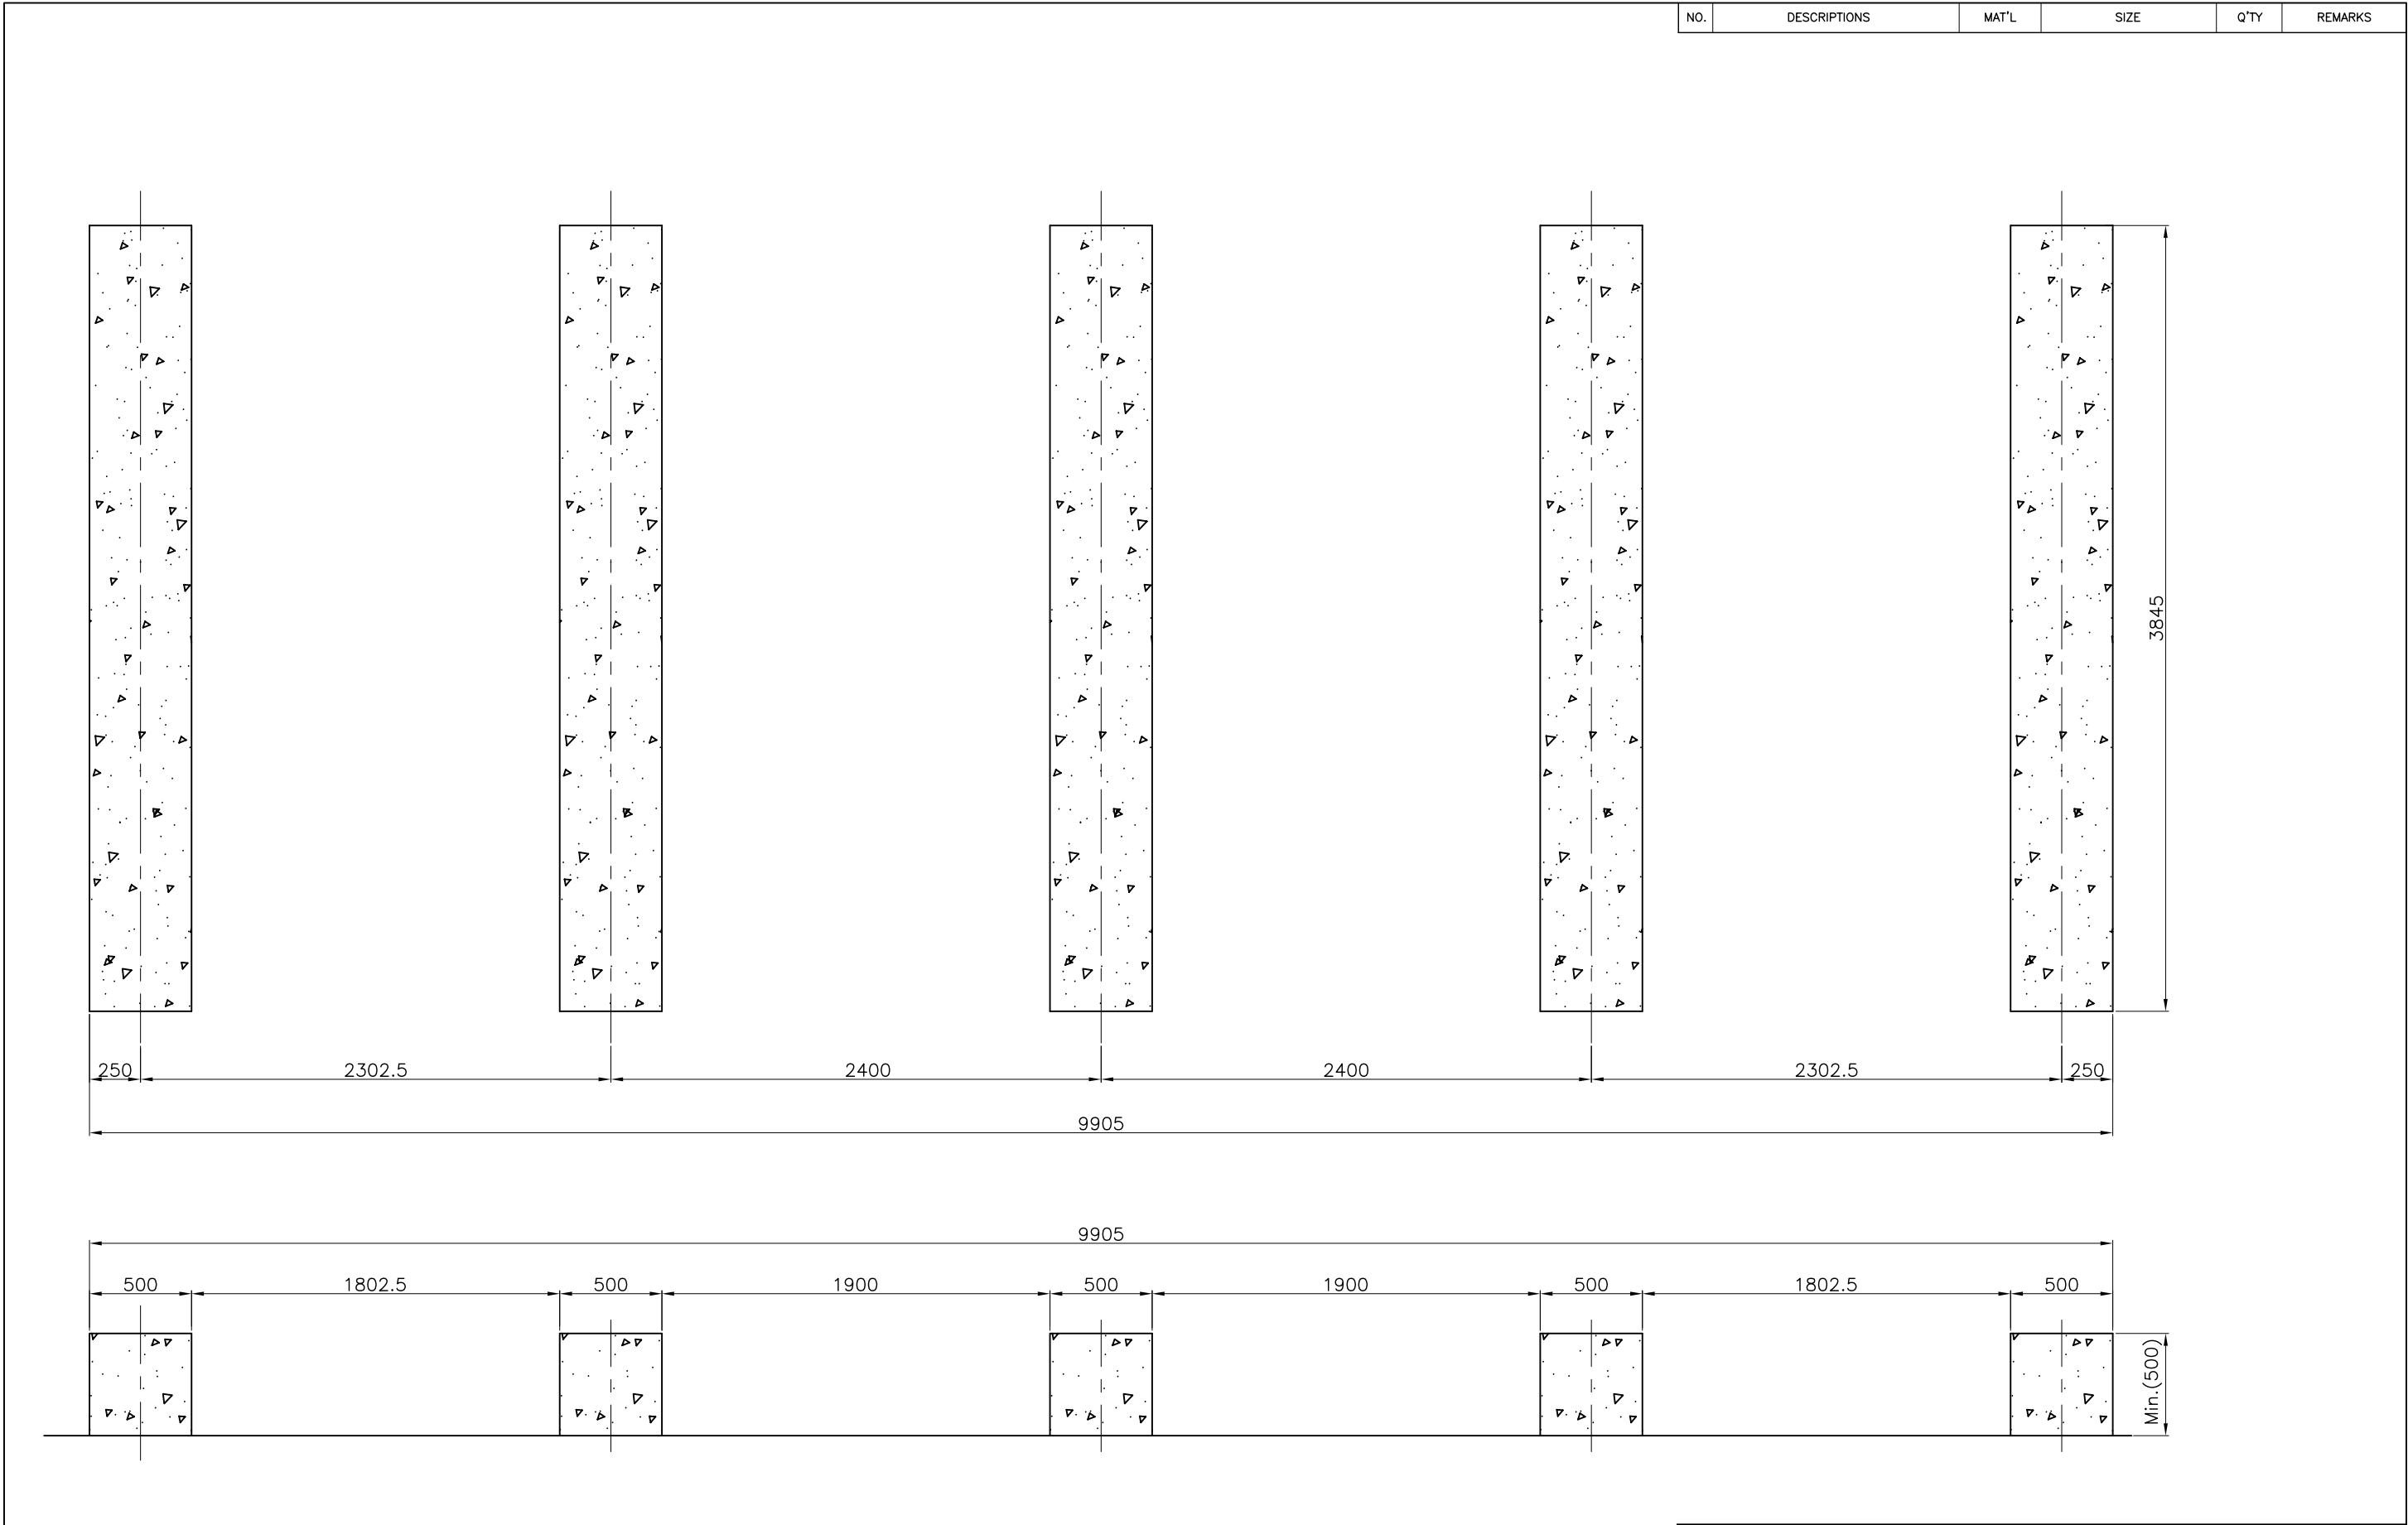

NO.	DATE	REVISIONS	REVIEWED	CHECKED	APPROVED

NO.	DESCRIPTIONS	MAT'L	SIZE	Q'TY	REMARKS
-----	--------------	-------	------	------	---------

NO.	DESCRIPTIONS				MAT'L	SIZE		Q'TY	REMARKS	
 DAEIL AQUA CO., LTD. COOLING TOWER (주) 대 일 아 쿠 아					TITLE FOUNDATION (LCP 250 CT x 4 CELLS)		PROJECTION			
										
DWG.	DSN.	CHK.	APPR.	SCALE	1 / 30	P.J.T NAME				
S.C.I.	S.S.H.	J.J.M.	R.H.H.	UNIT	mm	REF. NO.				
				DATE		DWG. NO.	DI-LCP-250-4-02			
									REV.NO.	

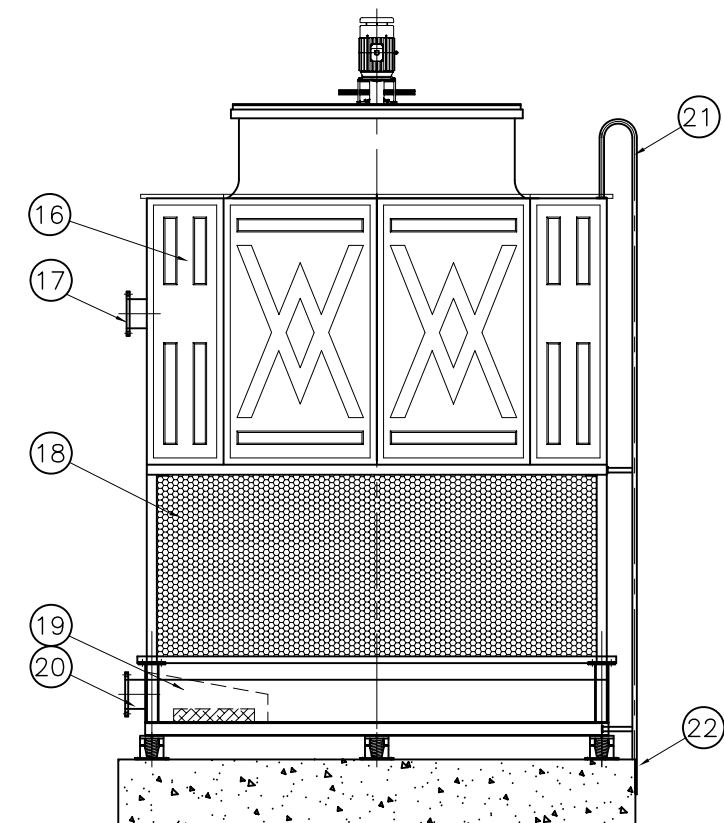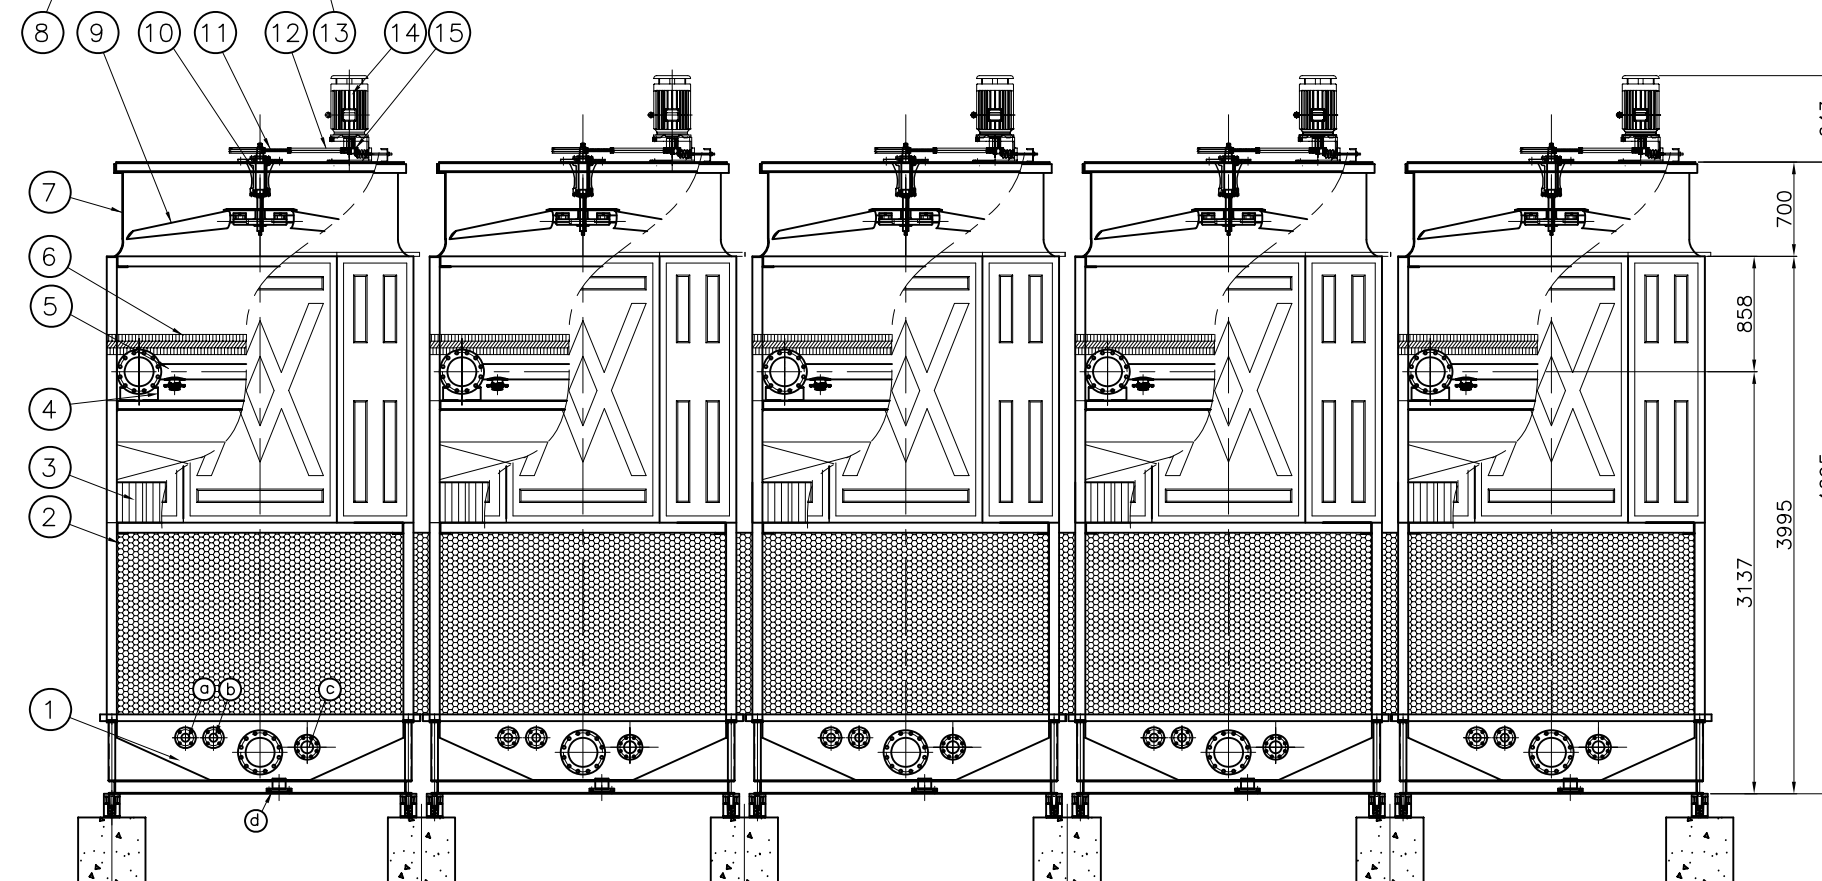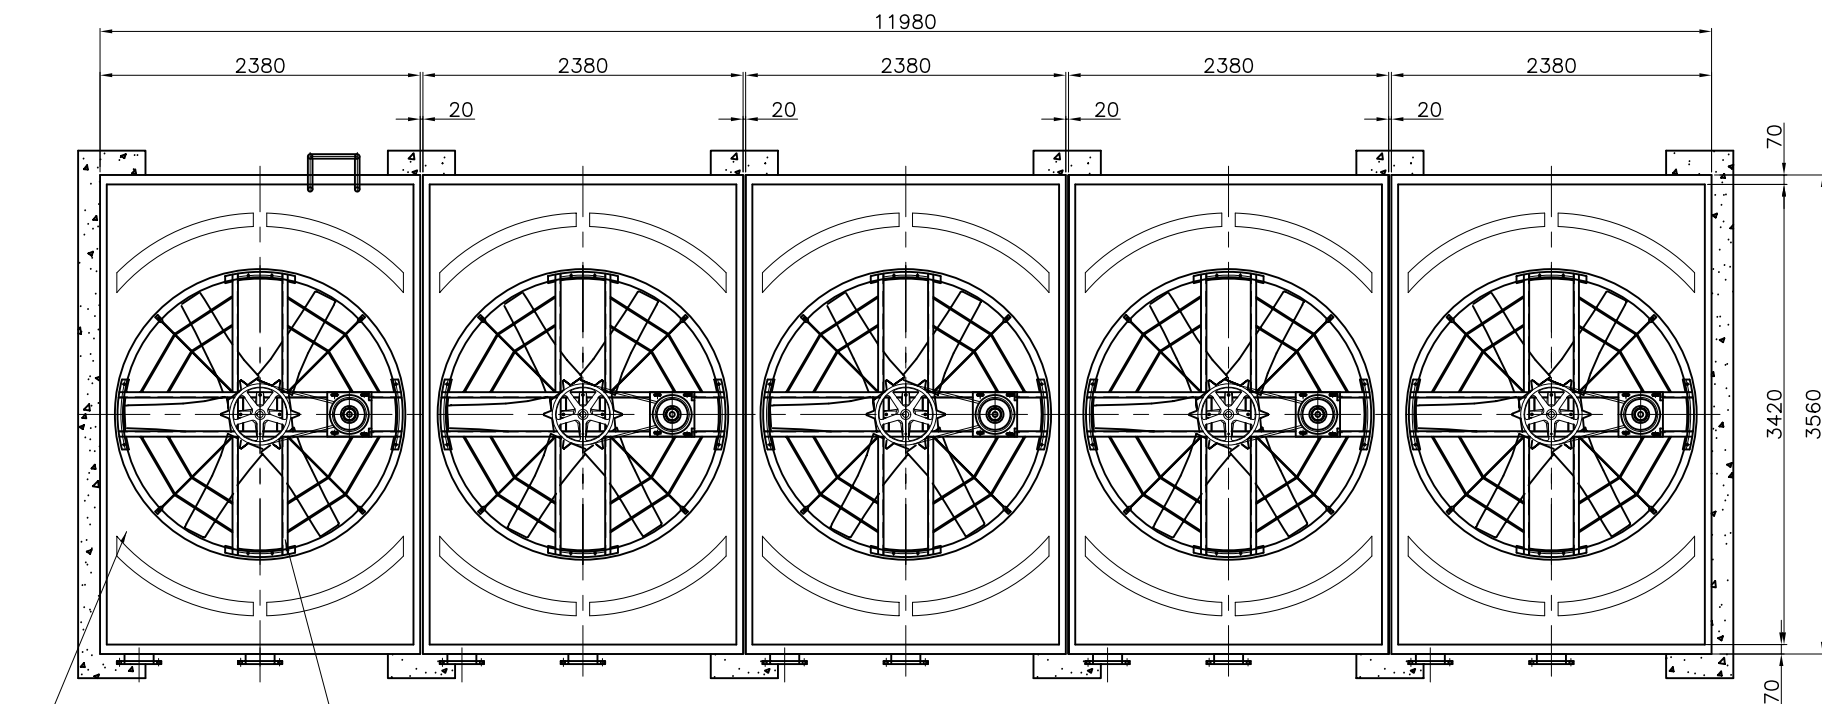

						DESIGN CONDITIONS		NOZZLE SPECIFICATIONS						NO.		DESCRIPTIONS		MAT'L	SIZE		Q'TY	REMARKS		
						WATER FLOW RATE		975 M ³ /HR	SYMBOL	DESCRIPTIONS		MAT'L	SIZE	Q'TY	REMARK							TITLE	ASSEMBLY & FOUNDATION	PROJECTION
						NO. OF CELLS		5 CELL	a	MANUAL MAKE-UP		SPP	50 A	5 EA	FLANGE	 DAEIL AQUA CO.,LTD. COOLING TOWER (주) 대 일 아 쿠 이						(250 CT x 5 CELLS)		
						TEMP.	INLET	37 °C	b	AUTO. MAKE-UP	SPP	50 A	5 EA	FLANGE	DWG.	DSN.	CHK.	APPR.	SCALE	1 / 55	P.J.T NAME			
							OUTLET	32 °C	c	OVERFLOW	SPP	80 A	5 EA	FLANGE	S.C.I.	S.S.H.	J.J.M.	R.H.H.	UNIT	mm	REF. NO.			
NO.	DATE	REVISIONS	REVIEWED	CHECKED	APPROVED		WET BULB	27 °C	d	DRAIN	SPP	80 A	5 EA	FLANGE	DATE	DWG. NO.			DI-LCP-250-5-01					

