
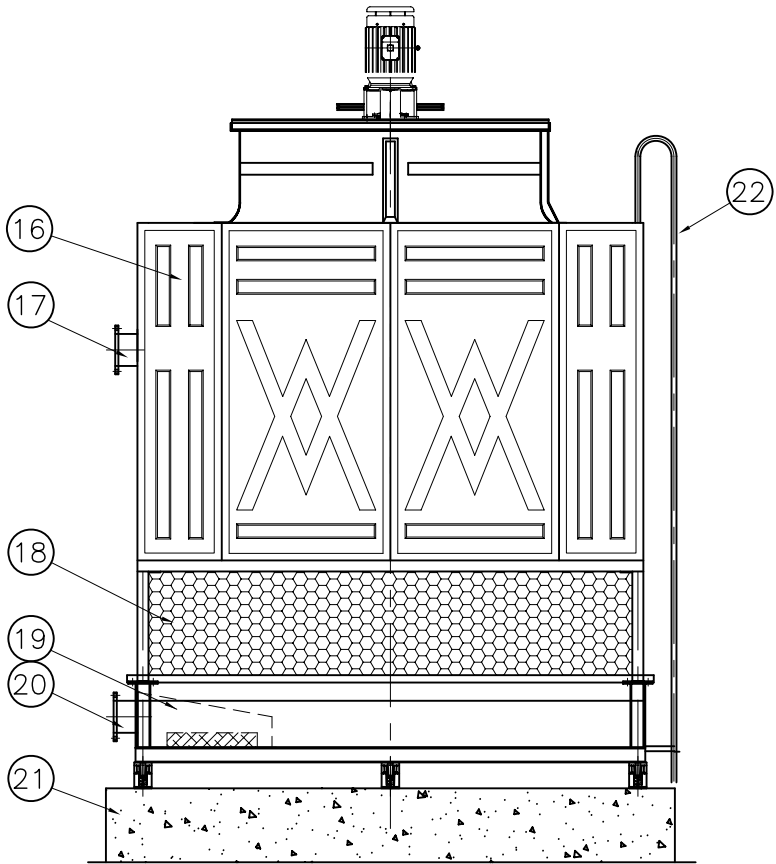
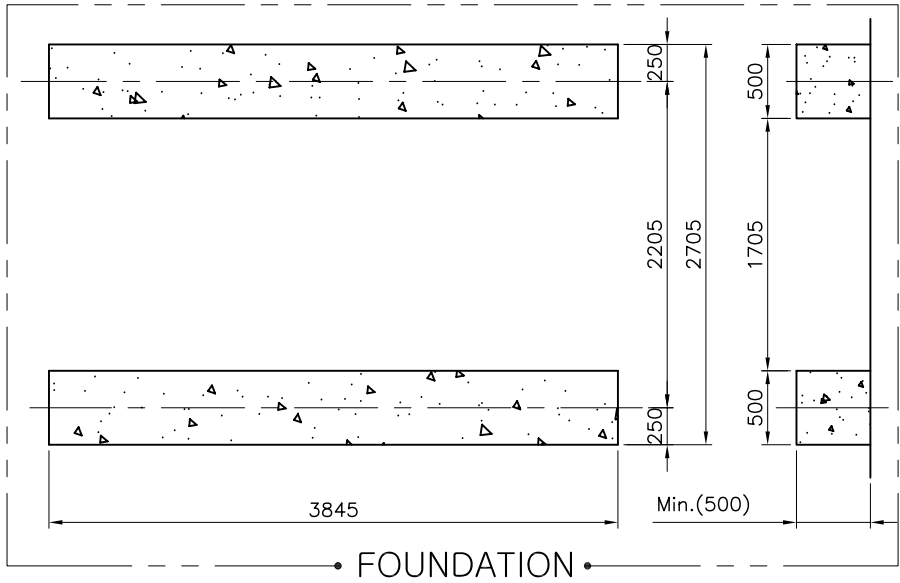


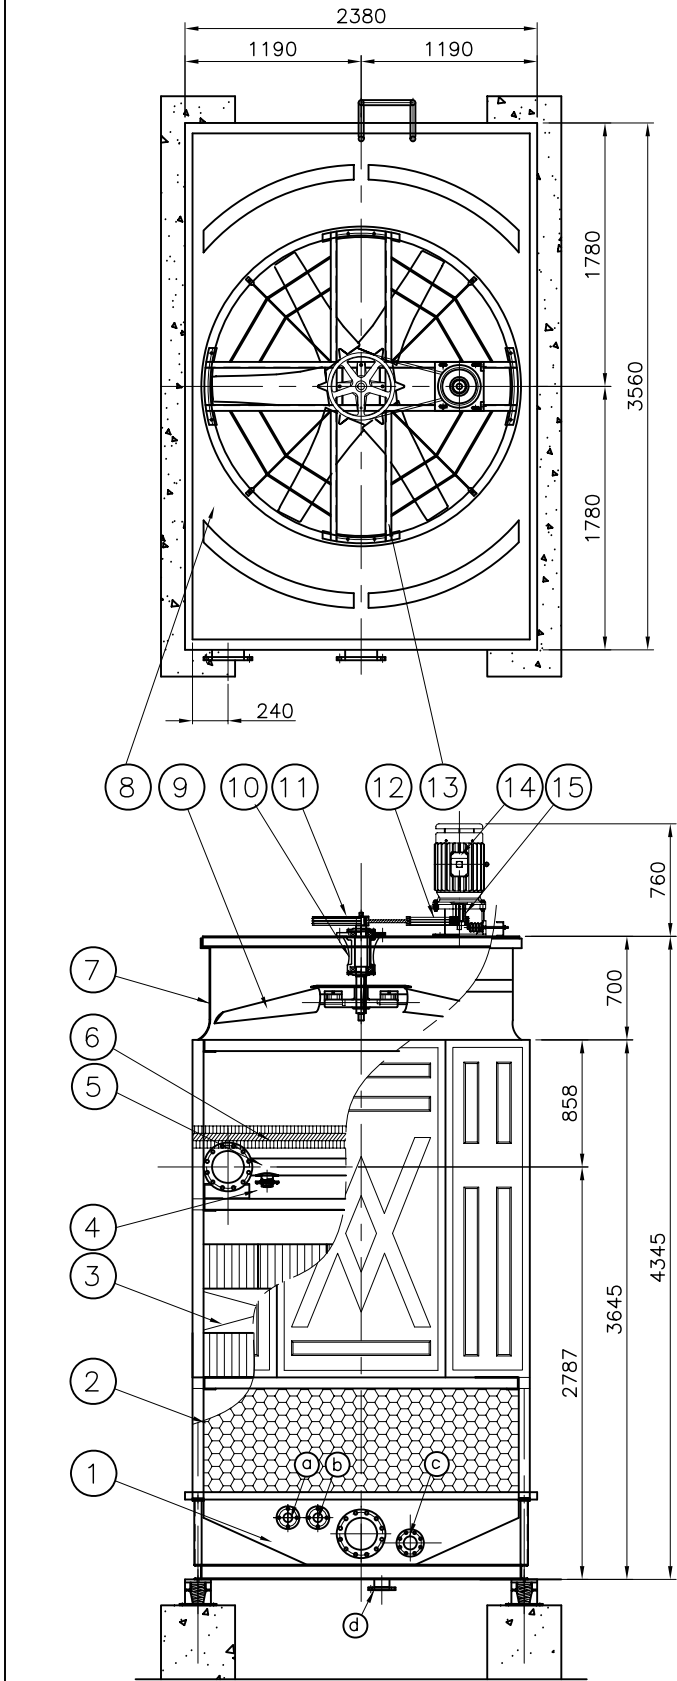



NO.	DESCRIPTIONS	MAT'L	IDENTIFICATION	Q'TY	REMARKS
1	COLD WATER BASIN	FRP	—	1 EA	
2	FRAMEWORK	SS400	75x75	1 EA	HDG
3	FILL	PVC	—	1 LOT	
4	WATER SPRAY NOZZLE	ABS	DK-D	12 EA	
5	LATRAL PIPE	PVC	100A	1 LOT	
6	DRIFT ELIMINATOR	PVC	—	1 LOT	
7	FAN CYLINDER	FRP	ø2020 $\pm_{-0}^{+10}$	1 EA	
8	FAN DECK	FRP	—	1 EA	
9	FAN ASSEMBLY	AL-ALLOY	ø2000	1 SET	
10	SPEED REDUCER	FC200	15HP	1 SET	
11	FAN DRIVE SHAFT PULLEY	FC200	5V1803	1 EA	
12	V-BELT	RUBBER	5V900	2 EA	
13	MECH. EQUIPMENT BASE	SS400	—	1 EA	HDG
14	ELECTRIC MOTOR	TEFC	15HPx4P	1 EA	
15	MOTOR SHAFT PULLEY	FC200	5V503	1 EA	
16	CASING	FRP	—	1 LOT	
17	INLET PIPE	PVC	200A	1 EA	
18	AIR INLET SCREEN	PVC	—	1 LOT	
19	ANTI VORTEX BOX	FRP	—	1 EA	HDG
20	OUTLET PIPE	SPP	200A	1 EA	HDG
21	FOUNDATION	RF CON'C	—	1 LOT	BY OWNER
22	LADDER	SPP	25A	1 EA	HDG

1. 상기 수량은 1 CELL에 대한 것임.
2. 본 기기와 연결되는 전선자재, 배관자재 및 공사는 공급범위에서 제외됨.
3. 기초 공사 제외.

△					
▽					
NO.	DATE	REVISIONS	REVIEWED	CHECKED	APPROVED


DESIGN CONDITIONS		NOZZLE SPECIFICATIONS						
WATER FLOW RATE		234	M ³ /HR	SYMBOL	DESCRIPTIONS	MAT'L	SIZE	Q'TY
NO. OF CELLS		1	CELL	a	MANUAL MAKE-UP	SPP	50 A	1 EA
TEMP.	INLET	37	°C	b	AUTO. MAKE-UP	SPP	50 A	1 EA
	OUTLET	32	°C	c	OVERFLOW	SPP	80 A	1 EA
	WET BULB	27	°C	d	DRAIN	SPP	80 A	1 EA

NO.	DESCRIPTIONS	MAT'L	SIZE	Q'TY	REMARKS
DAEIL AQUA CO.,LTD.		TITLE		PROJECTION	
COOLING TOWER (주) 대 일 아 쿠 아		ASSEMBLY & FOUNDATION		(300 CT)	
DWG.	DSN.	CHK.	APPR.	SCALE	1 / 50
S.C.I.	S.S.H.	J.J.M.	R.H.H.	UNIT	mm
DATE		REF. NO.		DWG. NO.	
				DI-LCP-300-01	


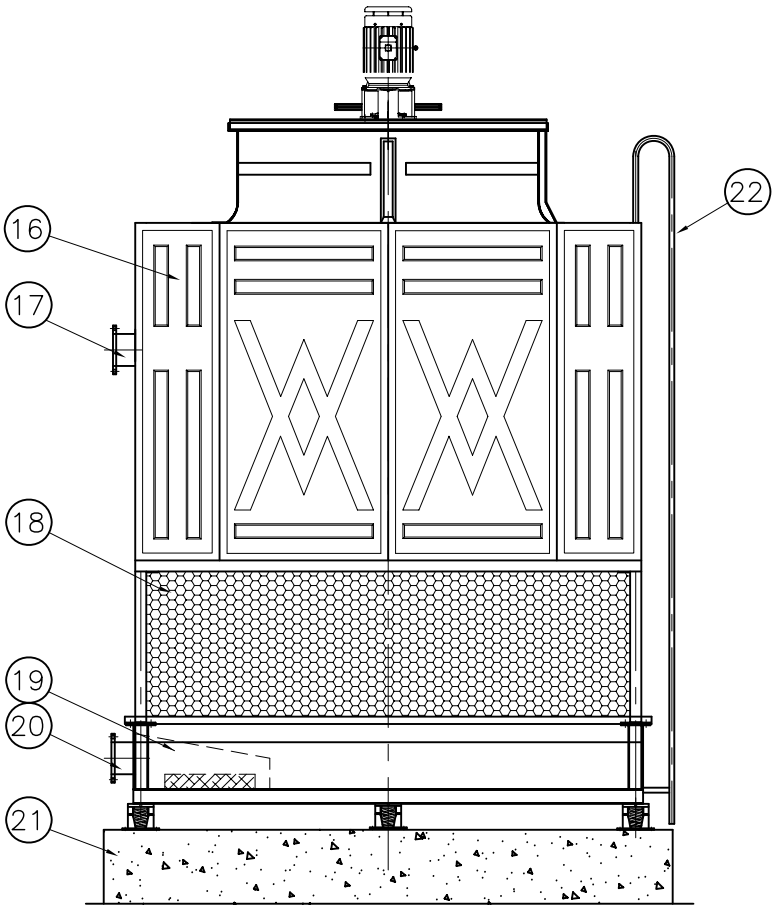
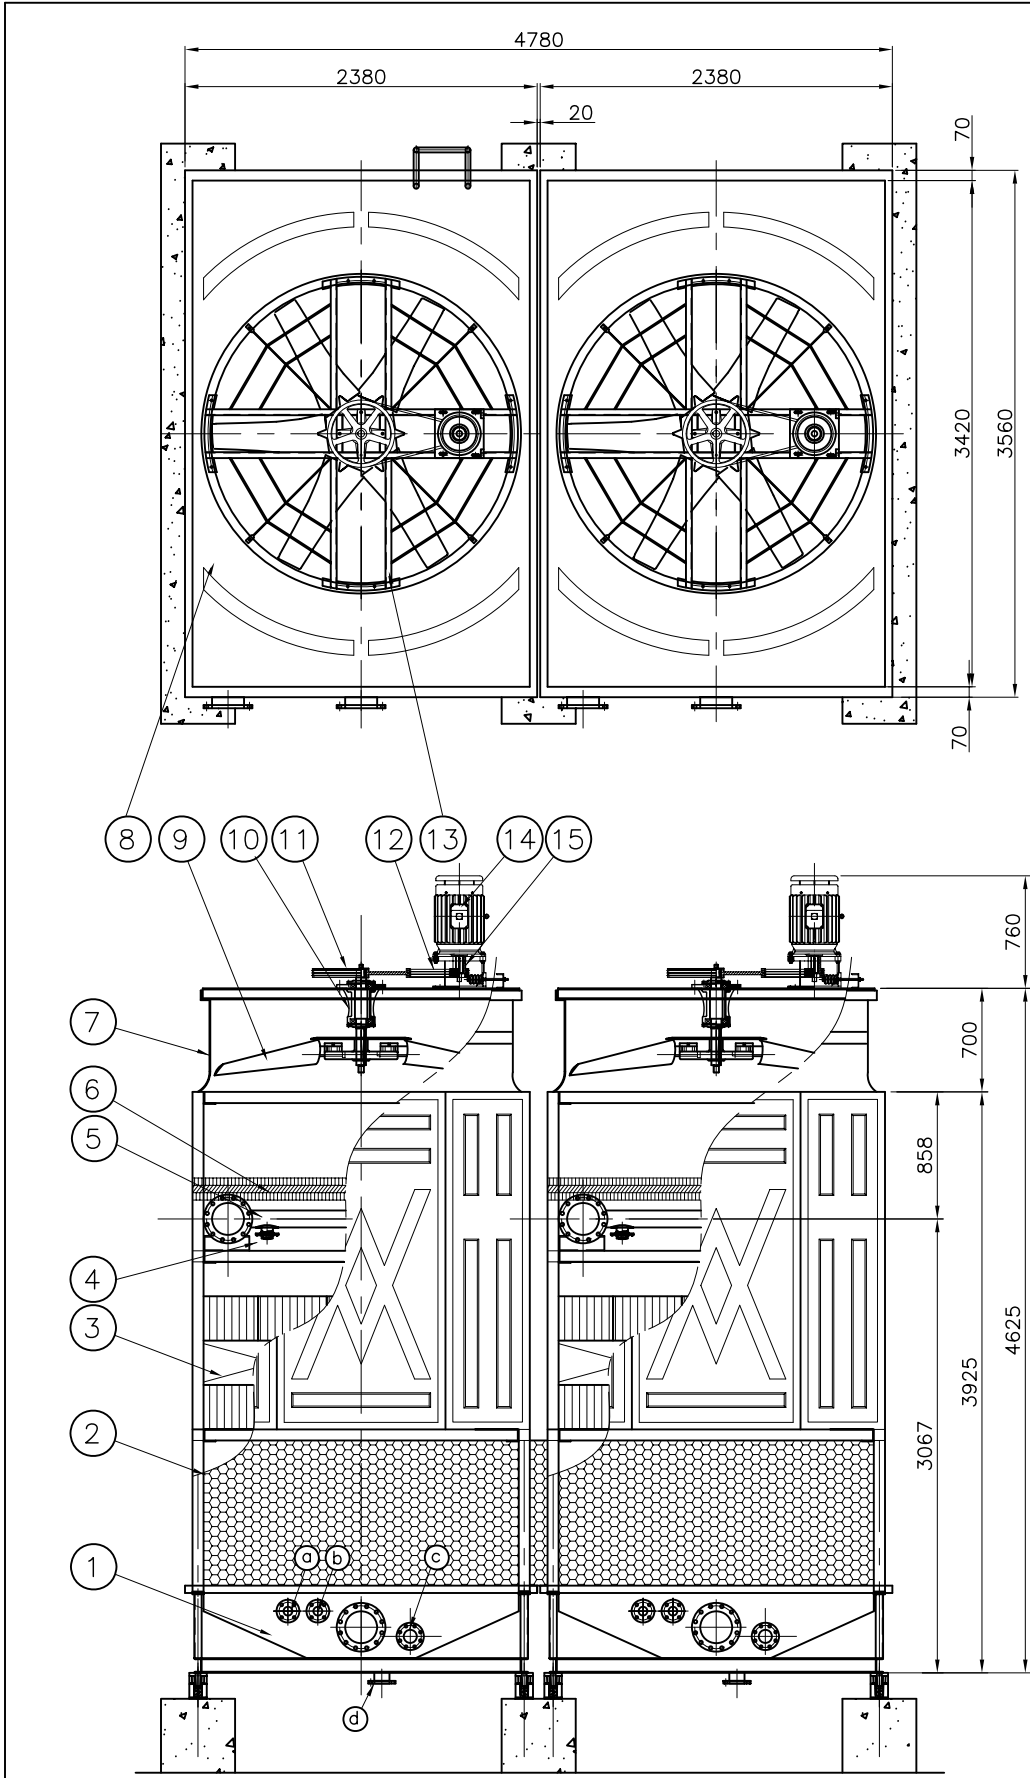


NO.	DESCRIPTIONS	MAT'L	IDENTIFICATION	Q'TY	REMARKS
1	COLD WATER BASIN	FRP	—	1 EA	
2	FRAMEWORK	SS400	75x75	1 EA	HDG
3	FILL	PVC	—	1 LOT	
4	WATER SPRAY NOZZLE	ABS	DK-D	12 EA	
5	LATRAL PIPE	PVC	100A	1 LOT	
6	DRIFT ELIMINATOR	PVC	—	1 LOT	
7	FAN CYLINDER	FRP	ø2020 $\pm_{-10}^{+10}$	1 EA	
8	FAN DECK	FRP	—	1 EA	
9	FAN ASSEMBLY	AL-ALLOY	ø2000	1 SET	
10	SPEED REDUCER	FC200	15HP	1 SET	
11	FAN DRIVE SHAFT PULLEY	FC200	5V1803	1 EA	
12	V-BELT	RUBBER	5V900	2 EA	
13	MECH. EQUIPMENT BASE	SS400	—	1 EA	HDG
14	ELECTRIC MOTOR	TEFC	15HPx4P	1 EA	
15	MOTOR SHAFT PULLEY	FC200	5V503	1 EA	
16	CASING	FRP	—	1 LOT	
17	INLET PIPE	PVC	200A	1 EA	
18	AIR INLET SCREEN	PVC	—	1 LOT	
19	ANTI VORTEX BOX	FRP	—	1 EA	
20	OUTLET PIPE	SPP	200A	1 EA	HDG
21	FOUNDATION	RF CON'C	—	1 LOT	BY OWNER
22	LADDER	SPP	25A	1 EA	HDG


1. 상기 수량은 1 CELL에 대한 것임.
2. 본 기기와 연결되는 전선자재, 배관자재 및 공사는 공급범위에서 제외됨.
3. 기초 공사 제외.



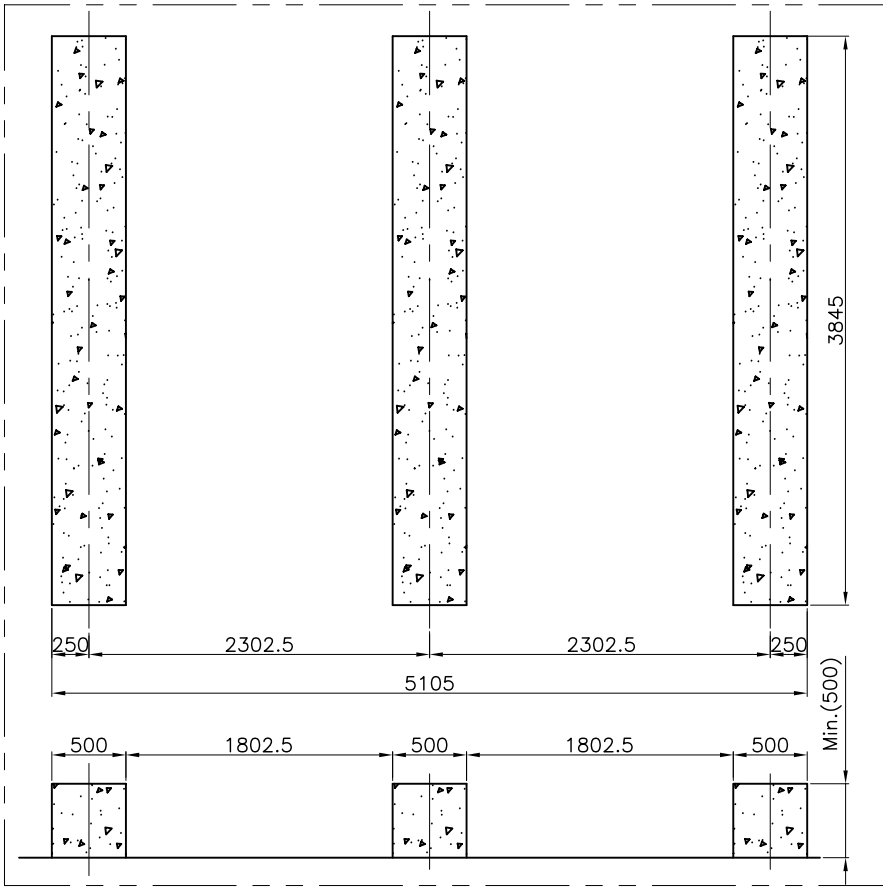


						DESIGN CONDITIONS		NOZZLE SPECIFICATIONS						NO.	DESCRIPTIONS			MAT'L	SIZE		Q'TY	REMARKS	
						WATER FLOW RATE		468	M ³ /HR	SYMBOL	DESCRIPTIONS	MAT'L	SIZE	Q'TY	REMARK	DAEIL AQUA CO.,LTD. COOLING TOWER (주) 대 일 아 쿠 아 TITLE ASSEMBLY & FOUNDATION (300 CT x 2 CELLS)			PROJECTION				
						NO. OF CELLS		2	CELL	a	MANUAL MAKE-UP	SPP	50 A	2 EA	FLANGE								
						TEMP.	INLET	37	°C	b	AUTO. MAKE-UP	SPP	50 A	2 EA	FLANGE	DWG.	DSN.	CHK.	APPR.	SCALE	1 / 50	P.J.T NAME	
							OUTLET	32	°C	c	OVERFLOW	SPP	80 A	2 EA	FLANGE					UNIT	mm	REF. NO.	
NO.	DATE	REVISIONS	REVIEWED	CHECKED	APPROVED		WET BULB	27	°C	d	DRAIN	SPP	80 A	2 EA	FLANGE					DATE	DWG. NO.	DI-LCP-300-2-01	

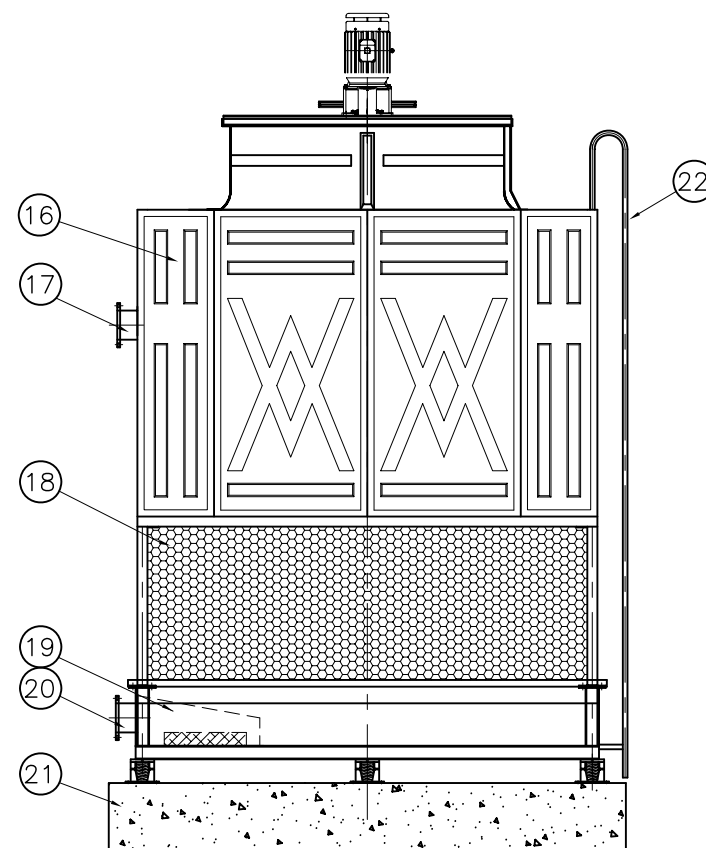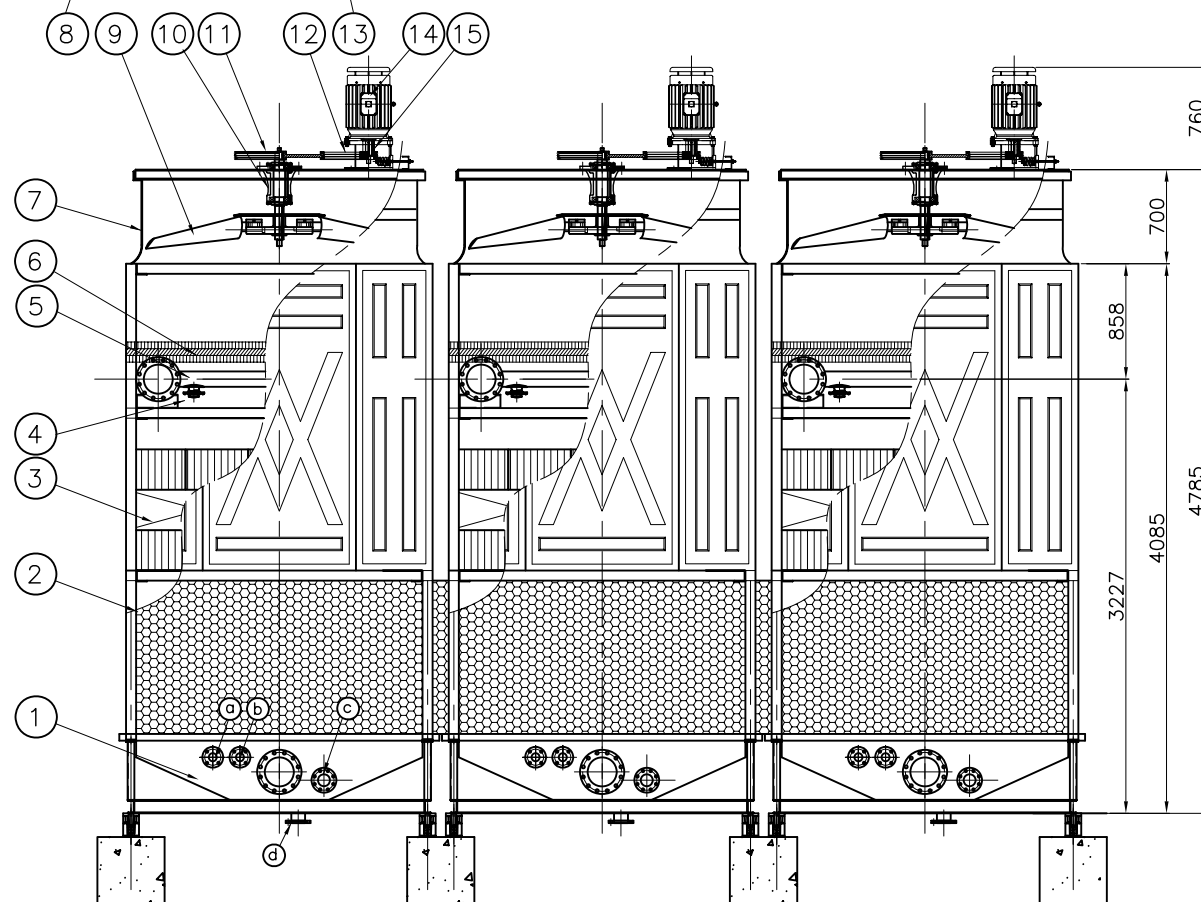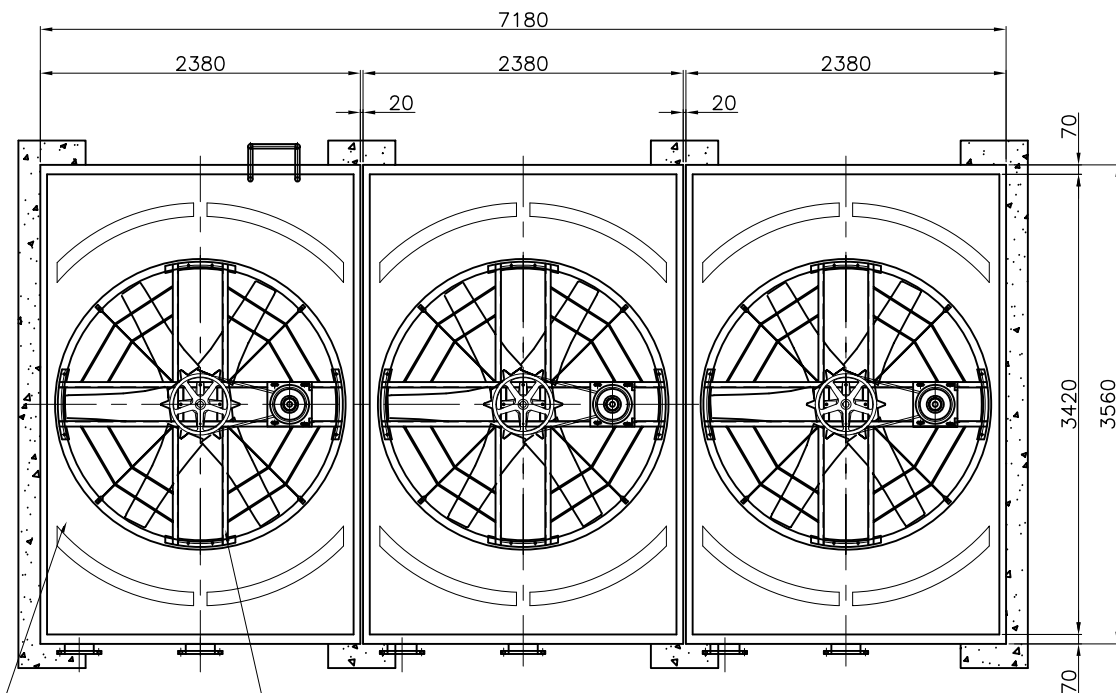

						DESIGN CONDITIONS		NOZZLE SPECIFICATIONS						NO.	DESCRIPTIONS				MAT'L	SIZE		Q'TY	REMARKS					
						WATER FLOW RATE		702 M ³ /HR		SYMBOL	DESCRIPTIONS		MAT'L	SIZE		Q'TY		REMARK	DAEIL AQUA CO.,LTD. COOLING TOWER (주) 대 일 아 쿠 아 TITLE ASSEMBLY & FOUNDATION(300 CT x 3 CELLS)..... 									
						NO. OF CELLS		3 CELL		a	MANUAL MAKE-UP		SPP	50 A		3 EA		FLANGE										
						TEMP.	INLET	37 °C	b	AUTO. MAKE-UP		SPP	50 A		3 EA		FLANGE		DWG.	DSN.	CHK.	APPR.	SCALE	1 / 55	P.J.T NAME			
							OUTLET	32 °C	c	OVERFLOW		SPP	80 A		3 EA		FLANGE						UNIT	mm	REF. NO.			
NO.	DATE	REVISIONS		REVIEWED	CHECKED		APPROVED	WET BULB	27 °C	d	DRAIN		SPP	80 A		3 EA		FLANGE					DATE		DWG. NO.		DI-LCP-300-3-01	

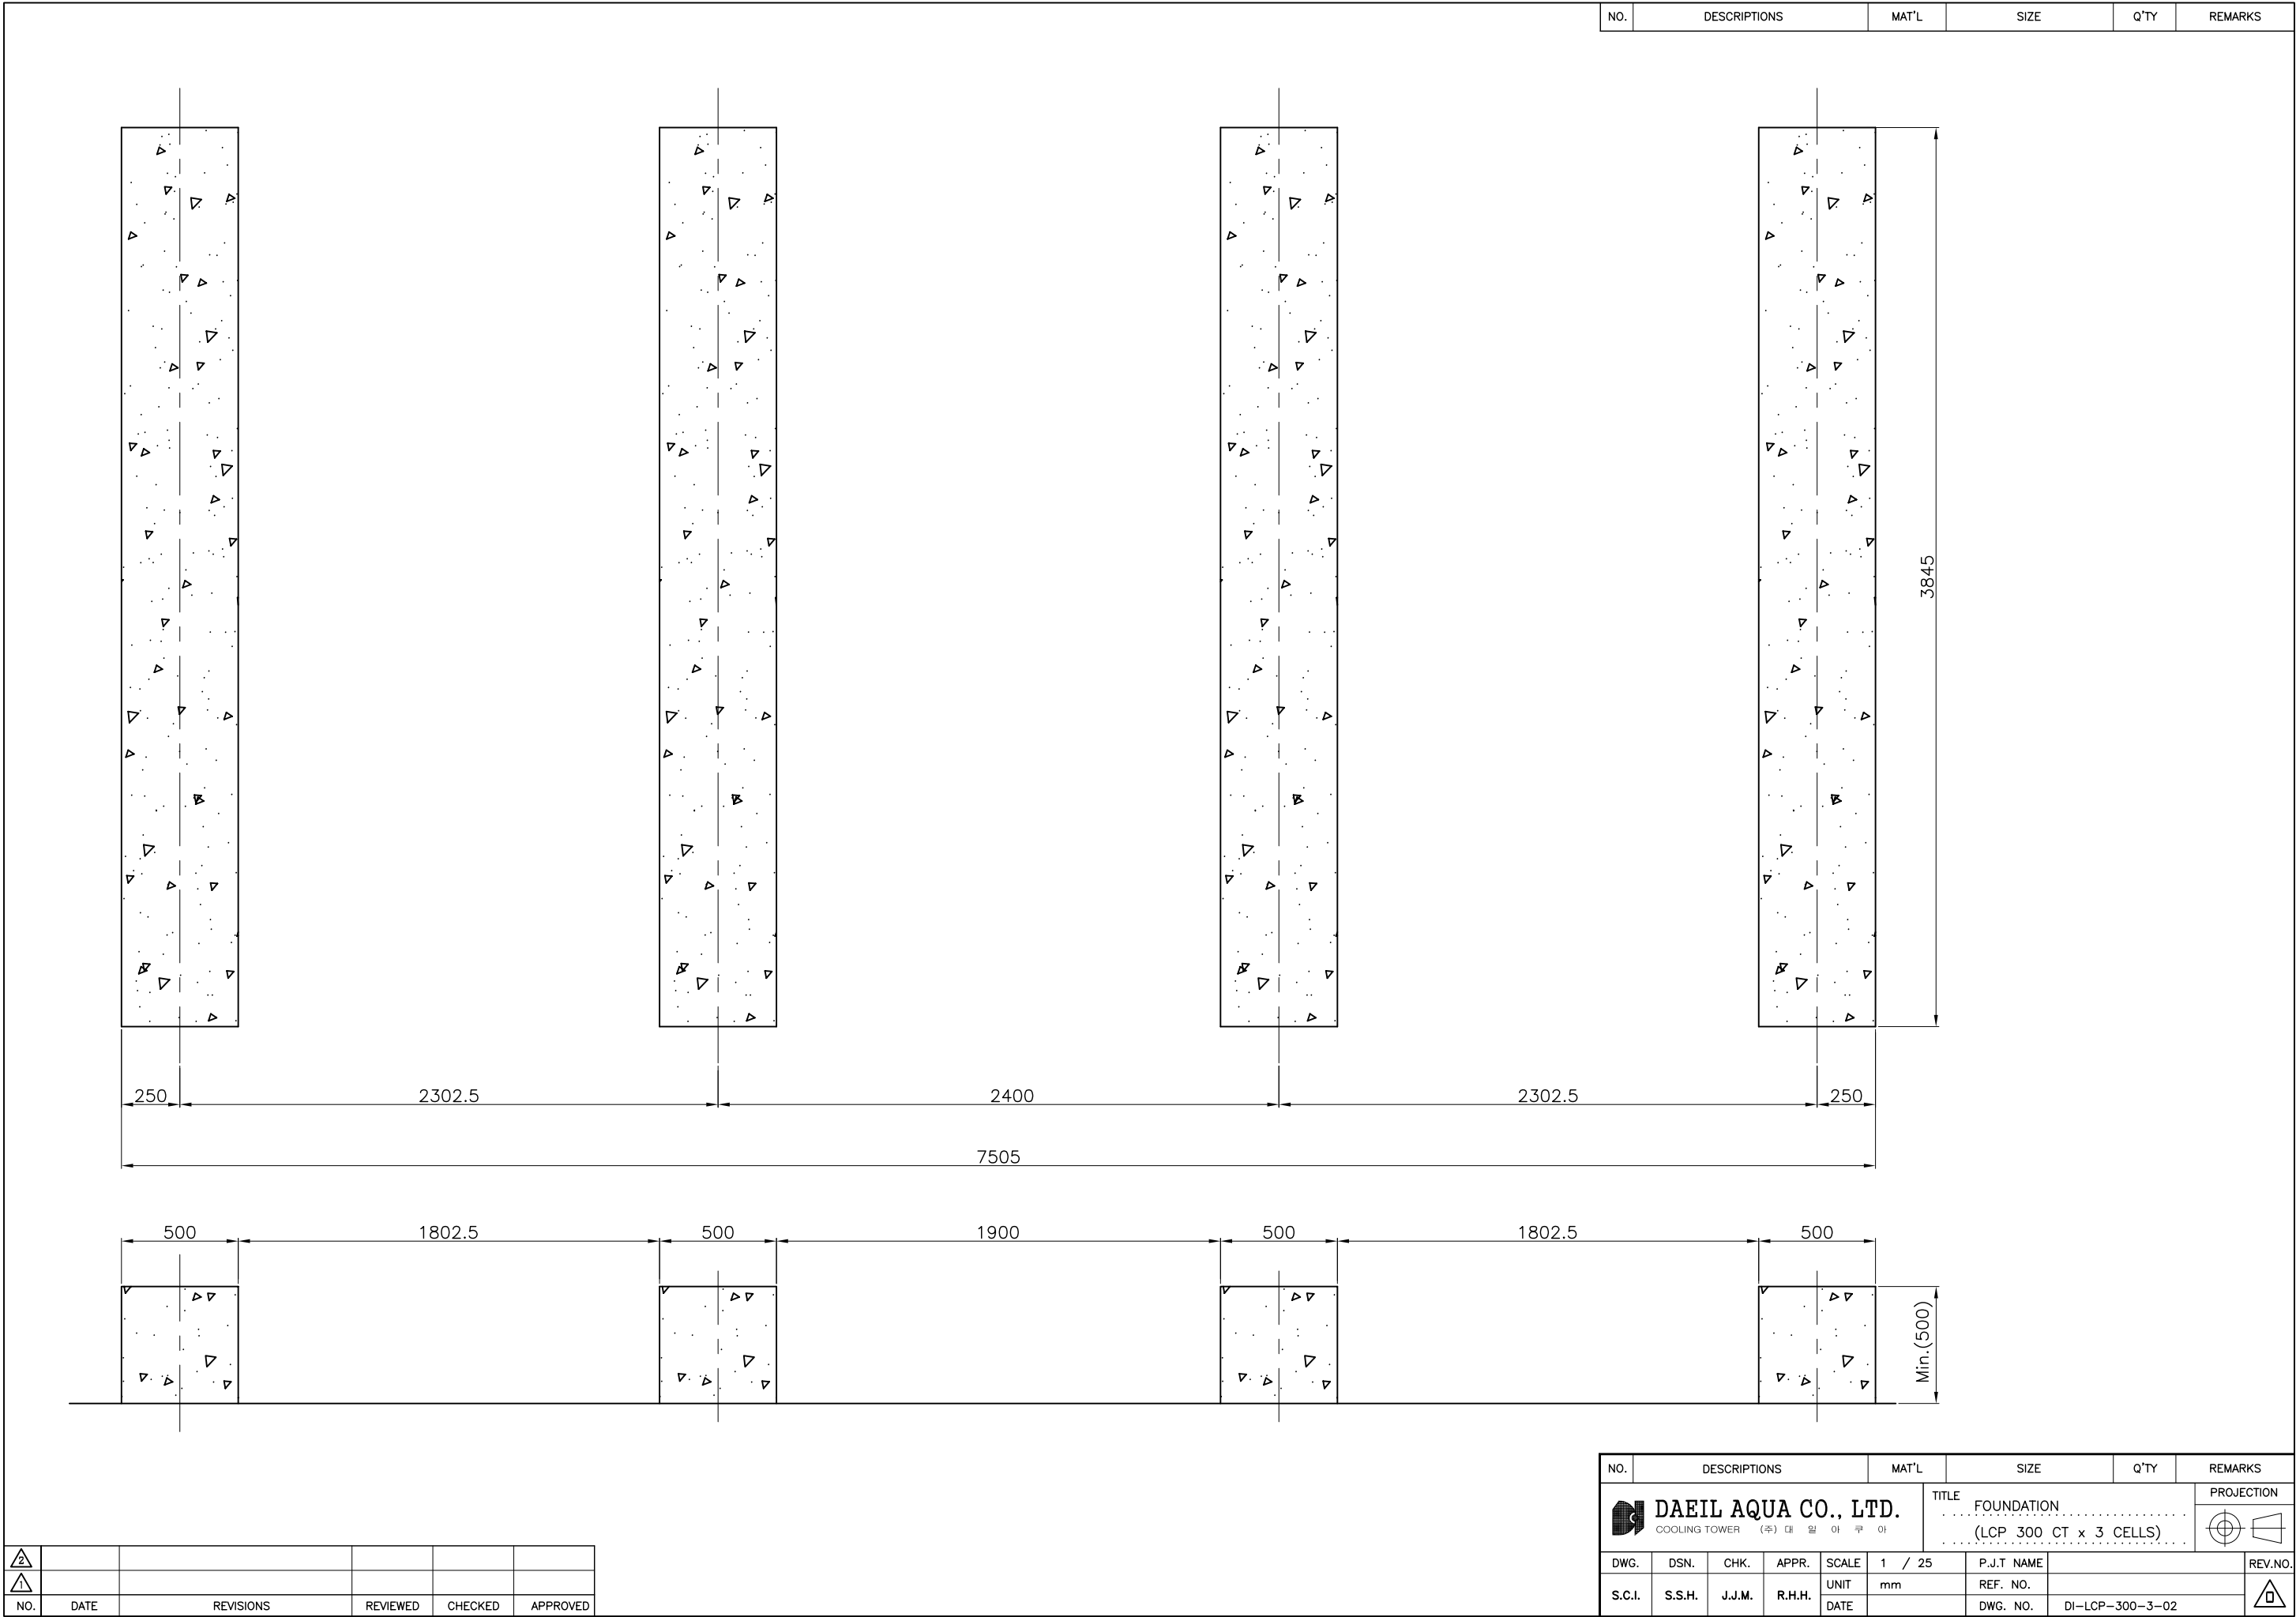

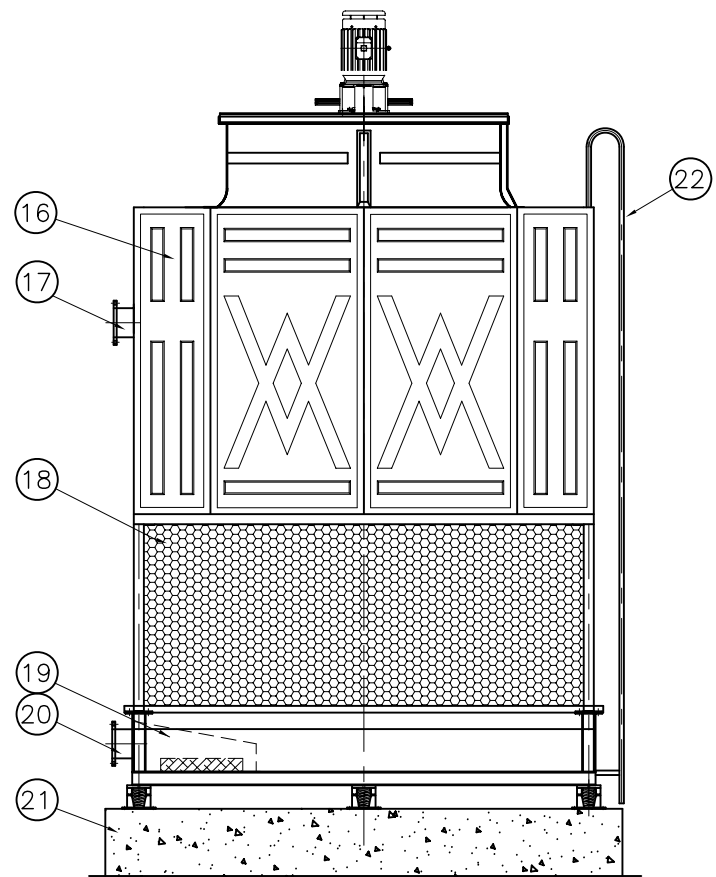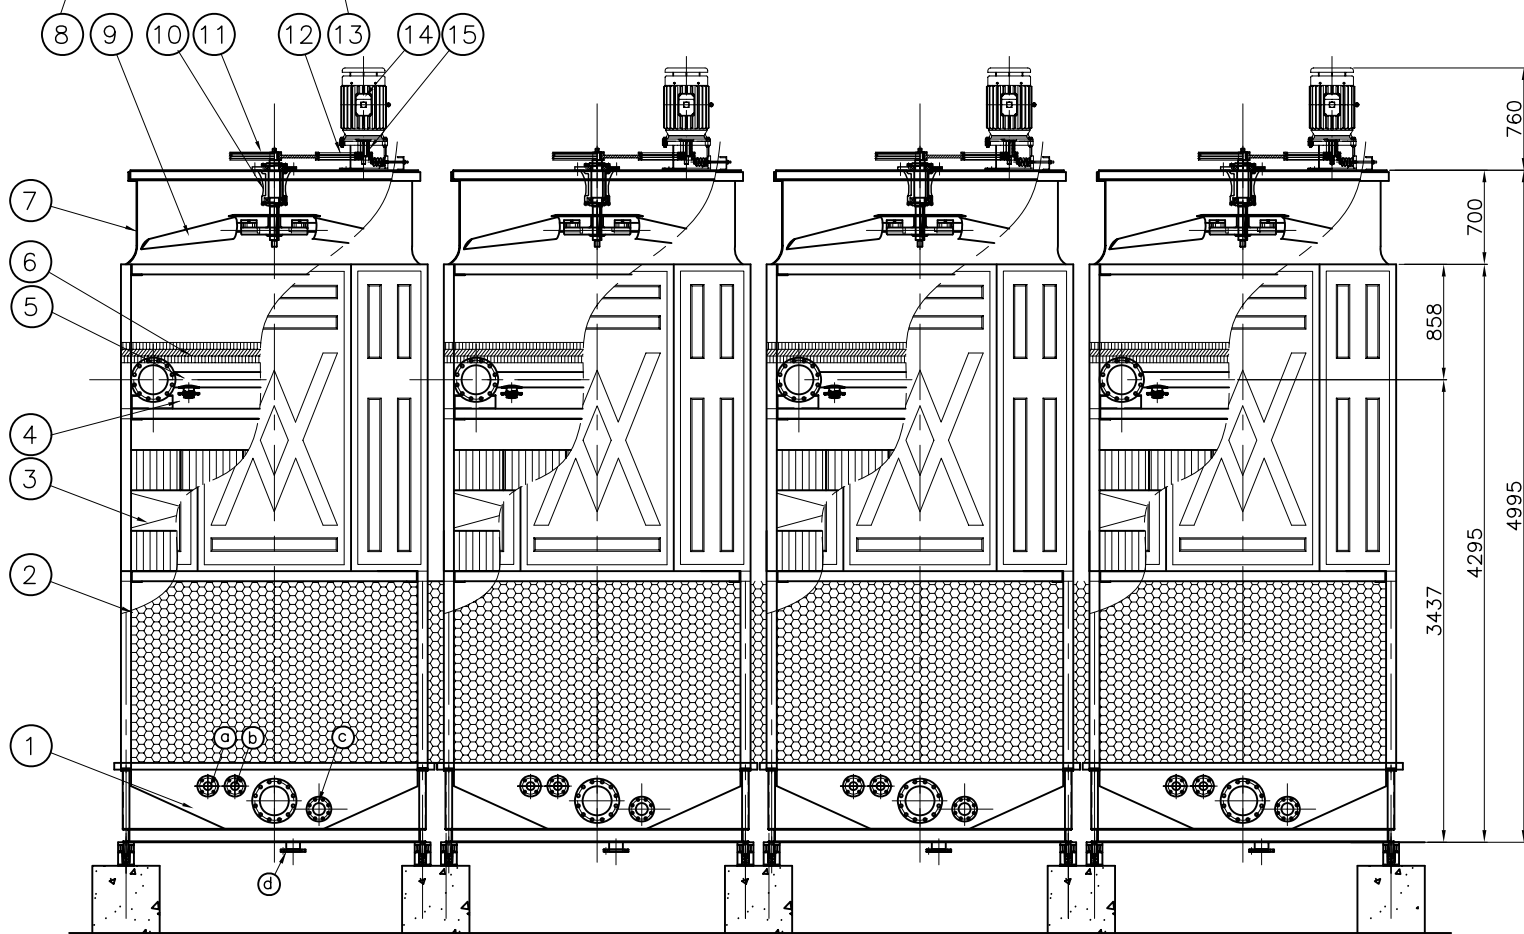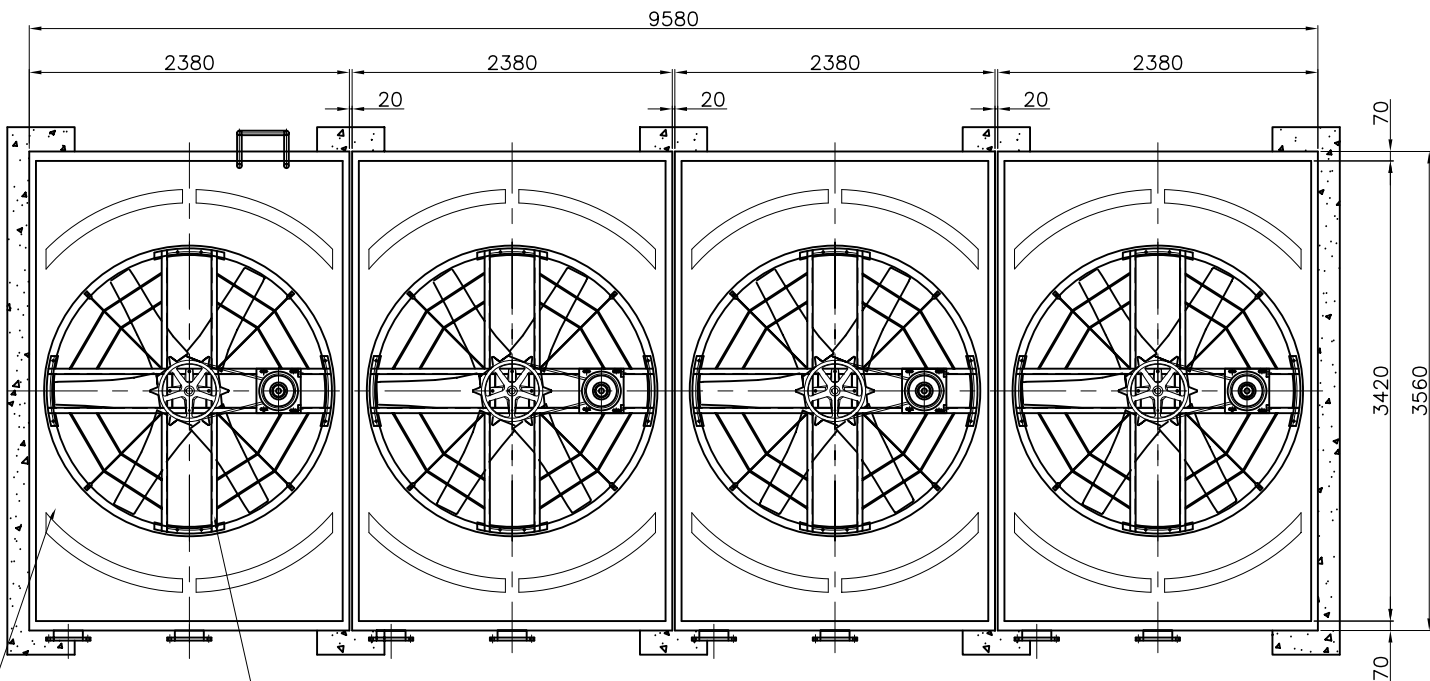


NO.	DESCRIPTIONS	MAT'L	IDENTIFICATION	Q'TY	REMARKS
1	COLD WATER BASIN	FRP	—	1 EA	
2	FRAMEWORK	SS400	75x75	1 EA	HDG
3	FILL	PVC	—	1 LOT	
4	WATER SPRAY NOZZLE	ABS	DK-D	12 EA	
5	LATRAL PIPE	PVC	100A	1 LOT	
6	DRIFT ELIMINATOR	PVC	—	1 LOT	
7	FAN CYLINDER	FRP	ø2020 $\pm_{-0}^{+10}$	1 EA	
8	FAN DECK	FRP	—	1 EA	
9	FAN ASSEMBLY	AL-ALLOY	ø2000	1 SET	
10	SPEED REDUCER	FC200	15HP	1 SET	
11	FAN DRIVE SHAFT PULLEY	FC200	5V1803	1 EA	
12	V-BELT	RUBBER	5V900	2 EA	
13	MECH. EQUIPMENT BASE	SS400	—	1 EA	HDG
14	ELECTRIC MOTOR	TEFC	15HPx4P	1 EA	
15	MOTOR SHAFT PULLEY	FC200	5V503	1 EA	
16	CASING	FRP	—	1 LOT	
17	INLET PIPE	PVC	200A	1 EA	
18	AIR INLET SCREEN	PVC	—	1 LOT	
19	ANTI VORTEX BOX	FRP	—	1 EA	
20	OUTLET PIPE	SPP	200A	1 EA	HDG
21	FOUNDATION	RF CON'C	—	1 LOT	BY OWNER
22	LADDER	SPP	25A	1 EA	HDG

1. 상기 수량은 1 CELL에 대한 것임.
2. 본 기기와 연결되는 전선자재, 배관자재 및 공사는 공급범위에서 제외됨.
3. 기초 공사 제외.

△					
▽					
NO.	DATE	REVISIONS	REVIEWED	CHECKED	APPROVED




DESIGN CONDITIONS		NOZZLE SPECIFICATIONS						
WATER FLOW RATE		936	M ³ /HR	SYMBOL	DESCRIPTIONS	MAT'L	SIZE	Q'TY
NO. OF CELLS		4	CELL	a	MANUAL MAKE-UP	SPP	50 A	4 EA
TEMP.	INLET	37	°C	b	AUTO. MAKE-UP	SPP	50 A	4 EA
	OUTLET	32	°C	c	OVERFLOW	SPP	80 A	4 EA
	WET BULB	27	°C	d	DRAIN	SPP	80 A	4 EA
					REMARK			

NO.	DESCRIPTIONS	MAT'L	SIZE	Q'TY	REMARKS
		TITLE ASSEMBLY & FOUNDATION		PROJECTION	
(300 CT x 4 CELLS)					
DWG.	DSN.	CHK.	APPR.	SCALE	1 / 55
S.C.I.	S.S.H.	J.J.M.	R.H.H.	UNIT	mm
		P.J.T NAME			
		REF. NO.			
		DWG. NO.		DI-LCP-300-4-01	

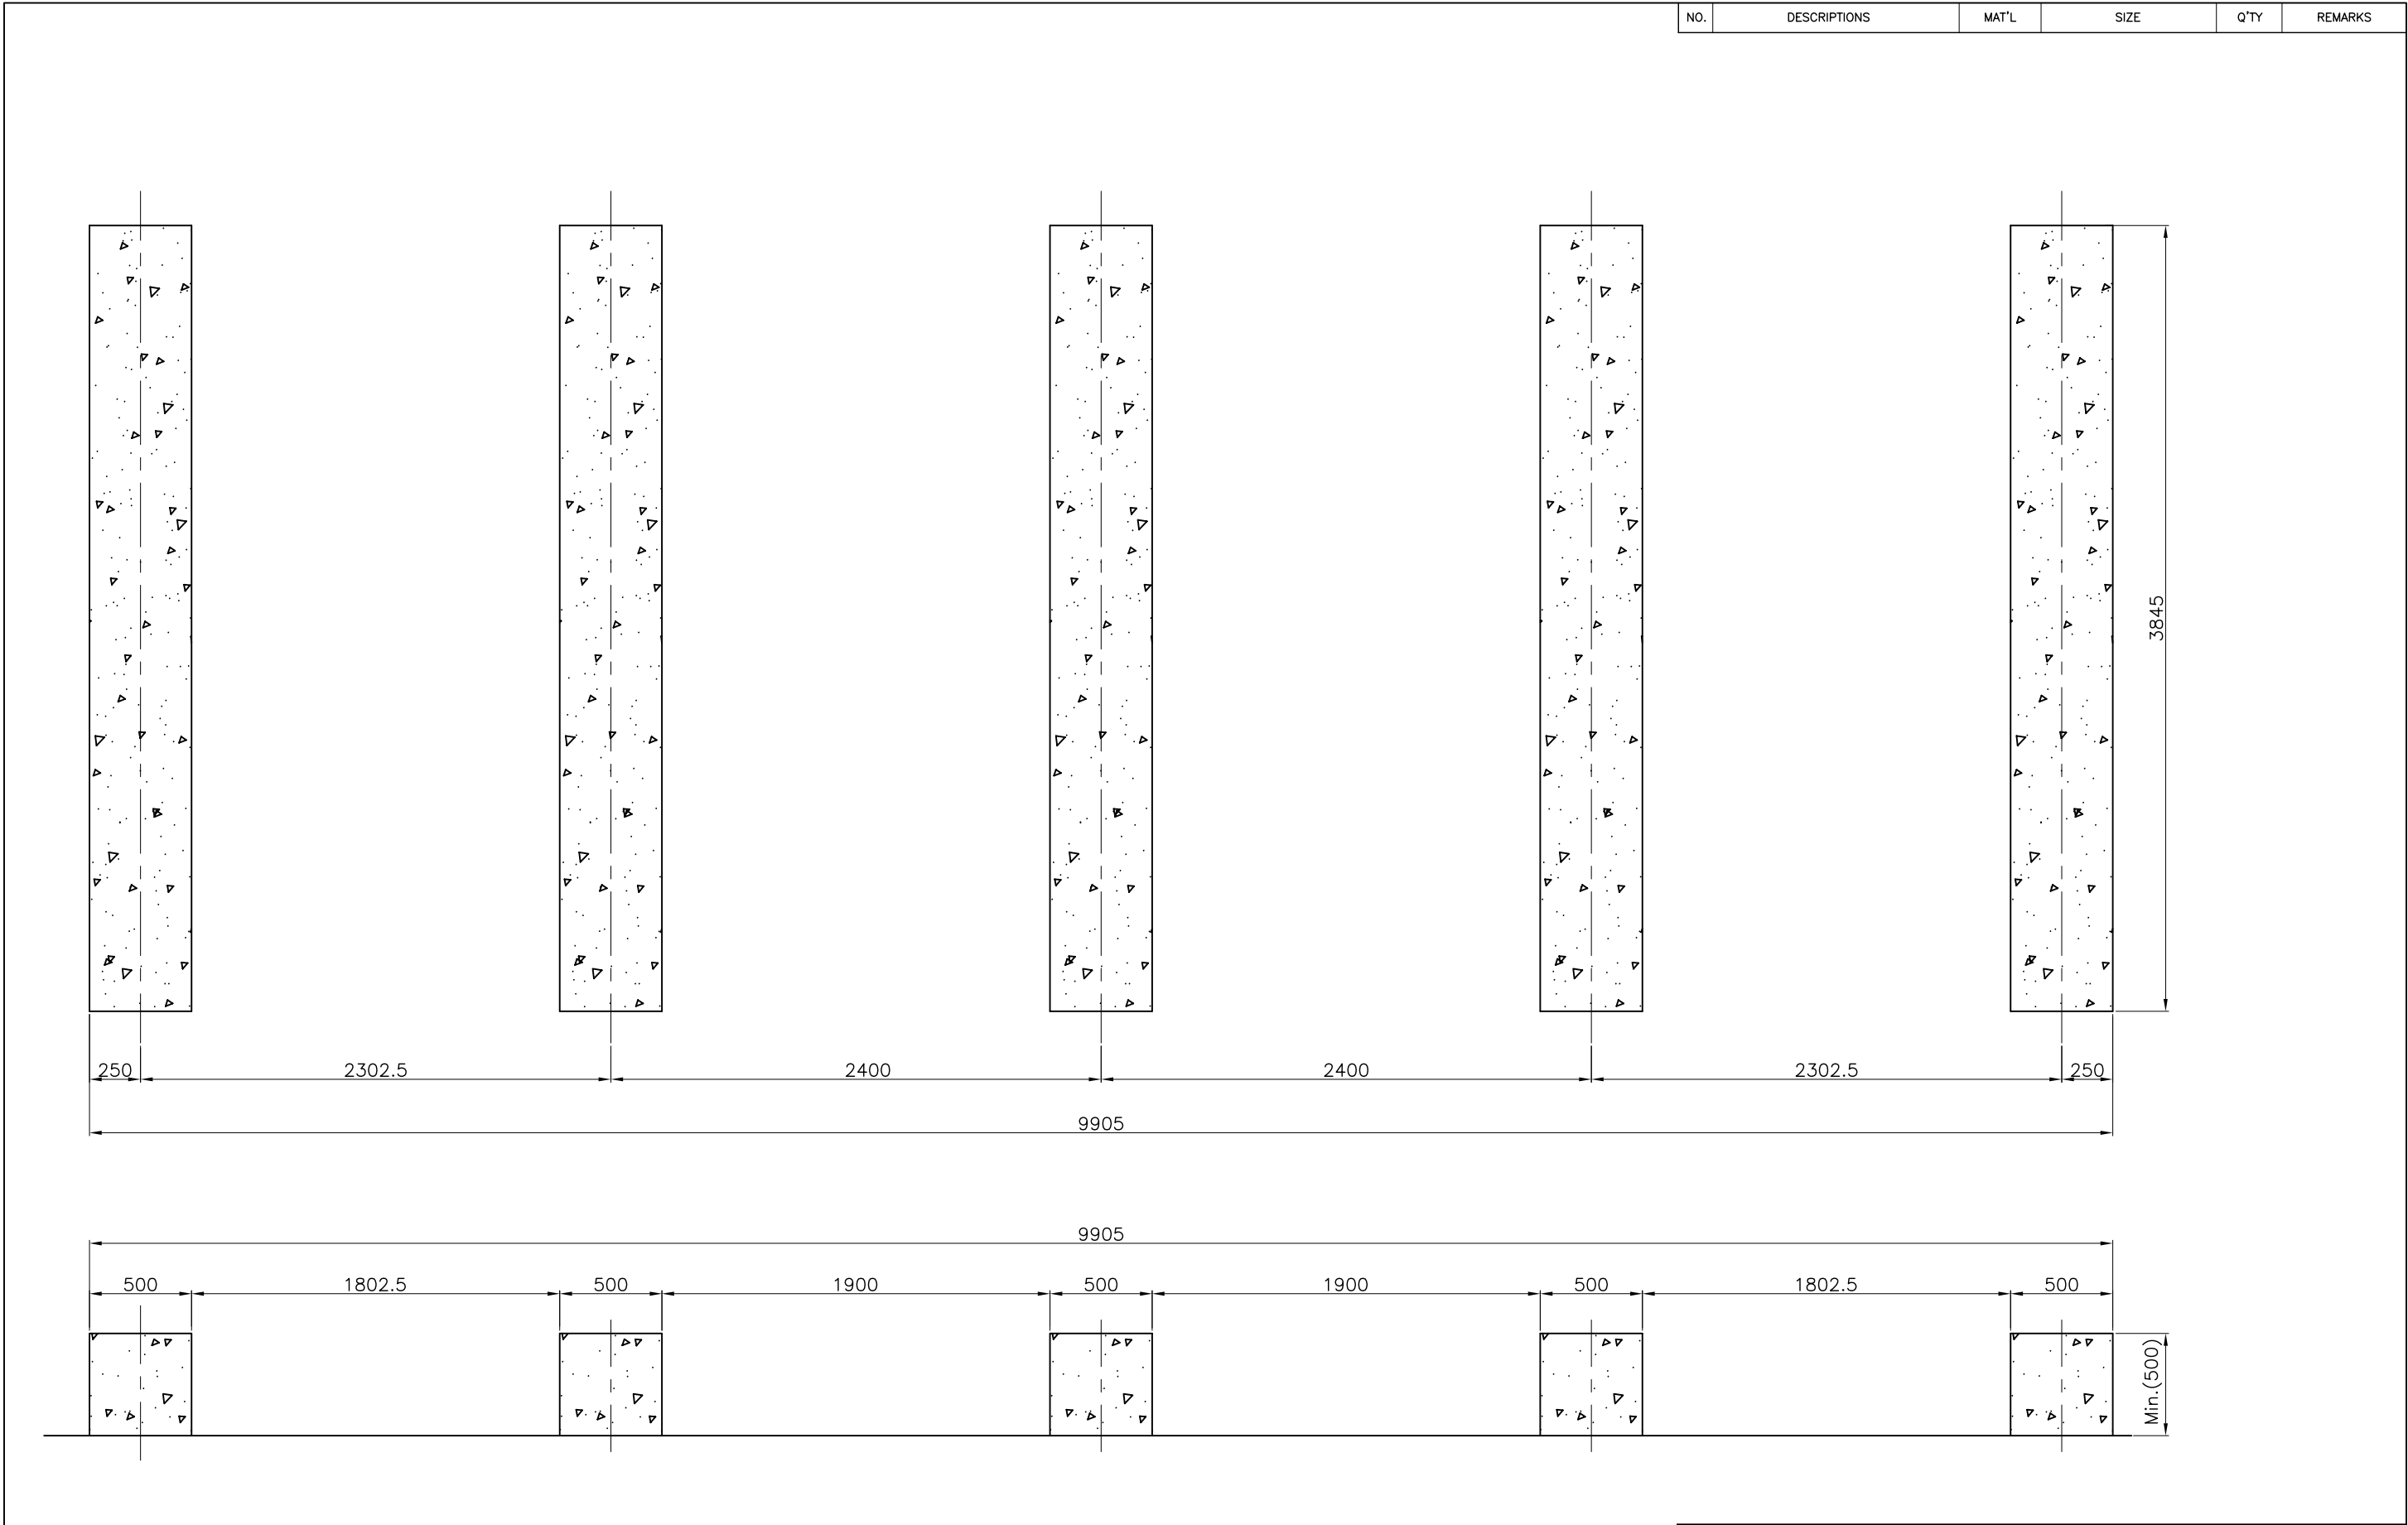

NO.	DATE	REVISIONS	REVIEWED	CHECKED	APPROVED

NO.	DESCRIPTIONS				MAT'L	SIZE		Q'TY	REMARKS	
 DAEIL AQUA CO., LTD. COOLING TOWER (주) 대 일 아 쿠 아					TITLE FOUNDATION (LCP 300 CT x 4 CELLS)		PROJECTION			
										
DWG.	DSN.	CHK.	APPR.	SCALE	1 / 30	P.J.T NAME				
S.C.I.	S.S.H.	J.J.M.	R.H.H.	UNIT	mm	REF. NO.				
				DATE		DWG. NO.	DI-LCP-300-4-02			
										

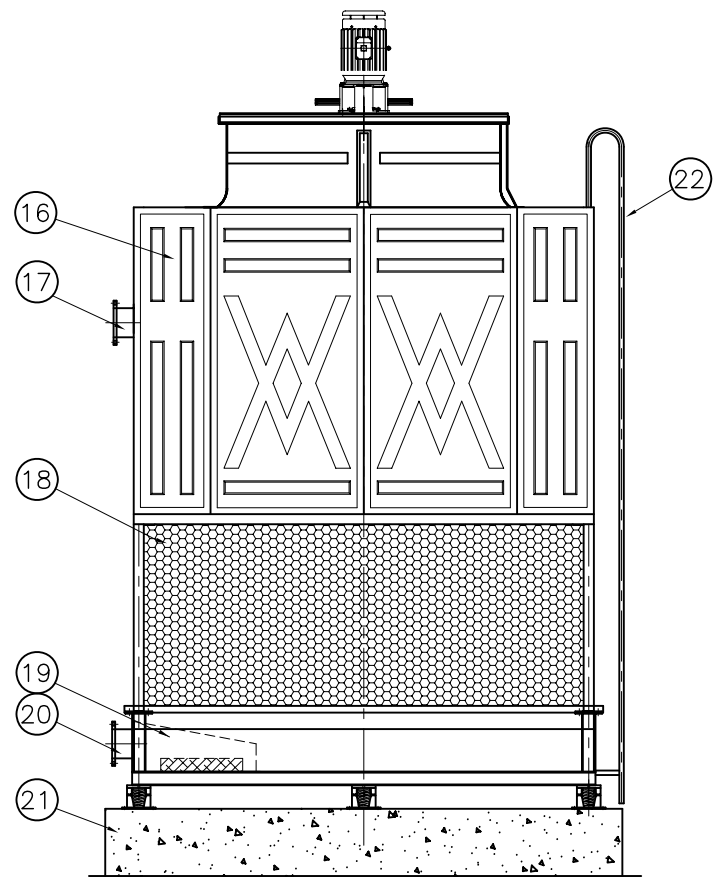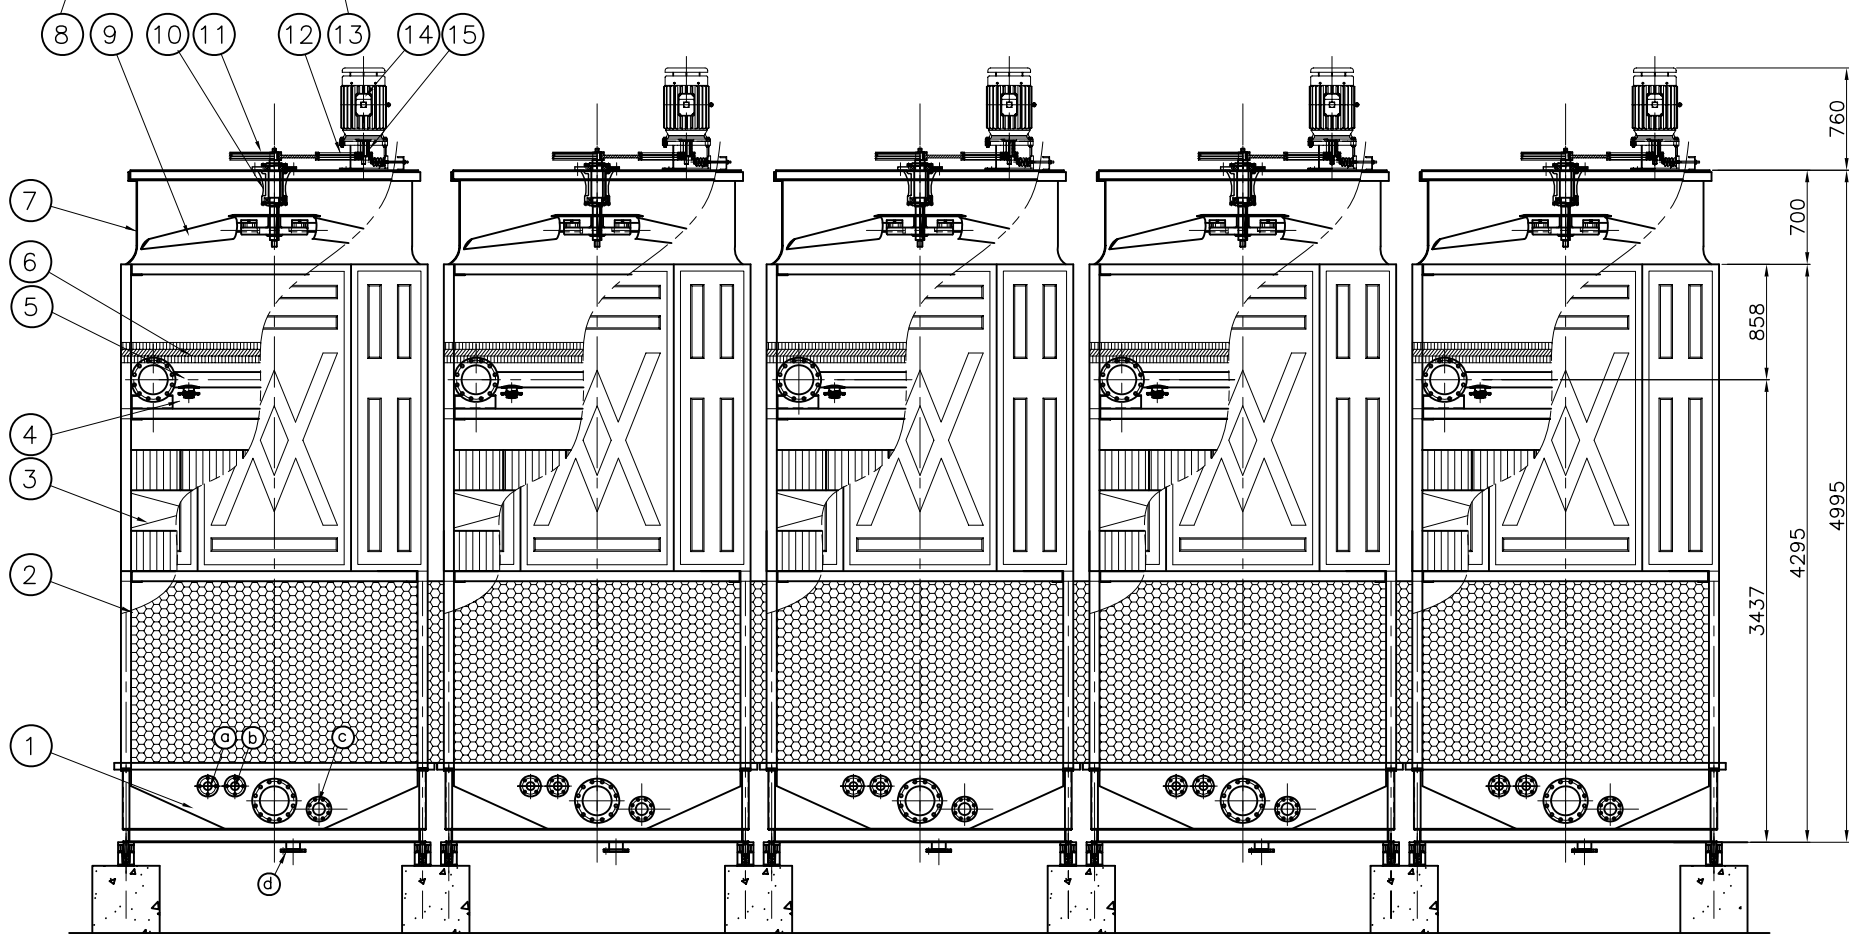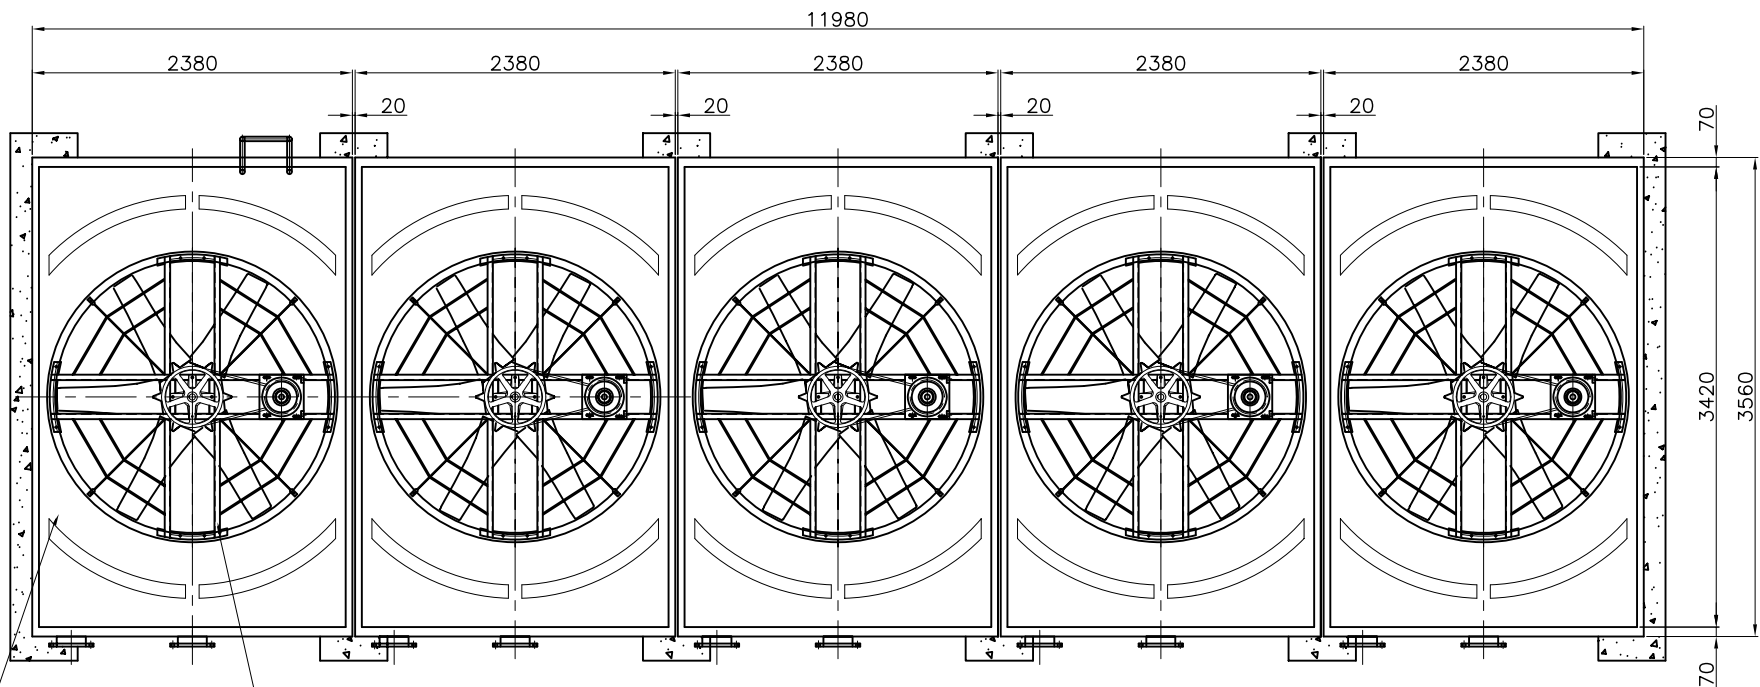

NO.	DESCRIPTIONS	MAT'L	IDENTIFICATION	Q'TY	REMARKS
1	COLD WATER BASIN	FRP	—	1 EA	
2	FRAMEWORK	SS400	75x75	1 EA	HDG
3	FILL	PVC	—	1 LOT	
4	WATER SPRAY NOZZLE	ABS	DK-D	12 EA	
5	LATRAL PIPE	PVC	100A	1 LOT	
6	DRIFT ELIMINATOR	PVC	—	1 LOT	
7	FAN CYLINDER	FRP	ø2020 +10 -0	1 EA	
8	FAN DECK	FRP	—	1 EA	
9	FAN ASSEMBLY	AL-ALLOY	ø2000	1 SET	
10	SPEED REDUCER	FC200	15HP	1 SET	
11	FAN DRIVE SHAFT PULLEY	FC200	5V1803	1 EA	
12	V-BELT	RUBBER	5V900	2 EA	
13	MECH. EQUIPMENT BASE	SS400	—	1 EA	HDG
14	ELECTRIC MOTOR	TEFC	15HPx4P	1 EA	
15	MOTOR SHAFT PULLEY	FC200	5V503	1 EA	
16	CASING	FRP	—	1 LOT	
17	INLET PIPE	PVC	200A	1 EA	
18	AIR INLET SCREEN	PVC	—	1 LOT	
19	ANTI VORTEX BOX	FRP	—	1 EA	
20	OUTLET PIPE	SPP	200A	1 EA	HDG
21	FOUNDATION	RF CON'C	—	1 LOT	BY OWNER
22	LADDER	SPP	25A	1 EA	HDG

1. 상기 수량은 1 CELL에 대한 것임.
2. 본 기기와 연결되는 전선자재, 배관자재 및 공사는 공급범위에서 제외됨.
3. 기초 공사 제외.

NO.	DATE	REVISIONS	REVIEWED	CHECKED	APPROVED
△					
▽					

DESIGN CONDITIONS		NOZZLE SPECIFICATIONS						
WATER FLOW RATE	1170 M ³ /HR	SYMBOL	DESCRIPTIONS	MAT'L	SIZE	Q'TY	REMARK	
NO. OF CELLS	5 CELL	a	MANUAL MAKE-UP	SPP	50 A	5 EA	FLANGE	
TEMP.	INLET	37 °C	b	AUTO. MAKE-UP	SPP	50 A	5 EA	FLANGE
	OUTLET	32 °C	c	OVERFLOW	SPP	80 A	5 EA	FLANGE
	WET BULB	27 °C	d	DRAIN	SPP	80 A	5 EA	FLANGE

NO.	DESCRIPTIONS	MAT'L	SIZE	Q'TY	REMARKS
DAEIL AQUA CO.,LTD.		TITLE		PROJECTION	
COOLING TOWER (주) 대 일 아 쿠 아		ASSEMBLY & FOUNDATION		FIRST ANGLE	
(300 CT x 5 CELLS)		P.J.T NAME		REF. NO.	
DWG.	DSN.	CHK.	APPR.	SCALE	1 / 55
S.C.I.	S.S.H.	J.J.M.	R.H.H.	UNIT	mm
		DWG. NO.		DI-LCP-300-5-01	

