
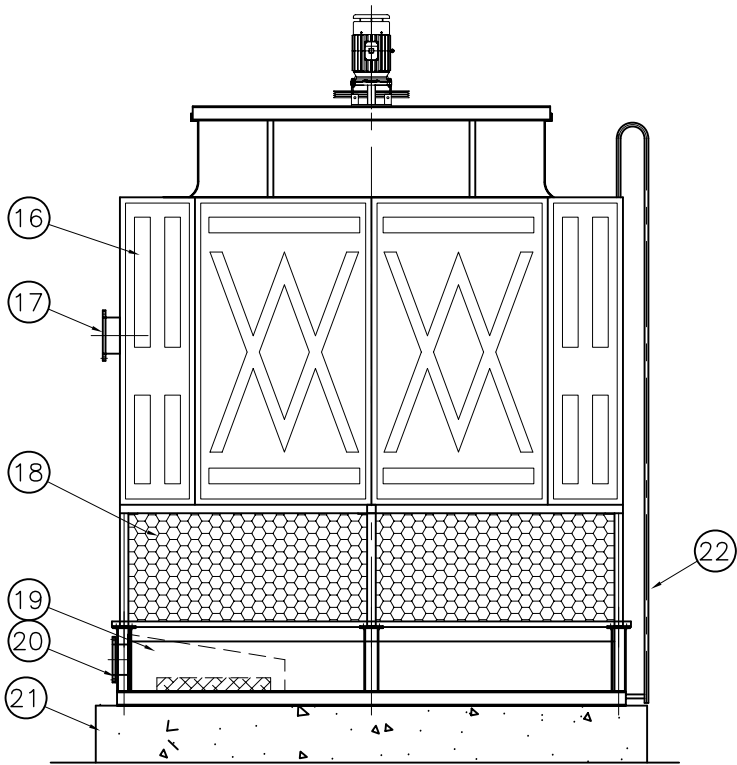
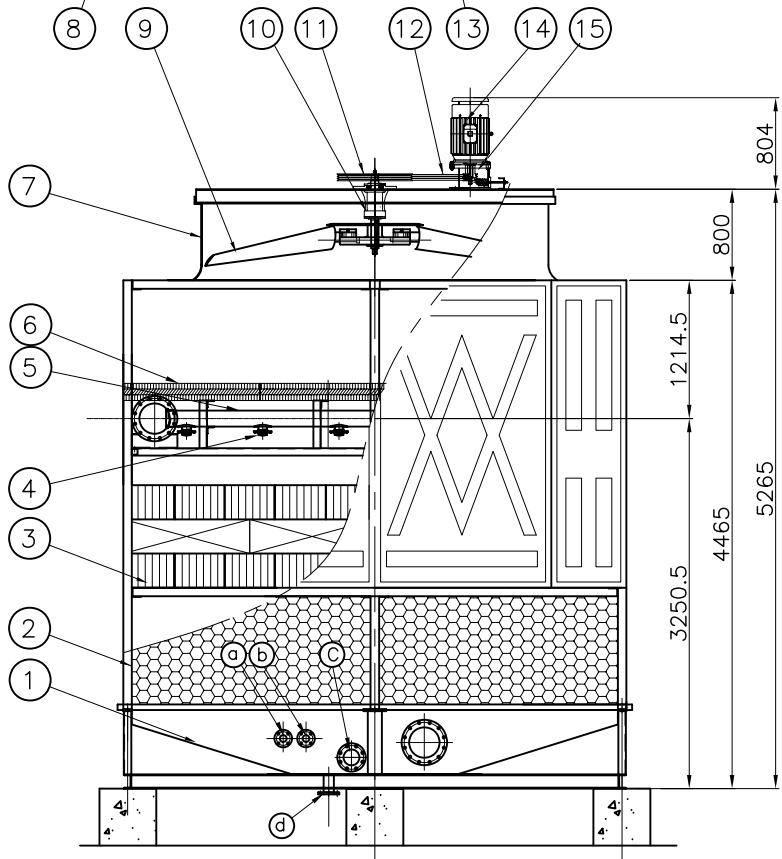
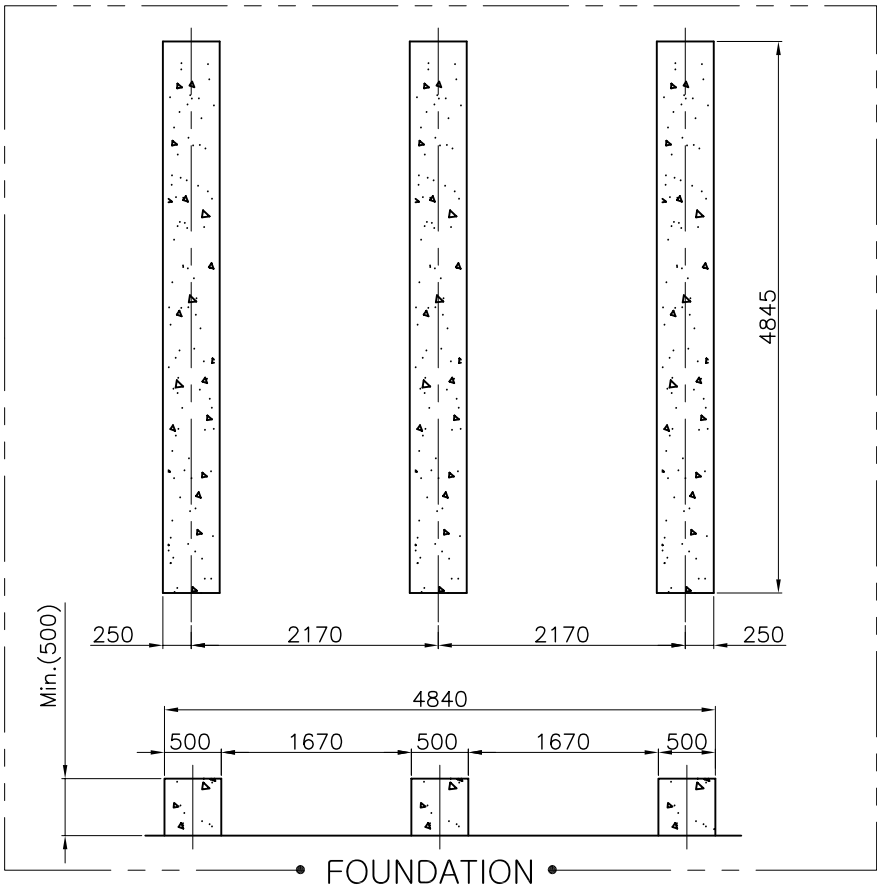


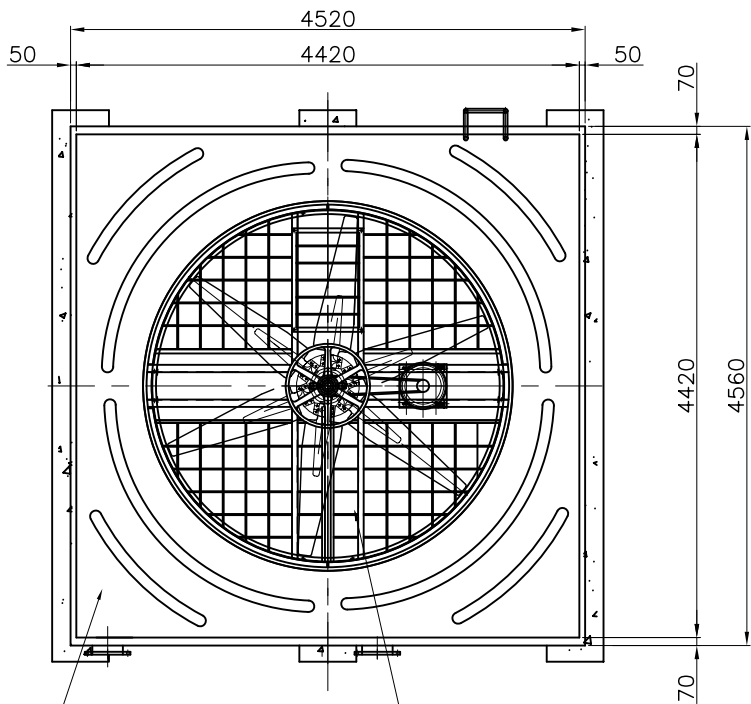


NO.	DESCRIPTIONS	MAT'L	IDENTIFICATION	Q'TY	REMARKS
1	COLD WATER BASIN	FRP	—	1 EA	
2	FRAMEWORK	SS400	75x75	1 EA	HDG
3	FILL	PVC	—	1 LOT	
4	WATER SPRAY NOZZLE	ABS	DK-C	36 EA	
5	LATERAL PIPE	PVC	125A	1 LOT	
6	DRIFT ELIMINATOR	PVC	—	1 LOT	
7	FAN CYLINDER	FRP	ø3030 $\pm_{-0}^{+10}$	1 EA	
8	FAN DECK	FRP	—	1 EA	
9	FAN ASSEMBLY	AL-ALLOY	ø3000	1 SET	
10	SPEED REDUCER	FC200	20HP	1 SET	
11	FAN DRIVE SHAFT PULLEY	FC200	5V2603	1 EA	
12	V-BELT	RUBBER	5V1180	3 EA	
13	MECH. EQUIPMENT BASE	SS400	—	1 EA	HDG
14	ELECTRIC MOTOR	TEFC	20HPx4P	1 EA	
15	MOTOR SHAFT PULLEY	FC200	5V503	1 EA	
16	CASING	FRP	—	1 LOT	
17	INLET PIPE	PVC	250A	1 EA	
18	AIR INLET SCREEN	PVC	—	1 LOT	
19	ANTI VORTEX BOX	FRP	—	1 EA	
20	OUTLET PIPE	SPP	250A	1 EA	HDG
21	FOUNDATION	RF CON'C	—	1 LOT	BY OWNER
22	LADDER	SPP	25A	1 EA	HDG




1. 상기 수량은 1 CELL에 대한 것임.
2. 본 기기와 연결되는 전선자재, 배관자재 및 공사는 공급범위에서 제외됨.
3. 기초 공사 제외.

△					
△					
NO.	DATE	REVISIONS	REVIEWED	CHECKED	APPROVED

DESIGN CONDITIONS		NOZZLE SPECIFICATIONS						
WATER FLOW RATE		468	M ³ /HR	SYMBOL	DESCRIPTIONS	MAT'L	SIZE	Q'TY
NO. OF CELLS		1	CELL	a	MANUAL MAKE-UP	SPP	50 A	1 EA
TEMP.	INLET	37	°C	b	AUTO. MAKE-UP	SPP	50 A	1 EA
	OUTLET	32	°C	c	OVERFLOW	SPP	100 A	1 EA
	WET BULB	27	°C	d	DRAIN	SPP	80 A	1 EA
								REMARK
								FLANGE
								FLANGE
								FLANGE

NO.	DESCRIPTIONS	MAT'L	SIZE	Q'TY	REMARKS
DAEIL AQUA CO.,LTD.		TITLE ASSEMBLY & FOUNDATION			PROJECTION
COOLING TOWER (주) 대 일 아 쿠 아		(600 CT)			
DWG.	DSN.	CHK.	APPR.	SCALE	1 / 65
S.C.I.	S.S.H.	J.J.M.	R.H.H.	UNIT	mm
		DATE		REF. NO.	
				DWG. NO.	
				DI-LCP-600-01	

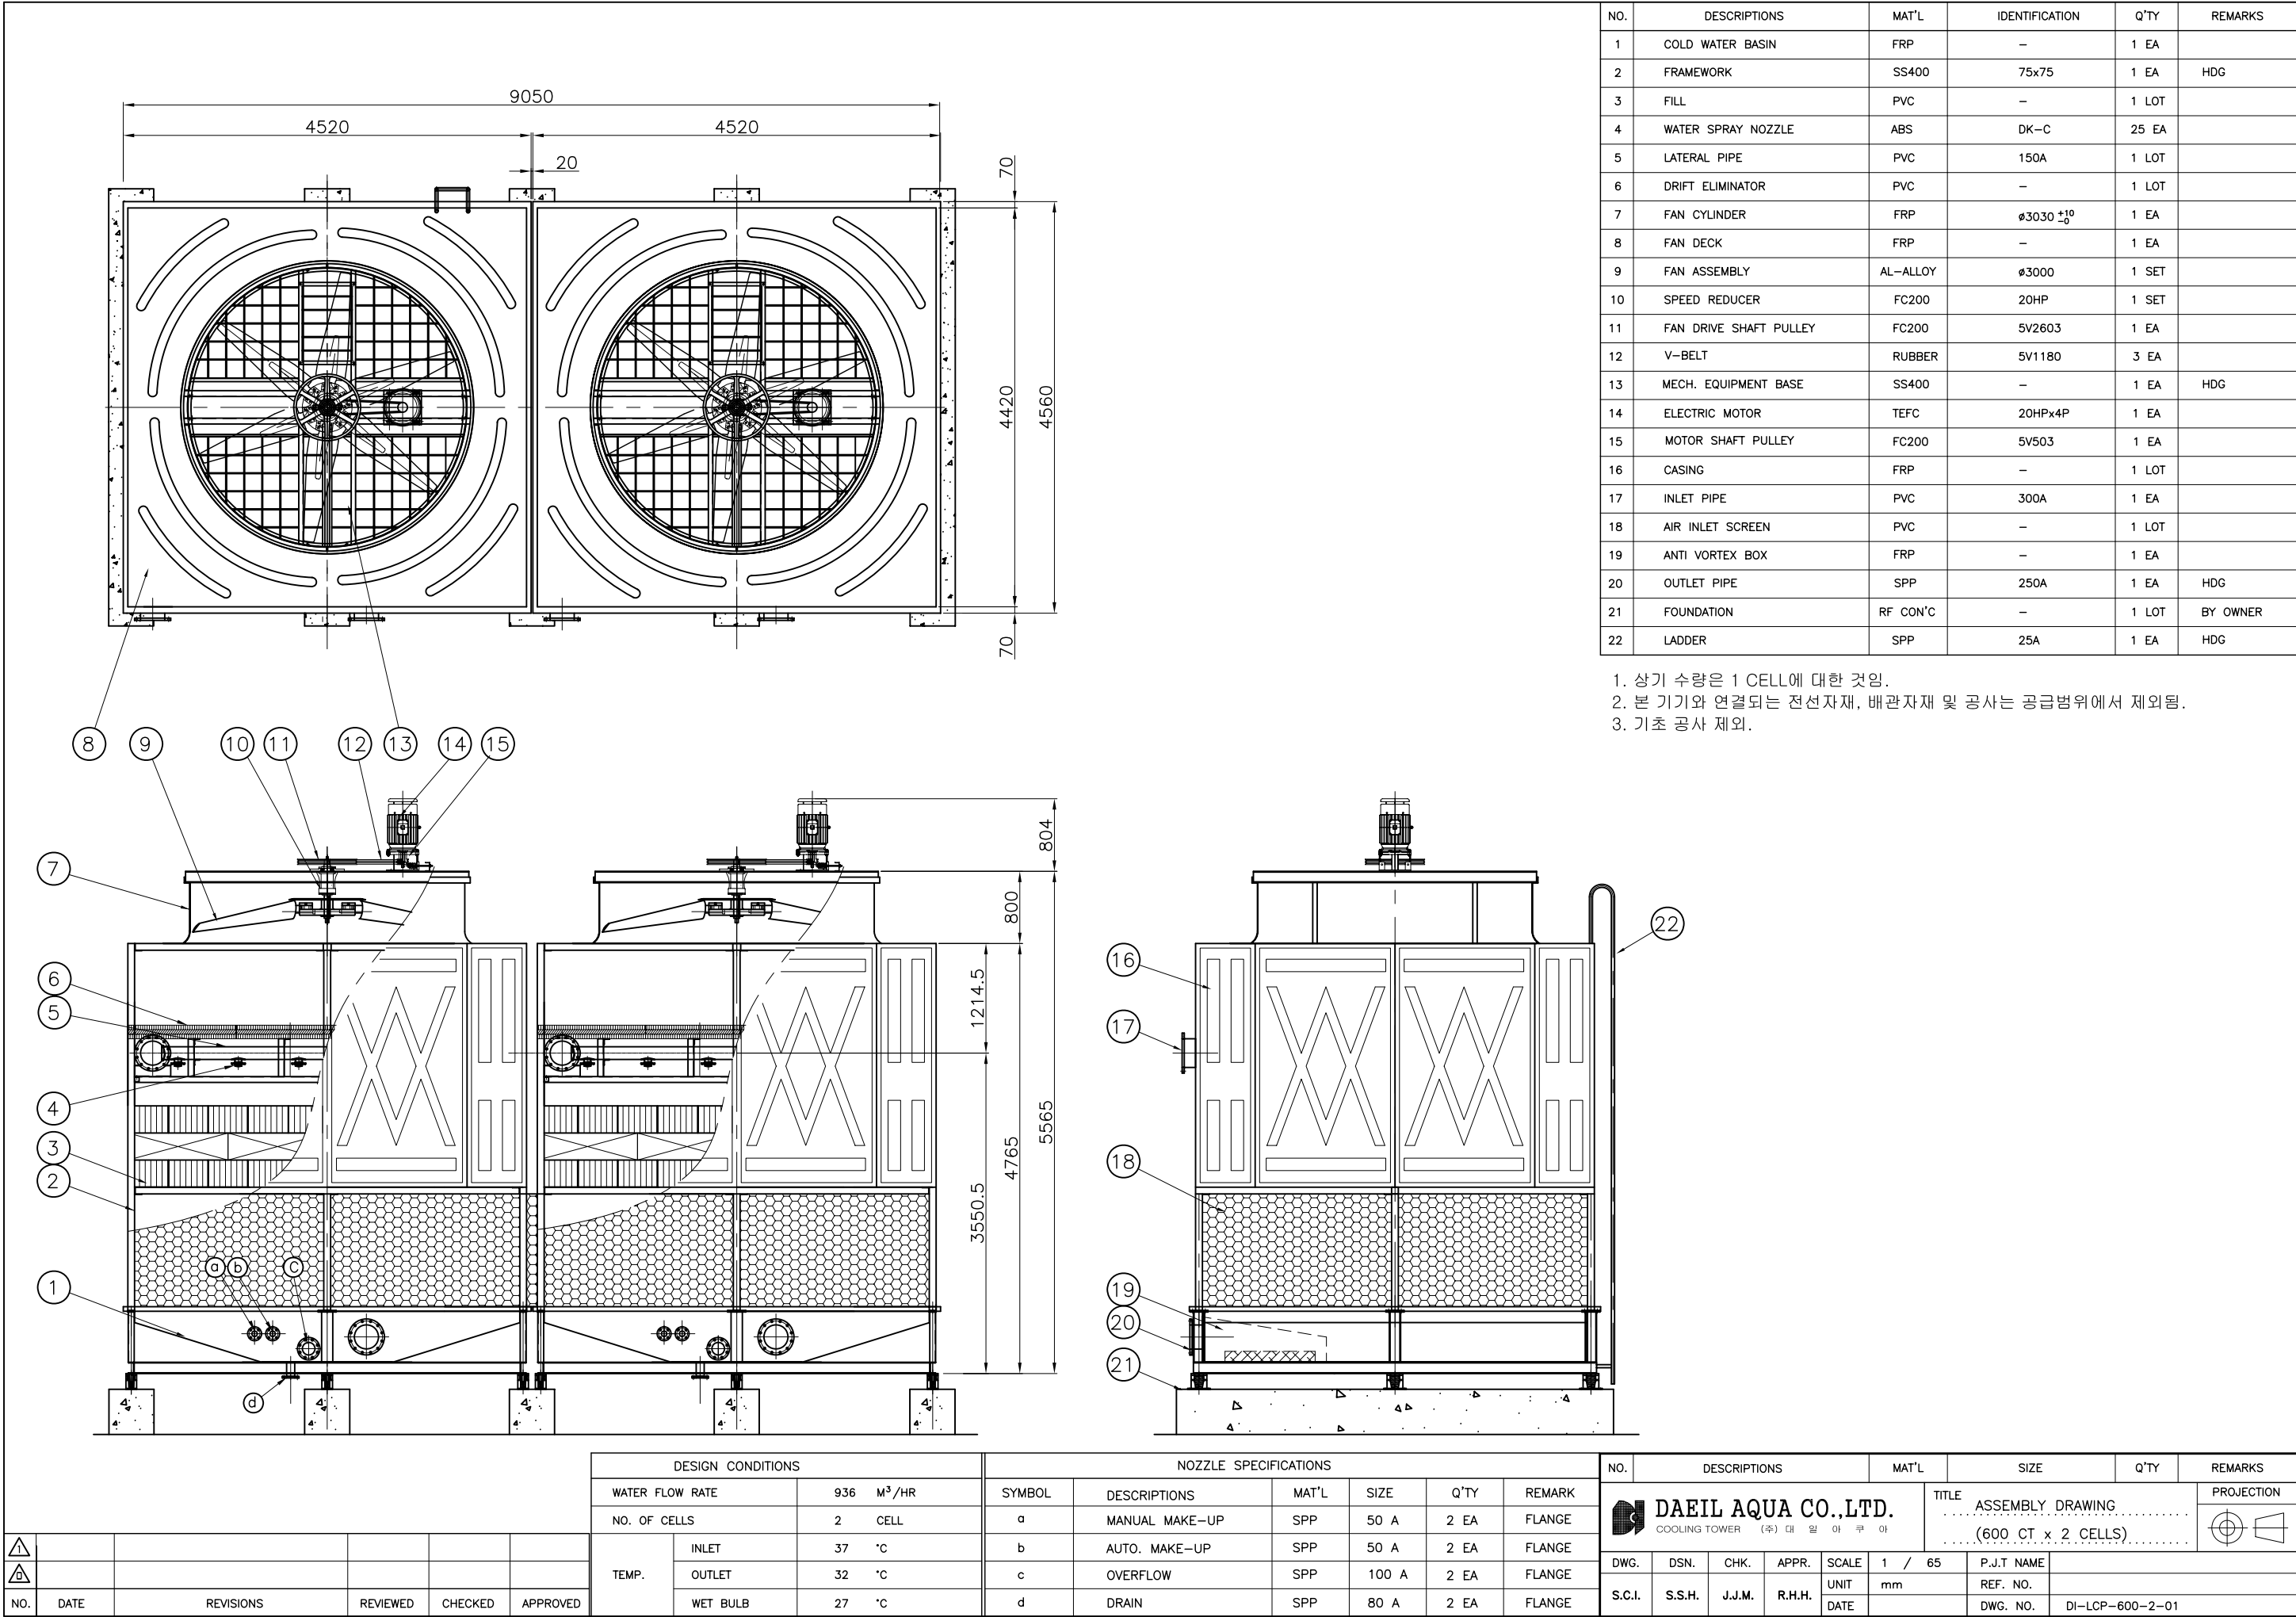

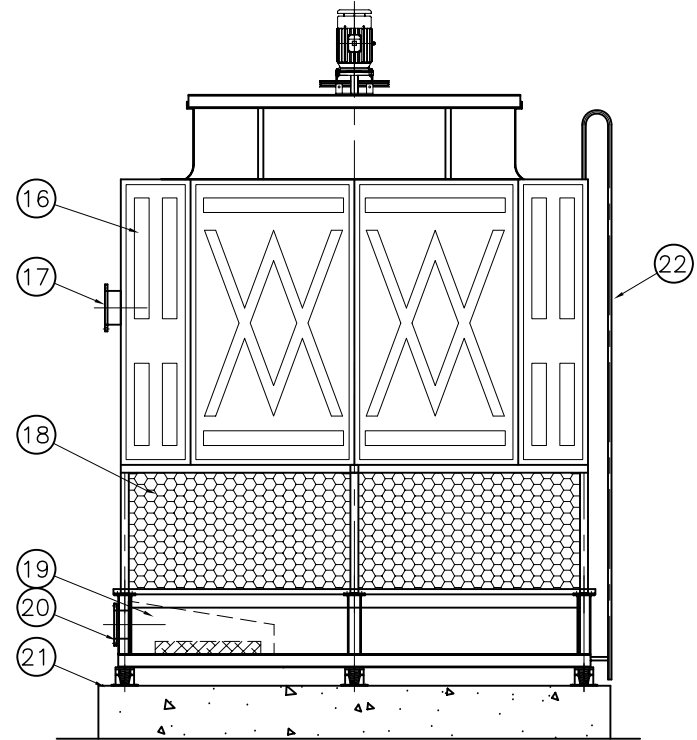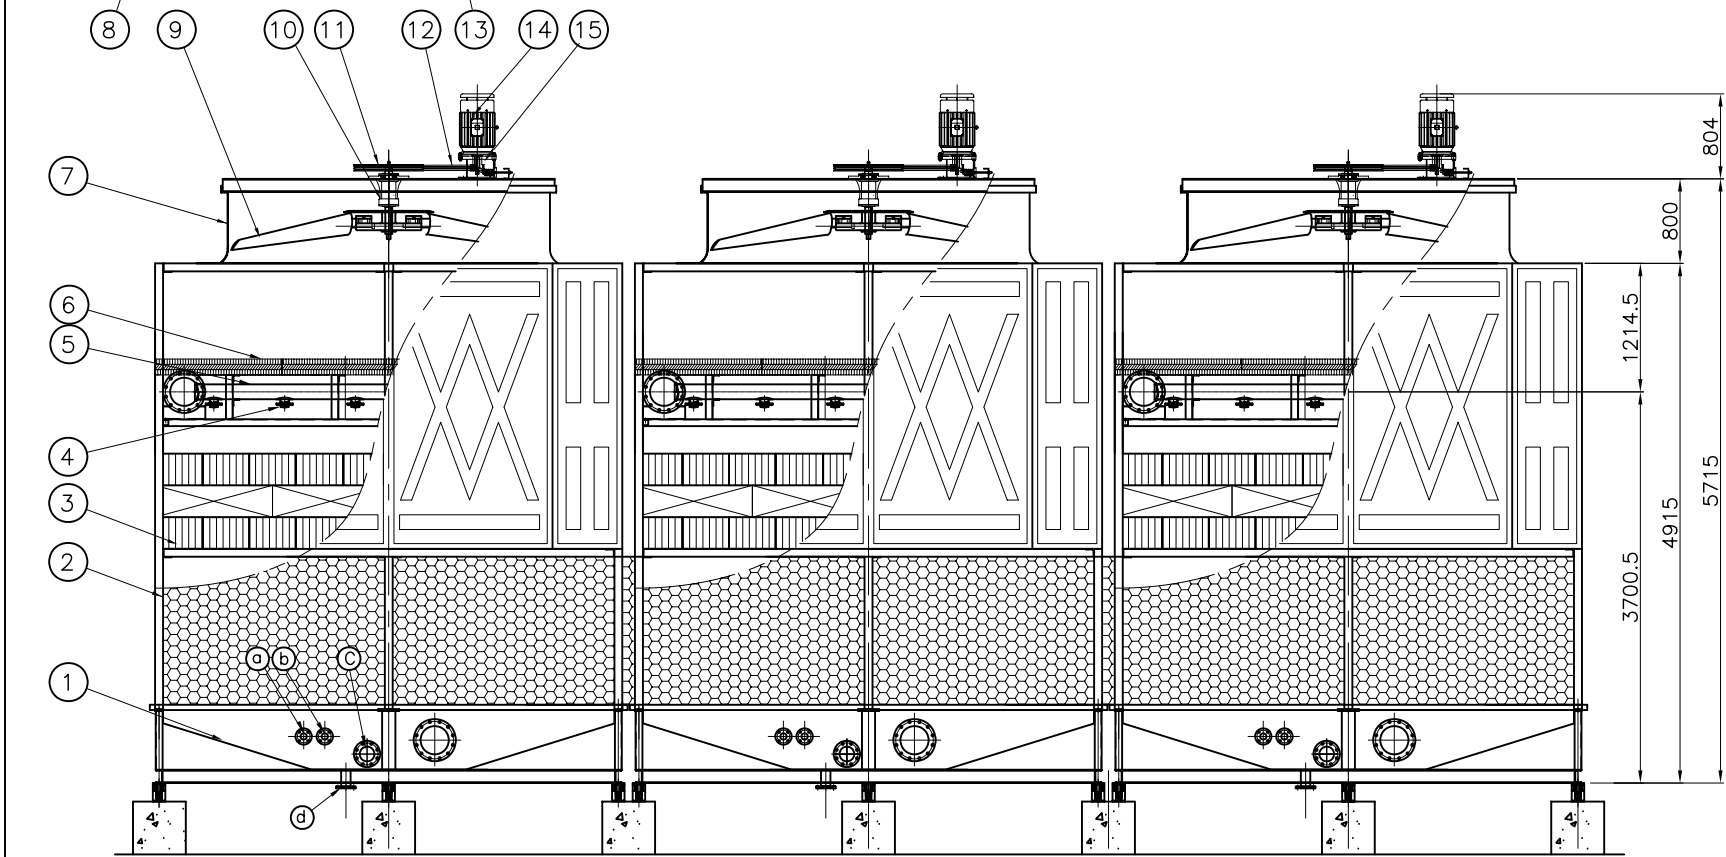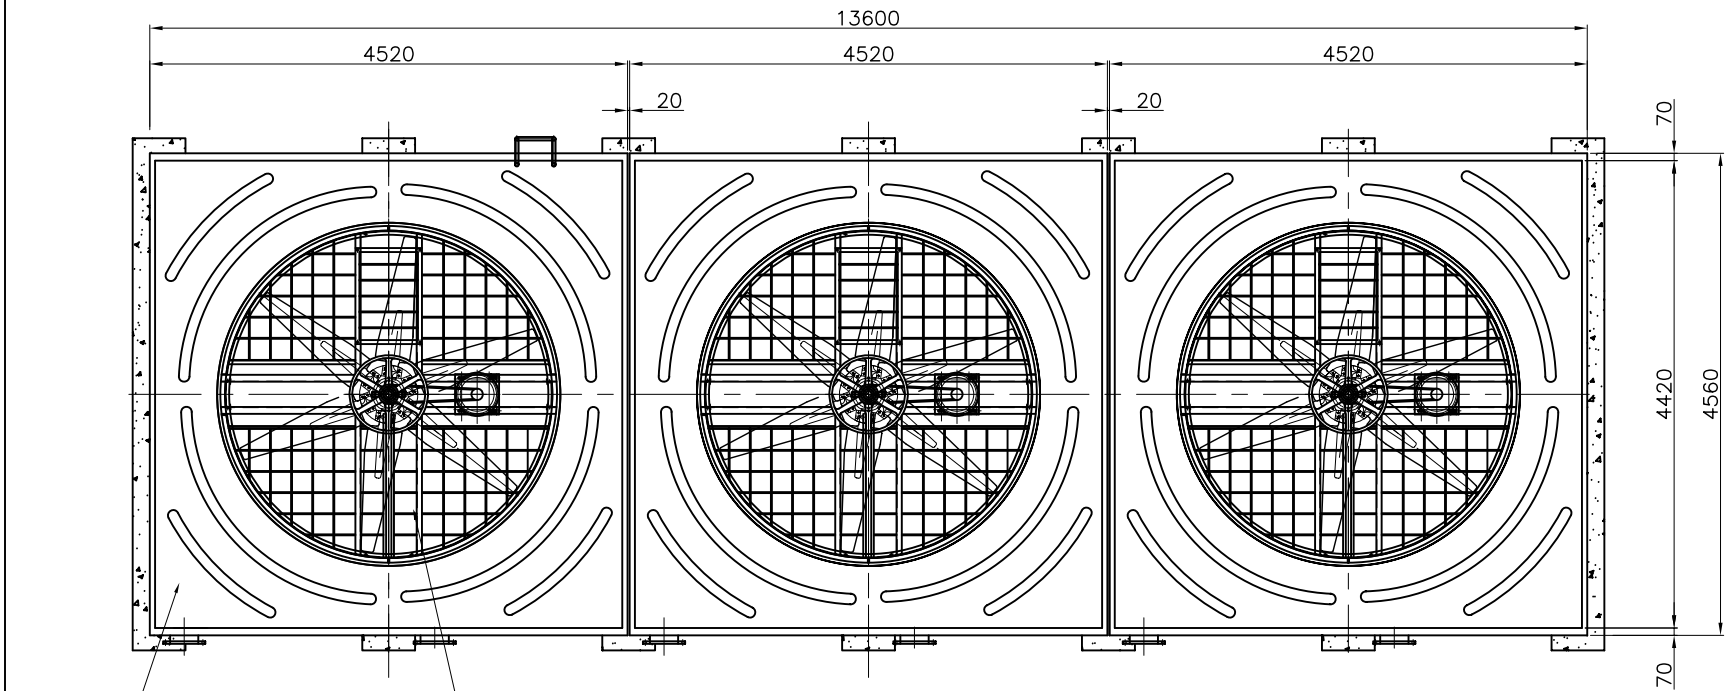

NO.	DESCRIPTIONS	MAT'L	IDENTIFICATION	Q'TY	REMARKS
1	COLD WATER BASIN	FRP	—	1 EA	
2	FRAMEWORK	SS400	75x75	1 EA	HDG
3	FILL	PVC	—	1 LOT	
4	WATER SPRAY NOZZLE	ABS	DK-C	25 EA	
5	LATERAL PIPE	PVC	150A	1 LOT	
6	DRIFT ELIMINATOR	PVC	—	1 LOT	
7	FAN CYLINDER	FRP	ø3030 ± ₀ ⁺¹⁰	1 EA	
8	FAN DECK	FRP	—	1 EA	
9	FAN ASSEMBLY	AL-ALLOY	ø3000	1 SET	
10	SPEED REDUCER	FC200	20HP	1 SET	
11	FAN DRIVE SHAFT PULLEY	FC200	5V2603	1 EA	
12	V-BELT	RUBBER	5V1180	3 EA	
13	MECH. EQUIPMENT BASE	SS400	—	1 EA	HDG
14	ELECTRIC MOTOR	TEFC	20HPx4P	1 EA	
15	MOTOR SHAFT PULLEY	FC200	5V503	1 EA	
16	CASING	FRP	—	1 LOT	
17	INLET PIPE	PVC	250A	1 EA	
18	AIR INLET SCREEN	PVC	—	1 LOT	
19	ANTI VORTEX BOX	FRP	—	1 EA	
20	OUTLET PIPE	SPP	250A	1 EA	HDG
21	FOUNDATION	RF CON'C	—	1 LOT	BY OWNER
22	LADDER	SPP	25A	1 EA	HDG


1. 상기 수량은 1 CELL에 대한 것임.
2. 본 기기와 연결되는 전선자재, 배관자재 및 공사는 공급범위에서 제외됨.
3. 기초 공사 제외.

△					
▽					
NO.	DATE	REVISIONS	REVIEWED	CHECKED	APPROVED

DESIGN CONDITIONS		NOZZLE SPECIFICATIONS						
WATER FLOW RATE		1404 M ³ /HR	SYMBOL	DESCRIPTIONS	MAT'L	SIZE	Q'TY	REMARK
NO. OF CELLS		3 CELL	a	MANUAL MAKE-UP	SPP	50 A	3 EA	FLANGE
TEMP.	INLET	37 °C	b	AUTO. MAKE-UP	SPP	50 A	3 EA	FLANGE
	OUTLET	32 °C	c	OVERFLOW	SPP	100 A	3 EA	FLANGE
	WET BULB	27 °C	d	DRAIN	SPP	80 A	3 EA	FLANGE




NO.	DESCRIPTIONS	MAT'L	SIZE	Q'TY	REMARKS
		TITLE ASSEMBLY DRAWING			PROJECTION
		(600 CT x 3 CELLS)			
DWG.	DSN.	CHK.	APPR.	SCALE 1 / 70	P.J.T NAME
S.C.I.	S.S.H.	J.J.M.	R.H.H.	UNIT mm	REF. NO.
				DATE	DWG. NO. DI-LCP-600-3-01

NO.	DESCRIPTIONS	MAT'L	SIZE	Q'TY	REMARKS
-----	--------------	-------	------	------	---------

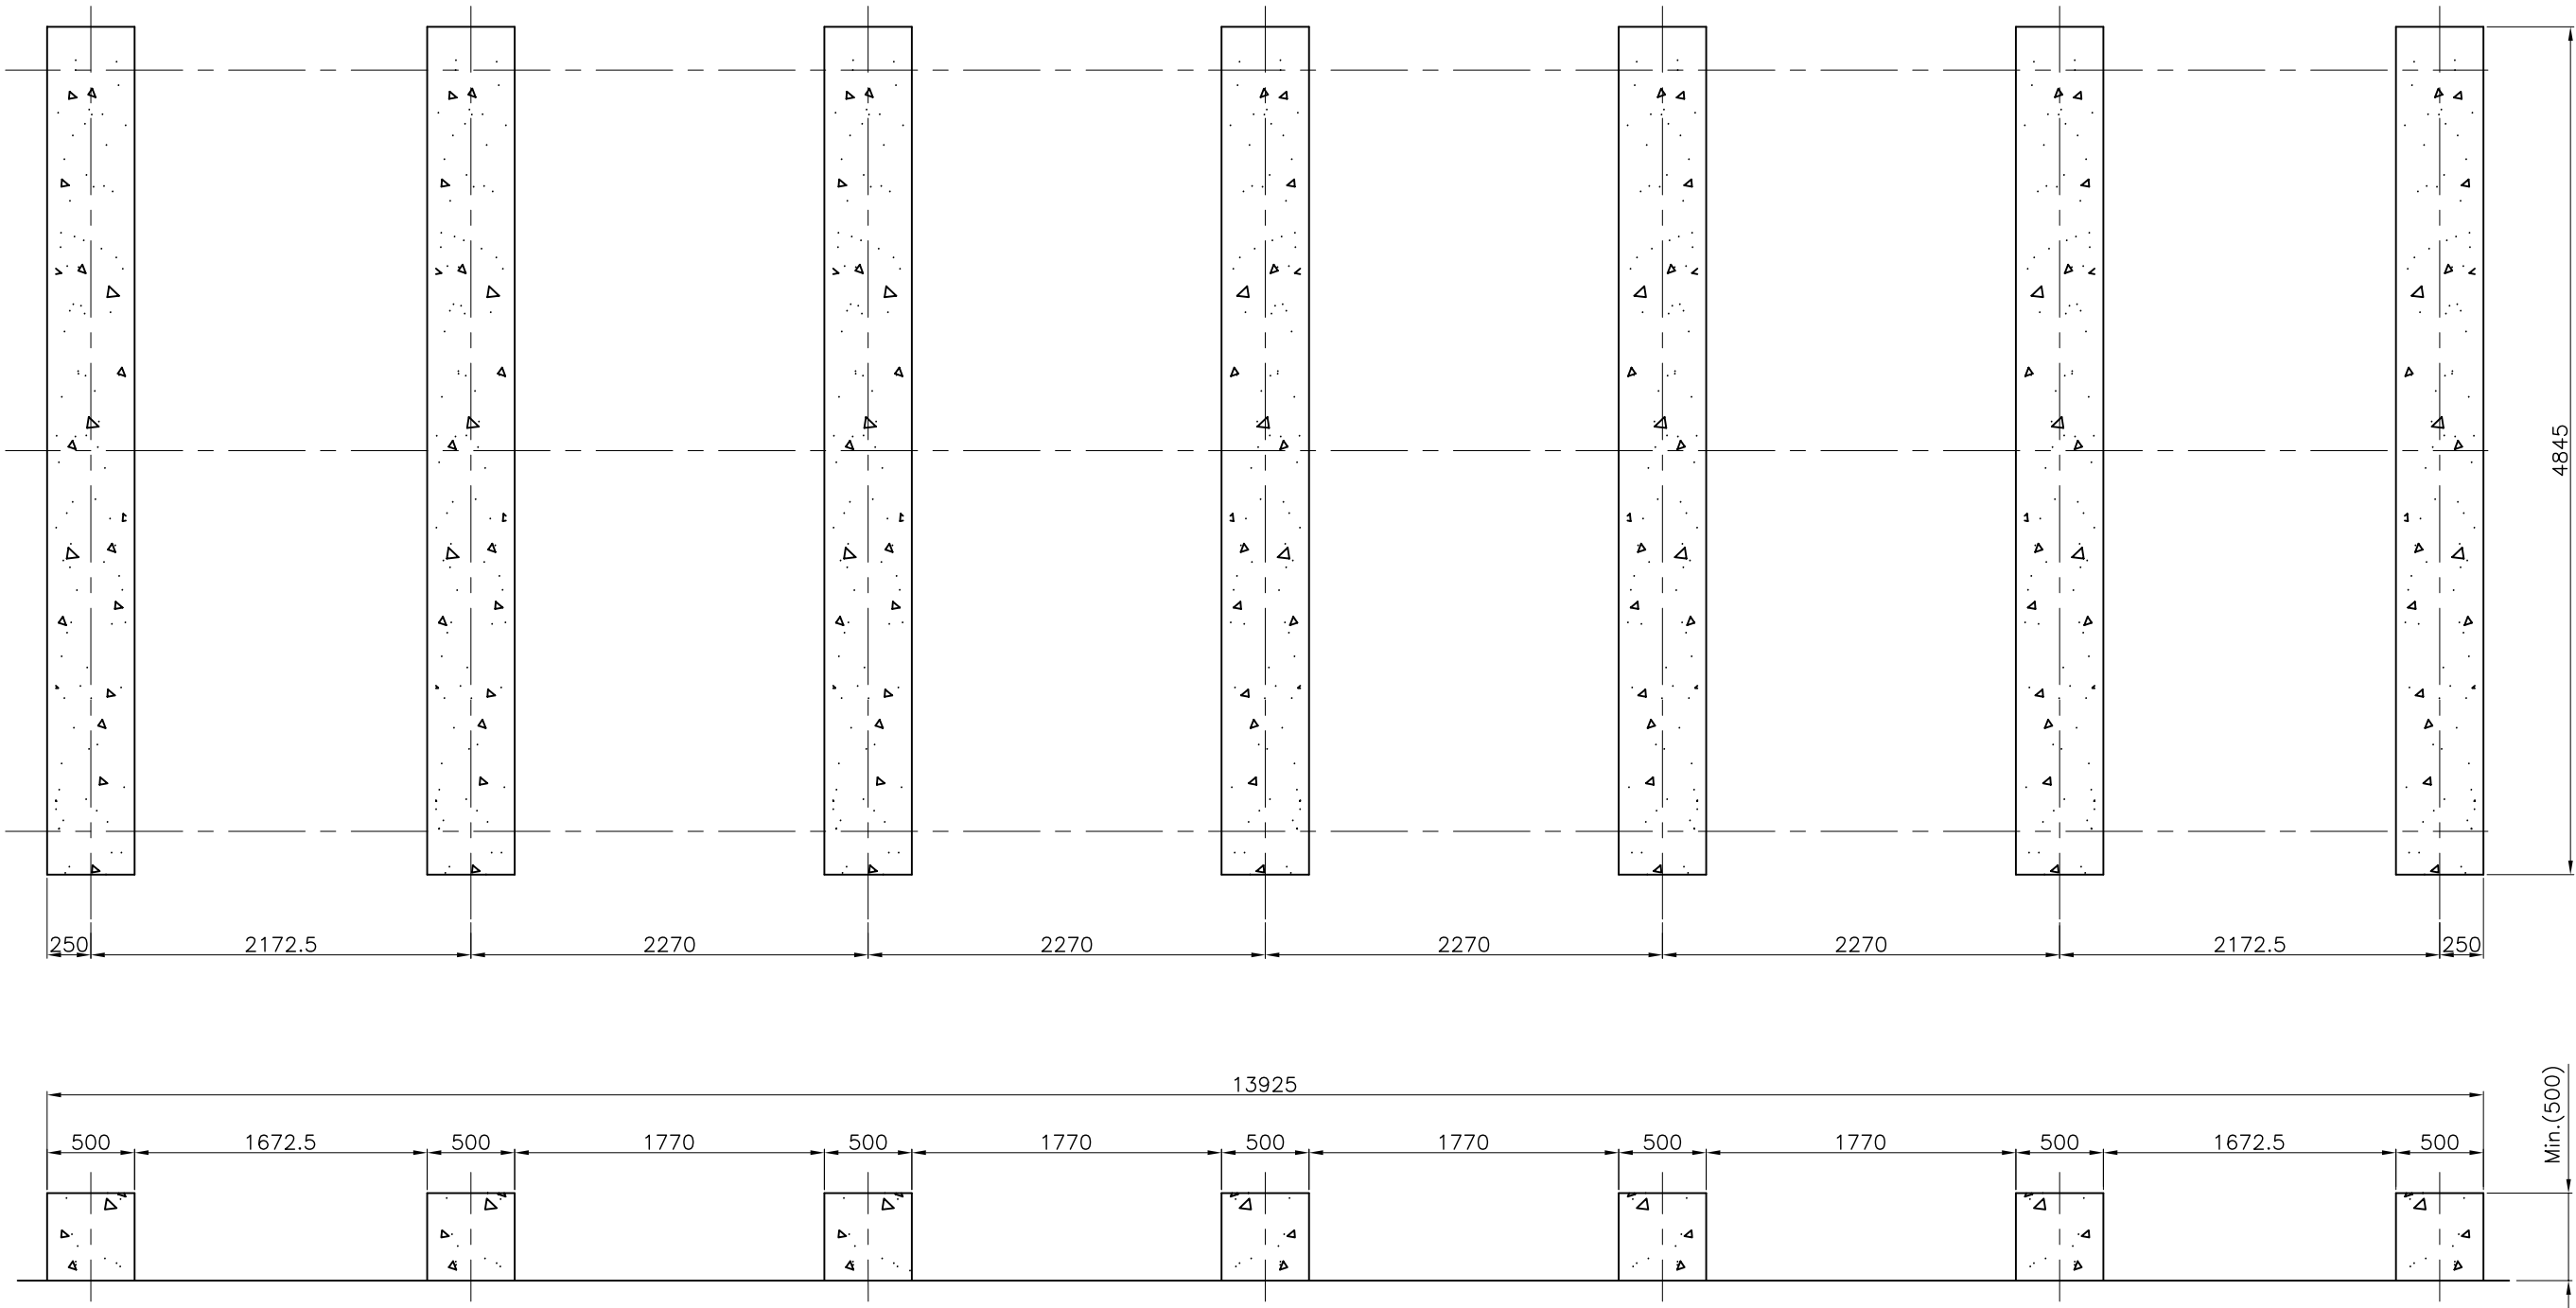

2					
1					
NO.	DATE	REVISIONS	REVIEWED	CHECKED	APPROVED

NO.	DESCRIPTIONS	MAT'L	SIZE	Q'TY	REMARKS
DAEIL AQUA CO., LTD. COOLING TOWER (주) 대 일 아 쿠 아			TITLE FOUNDATION (600 CT x 3 CELLS)		PROJECTION
DWG.	DSN.	CHK.	APPR.	SCALE 1 / 40	P.J.T NAME
S.C.I.	S.S.H.	J.J.M.	R.H.H.	UNIT mm	REF. NO.
				DATE	DWG. NO.
					DI-LCP-600-3-02
					REV.NO.

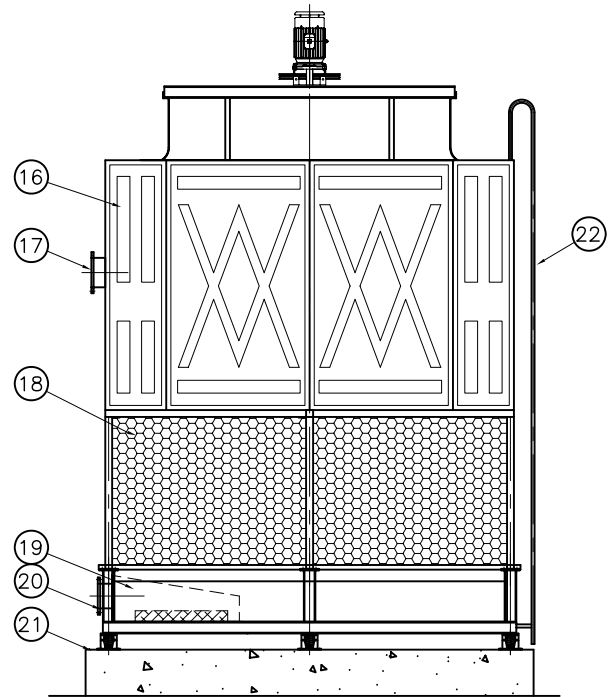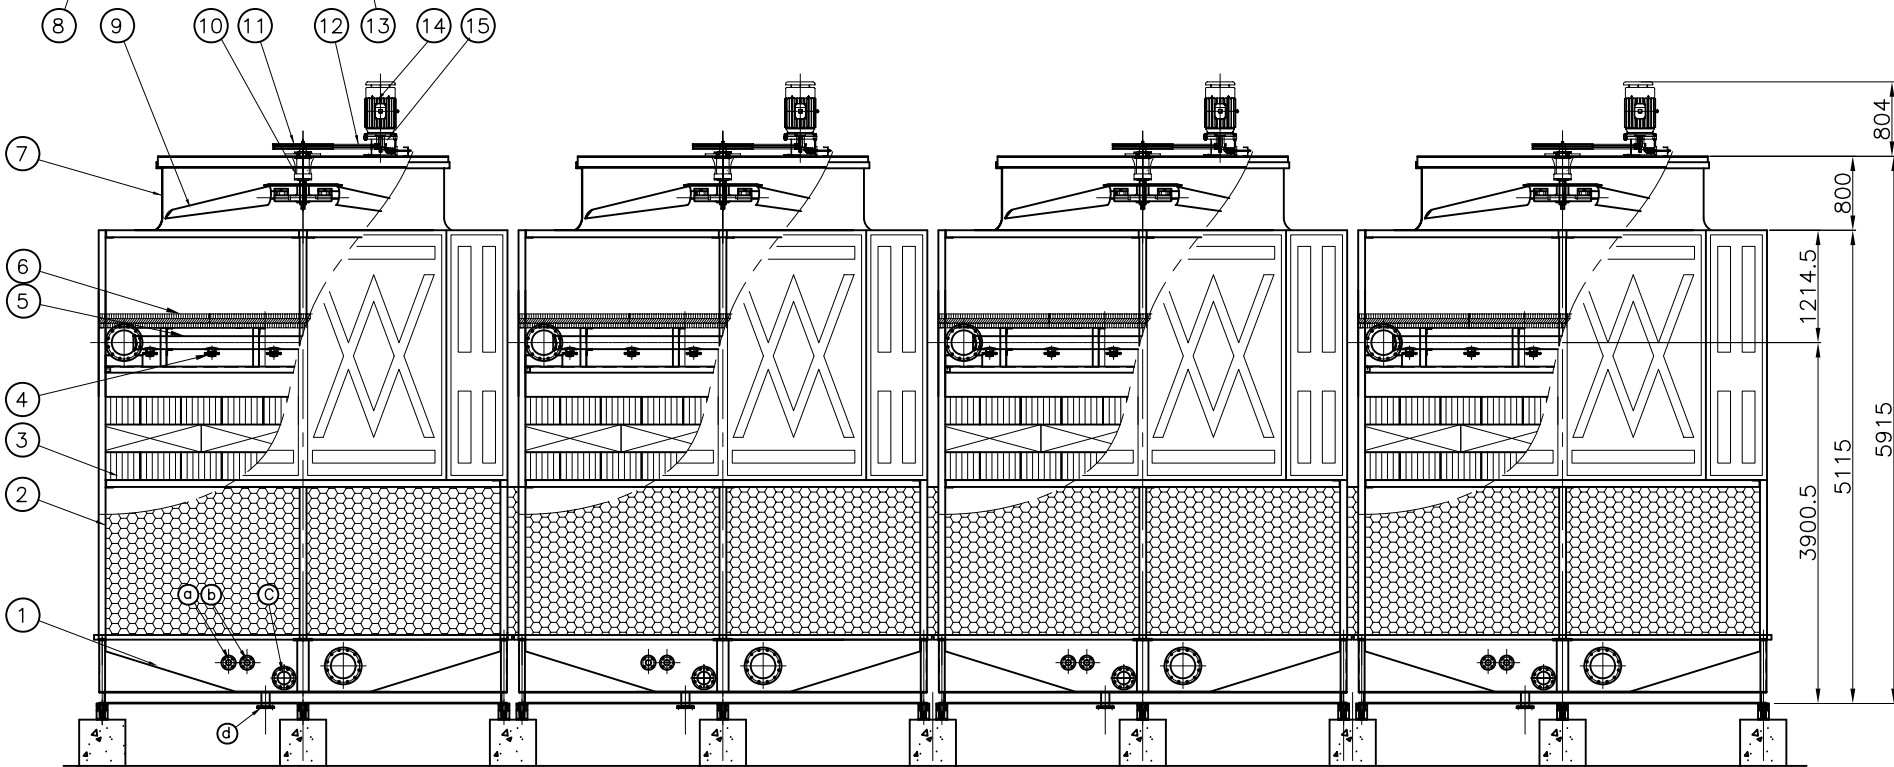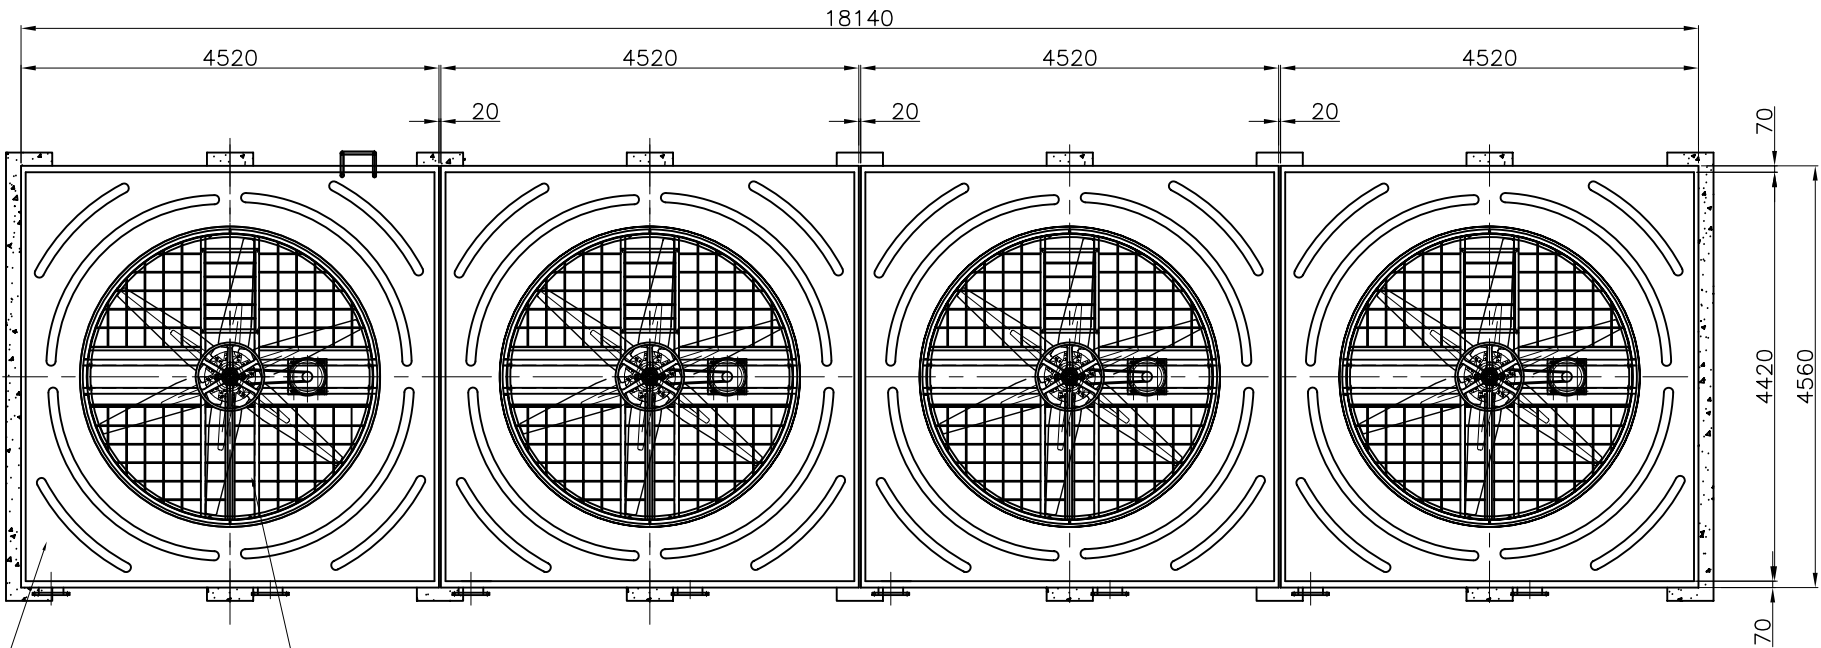

NO.	DESCRIPTIONS	MAT'L	IDENTIFICATION	Q'TY	REMARKS
1	COLD WATER BASIN	FRP	—	1 EA	
2	FRAMEWORK	SS400	75x75	1 EA	HDG
3	FILL	PVC	—	1 LOT	
4	WATER SPRAY NOZZLE	ABS	DK-C	25 EA	
5	LATERAL PIPE	PVC	150A	1 LOT	
6	DRIFT ELIMINATOR	PVC	—	1 LOT	
7	FAN CYLINDER	FRP	ø3030 ±10	1 EA	
8	FAN DECK	FRP	—	1 EA	
9	FAN ASSEMBLY	AL-ALLOY	ø3000	1 SET	
10	SPEED REDUCER	FC200	20HP	1 SET	
11	FAN DRIVE SHAFT PULLEY	FC200	5V2603	1 EA	
12	V-BELT	RUBBER	5V1180	3 EA	
13	MECH. EQUIPMENT BASE	SS400	—	1 EA	HDG
14	ELECTRIC MOTOR	TEFC	20HPx4P	1 EA	
15	MOTOR SHAFT PULLEY	FC200	5V503	1 EA	
16	CASING	FRP	—	1 LOT	
17	INLET PIPE	PVC	250A	1 EA	
18	AIR INLET SCREEN	PVC	—	1 LOT	
19	ANTI VORTEX BOX	FRP	—	1 EA	
20	OUTLET PIPE	SPP	250A	1 EA	HDG
21	FOUNDATION	RF CON'C	—	1 LOT	BY OWNER
22	LADDER	SPP	25A	1 EA	HDG



- 상기 수량은 1 CELL에 대한 것임.
- 본 기기와 연결되는 전선자재, 배관자재 및 공사는 공급범위에서 제외됨.
- 기초 공사 제외.



NO.	DATE	REVISIONS	REVIEWED	CHECKED	APPROVED
-----	------	-----------	----------	---------	----------




DESIGN CONDITIONS		NOZZLE SPECIFICATIONS						
WATER FLOW RATE		1872 M ³ /HR	SYMBOL	DESCRIPTIONS	MAT'L	SIZE	Q'TY	REMARK
NO. OF CELLS		4 CELL	a	MANUAL MAKE-UP	SPP	50 A	4 EA	FLANGE
TEMP.	INLET	37 °C	b	AUTO. MAKE-UP	SPP	50 A	4 EA	FLANGE
	OUTLET	32 °C	c	OVERFLOW	SPP	100 A	4 EA	FLANGE
	WET BULB	27 °C	d	DRAIN	SPP	80 A	4 EA	FLANGE

NO.	DESCRIPTIONS	MAT'L	SIZE	Q'TY	REMARKS
		TITLE ASSEMBLY DRAWING			PROJECTION
		(600 CT x 4 CELLS)			
DWG.	DSN.	CHK.	APPR.	SCALE 1 / 80	P.J.T NAME
S.C.I.	S.S.H.	J.J.M.	R.H.H.	UNIT mm	REF. NO.
				DATE	DWG. NO. DI-LCP-600-4-01

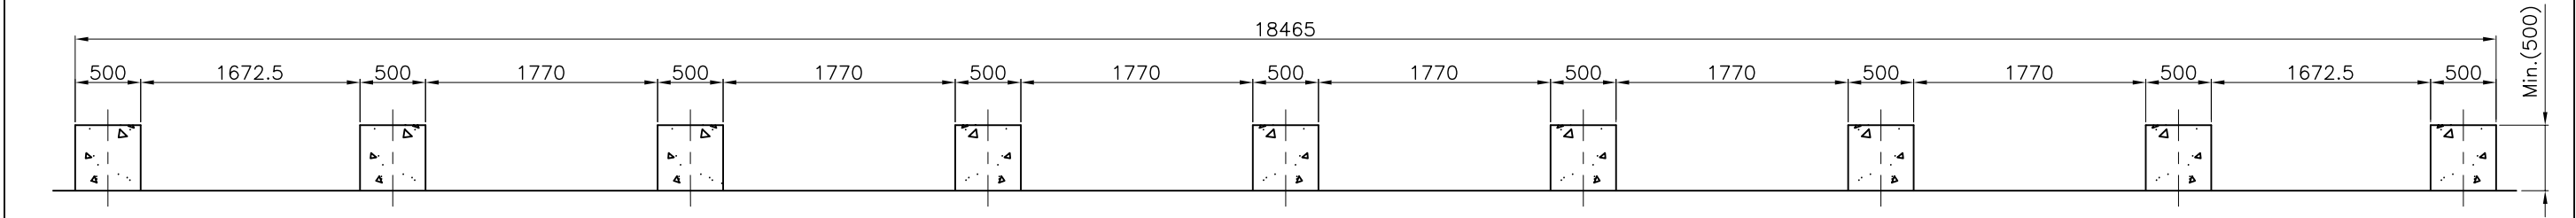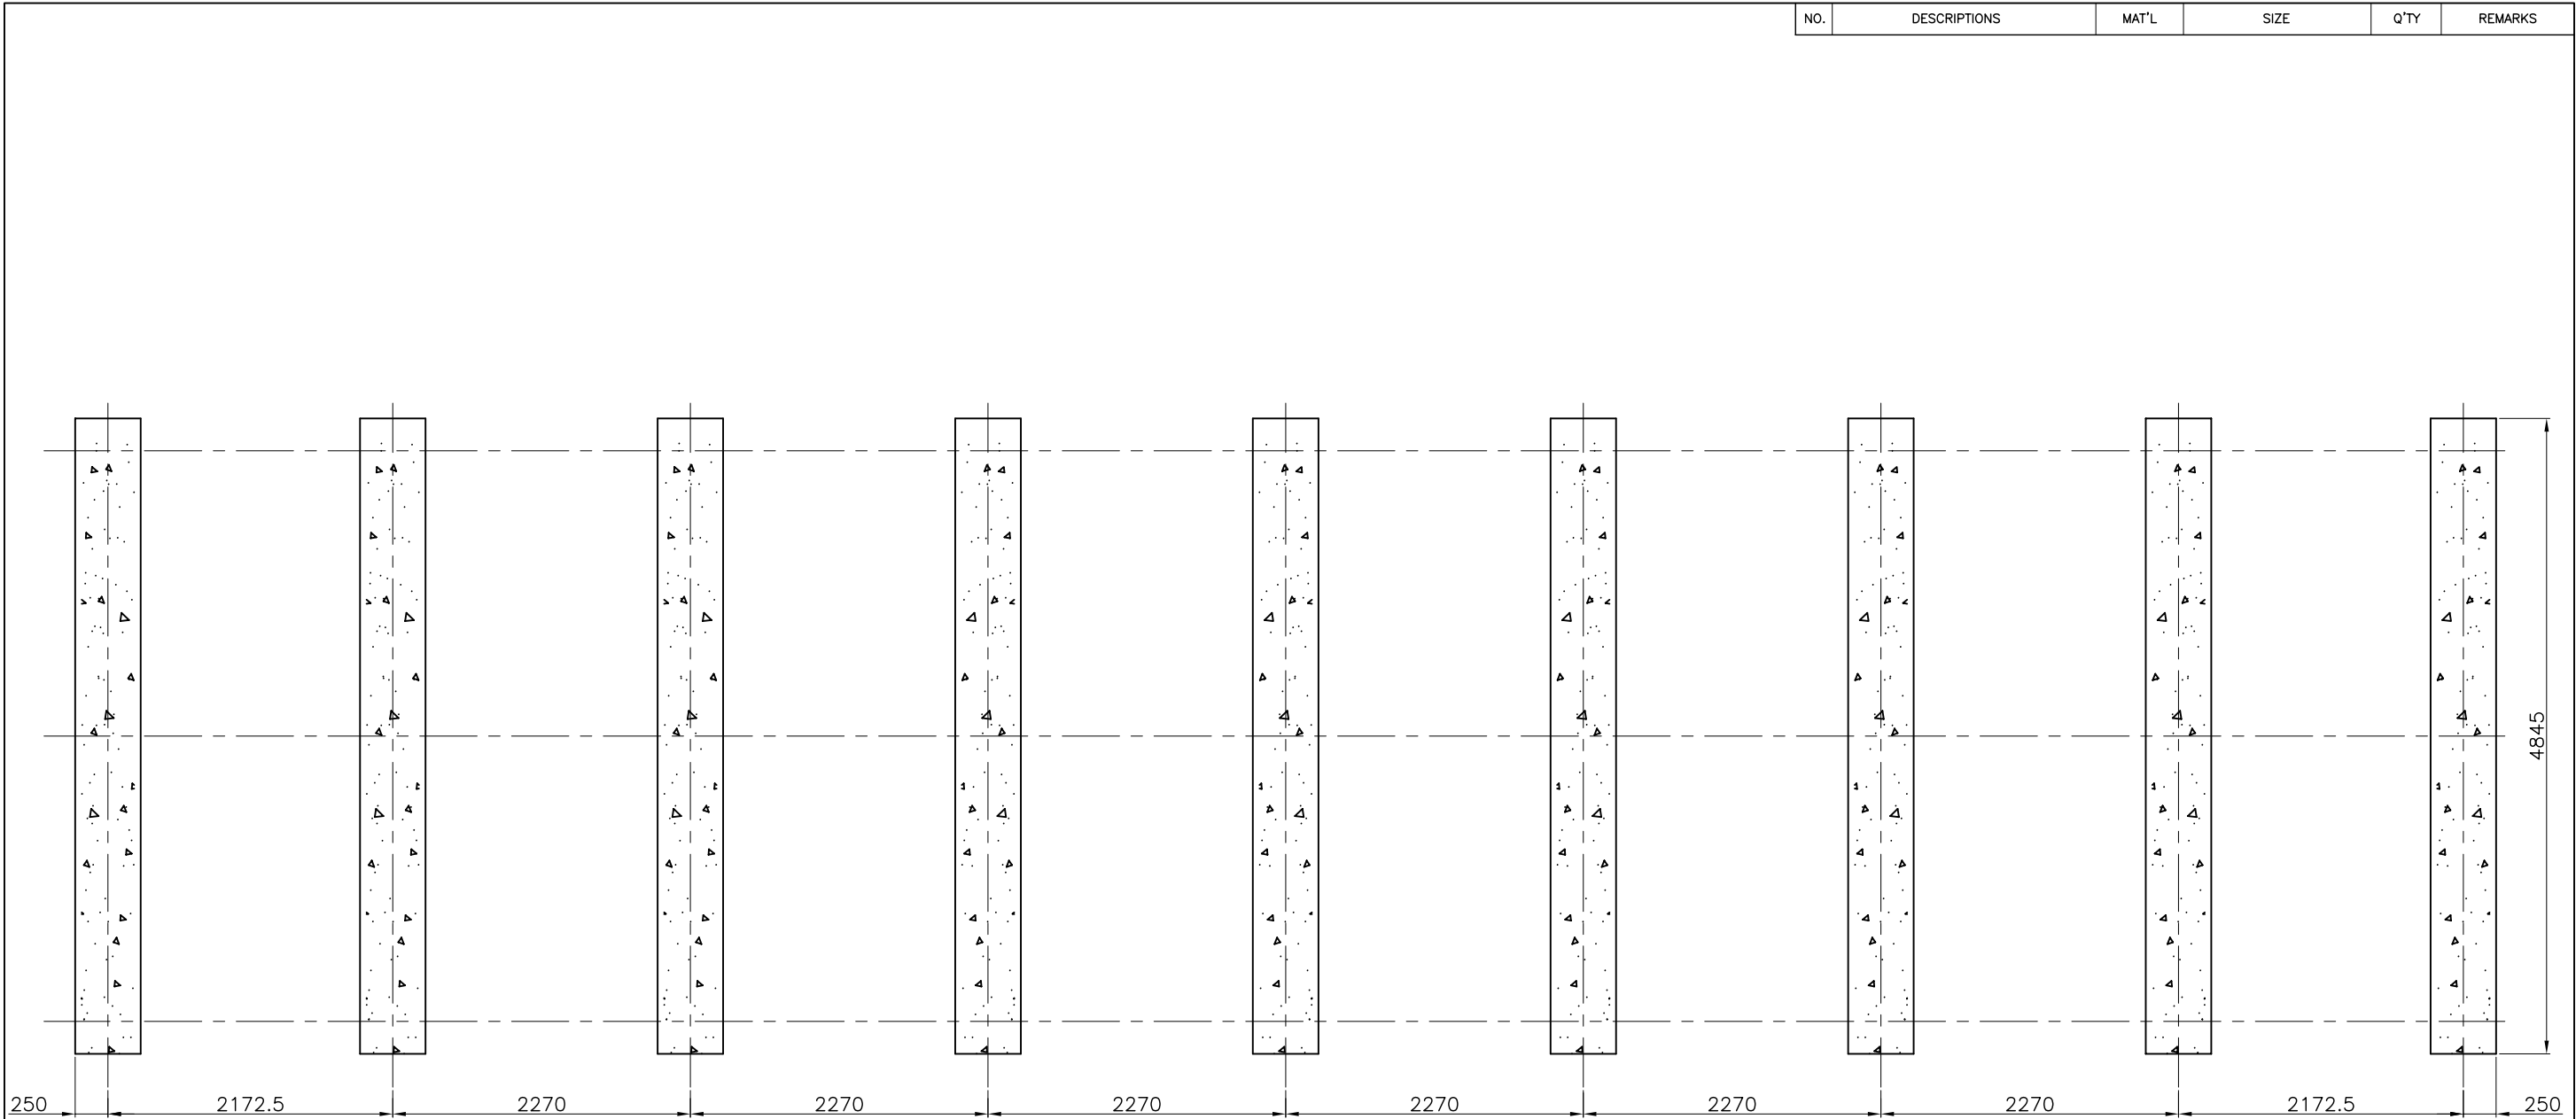

NO.	DATE	REVISIONS	REVIEWED	CHECKED	APPROVED

NO.	DESCRIPTIONS				MAT'L	SIZE		Q'TY	REMARKS	
	DAEIL AQUA CO., LTD. COOLING TOWER (주) 대 일 아 쿠 아				TITLE FOUNDATION (500 CT x 4 CELLS)					PROJECTION 
DWG.	DSN.	CHK.	APPR.	SCALE	1 / 50	P.J.T NAME				REV.NO.
S.C.I.	S.S.H.	J.J.M.	R.H.H.	UNIT	mm	REF. NO.				
				DATE		DWG. NO.	DI-LCP-500-4-02			

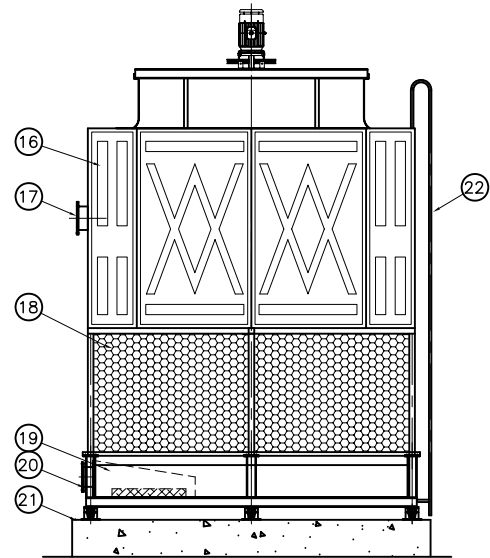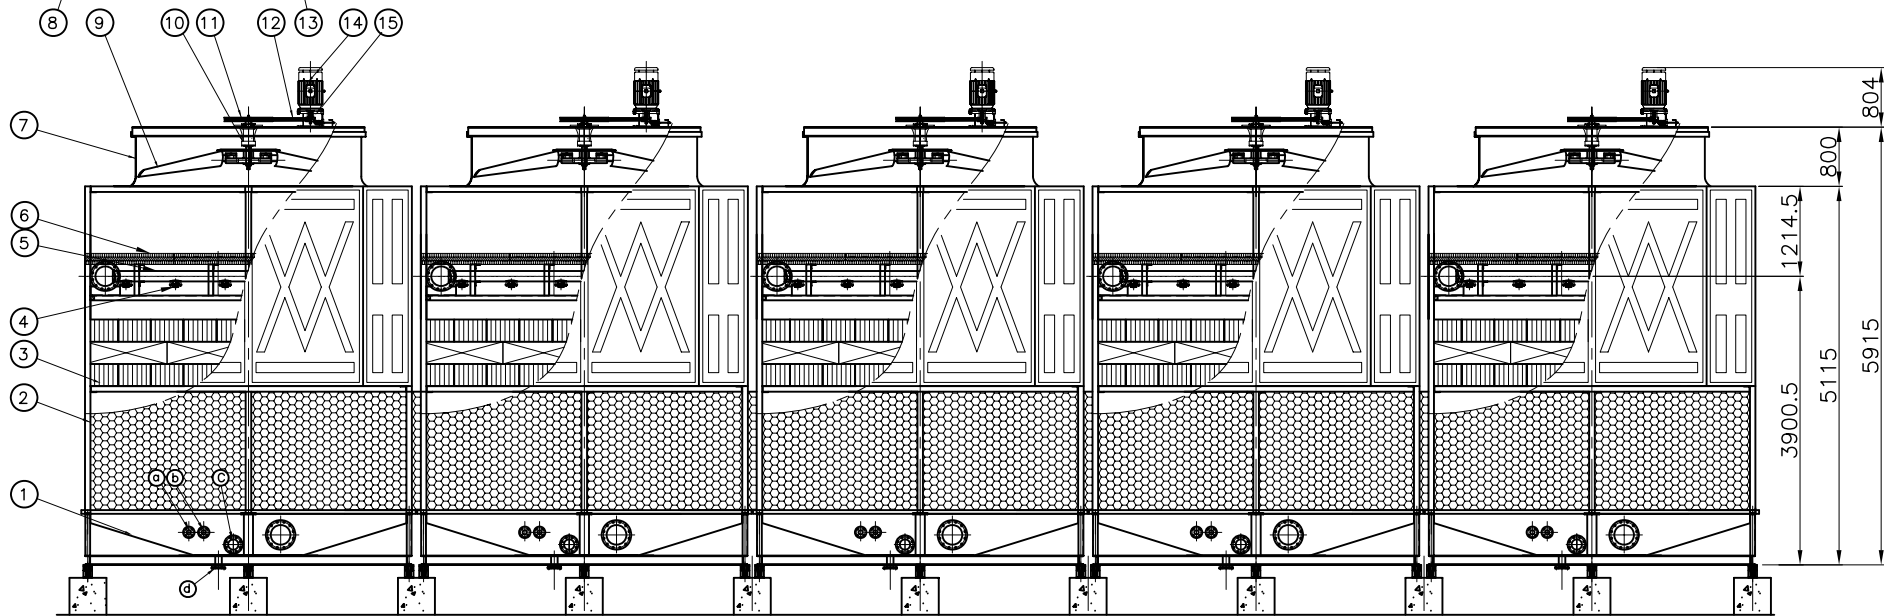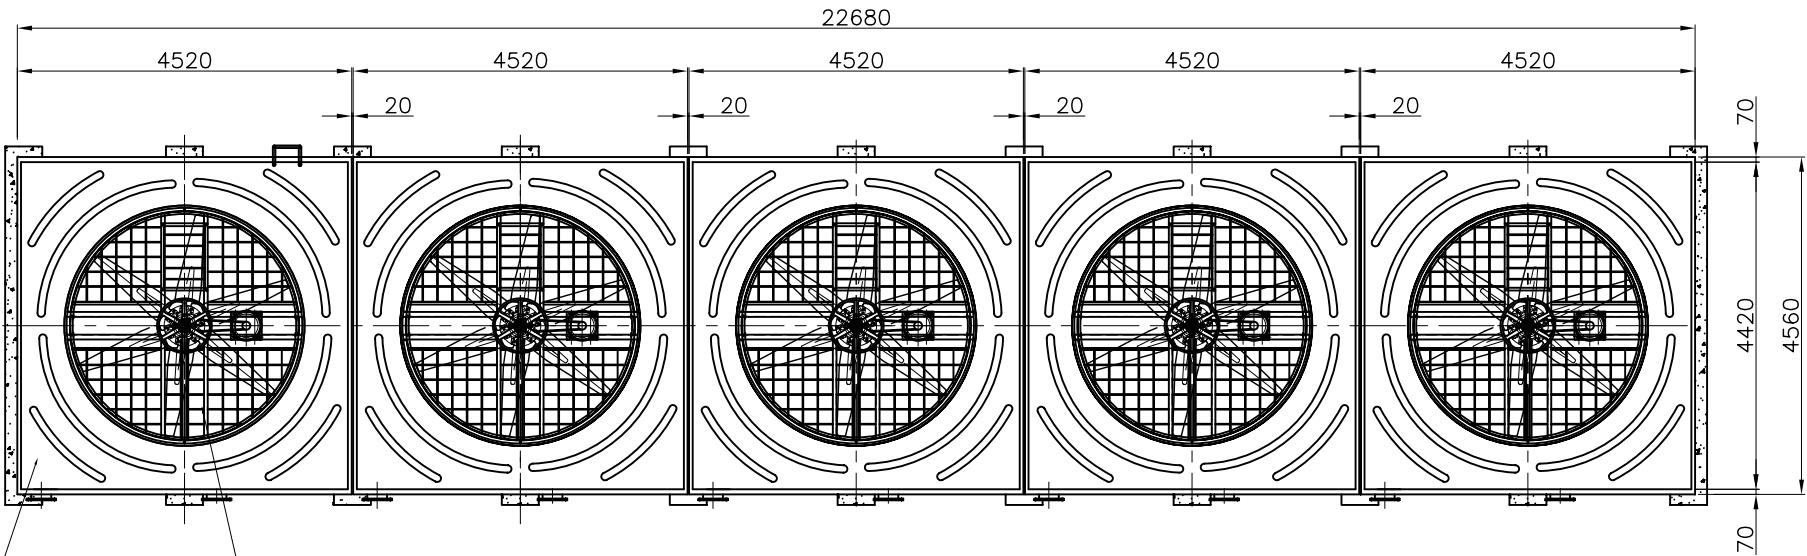


NO.	DESCRIPTIONS	MAT'L	IDENTIFICATION	Q'TY	REMARKS
1	COLD WATER BASIN	FRP	—	1 EA	
2	FRAMEWORK	SS400	75x75	1 EA	HDG
3	FILL	PVC	—	1 LOT	
4	WATER SPRAY NOZZLE	ABS	DK-C	25 EA	
5	LATERAL PIPE	PVC	150A	1 LOT	
6	DRIFT ELIMINATOR	PVC	—	1 LOT	
7	FAN CYLINDER	FRP	ø3030 $\pm_{-0}^{+10}$	1 EA	
8	FAN DECK	FRP	—	1 EA	
9	FAN ASSEMBLY	AL-ALLOY	ø3000	1 SET	
10	SPEED REDUCER	FC200	20HP	1 SET	
11	FAN DRIVE SHAFT PULLEY	FC200	5V2603	1 EA	
12	V-BELT	RUBBER	5V1180	3 EA	
13	MECH. EQUIPMENT BASE	SS400	—	1 EA	HDG
14	ELECTRIC MOTOR	TEFC	20HPx4P	1 EA	
15	MOTOR SHAFT PULLEY	FC200	5V503	1 EA	
16	CASING	FRP	—	1 LOT	
17	INLET PIPE	PVC	250A	1 EA	
18	AIR INLET SCREEN	PVC	—	1 LOT	
19	ANTI VORTEX BOX	FRP	—	1 EA	
20	OUTLET PIPE	SPP	250A	1 EA	HDG
21	FOUNDATION	RF CON'C	—	1 LOT	BY OWNER
22	LADDER	SPP	25A	1 EA	HDG

1. 상기 수량은 1 CELL에 대한 것임.
2. 본 기기와 연결되는 전선자재, 배관자재 및 공사는 공급범위에서 제외됨.
3. 기초 공사 제외.

△					
△					
NO.	DATE	REVISIONS	REVIEWED	CHECKED	APPROVED

DESIGN CONDITIONS		NOZZLE SPECIFICATIONS						
WATER FLOW RATE		2340	M ³ /HR	SYMBOL	DESCRIPTIONS	MAT'L	SIZE	Q'TY
NO. OF CELLS		5	CELL	a	MANUAL MAKE-UP	SPP	50 A	5 EA
TEMP.	INLET	37	°C	b	AUTO. MAKE-UP	SPP	50 A	5 EA
	OUTLET	32	°C	c	OVERFLOW	SPP	100 A	5 EA
	WET BULB	27	°C	d	DRAIN	SPP	80 A	5 EA
					REMARK			

NO.	DESCRIPTIONS	MAT'L	SIZE	Q'TY	REMARKS
		TITLE ASSEMBLY DRAWING			PROJECTION
		(600 CT x 5 CELLS)			
DWG.	DSN.	CHK.	APPR.	SCALE 1 / 100	P.J.T NAME
S.C.I.	S.S.H.	J.J.M.	R.H.H.	UNIT mm	REF. NO.
				DATE	DWG. NO.
					DI-LCP-600-5-01

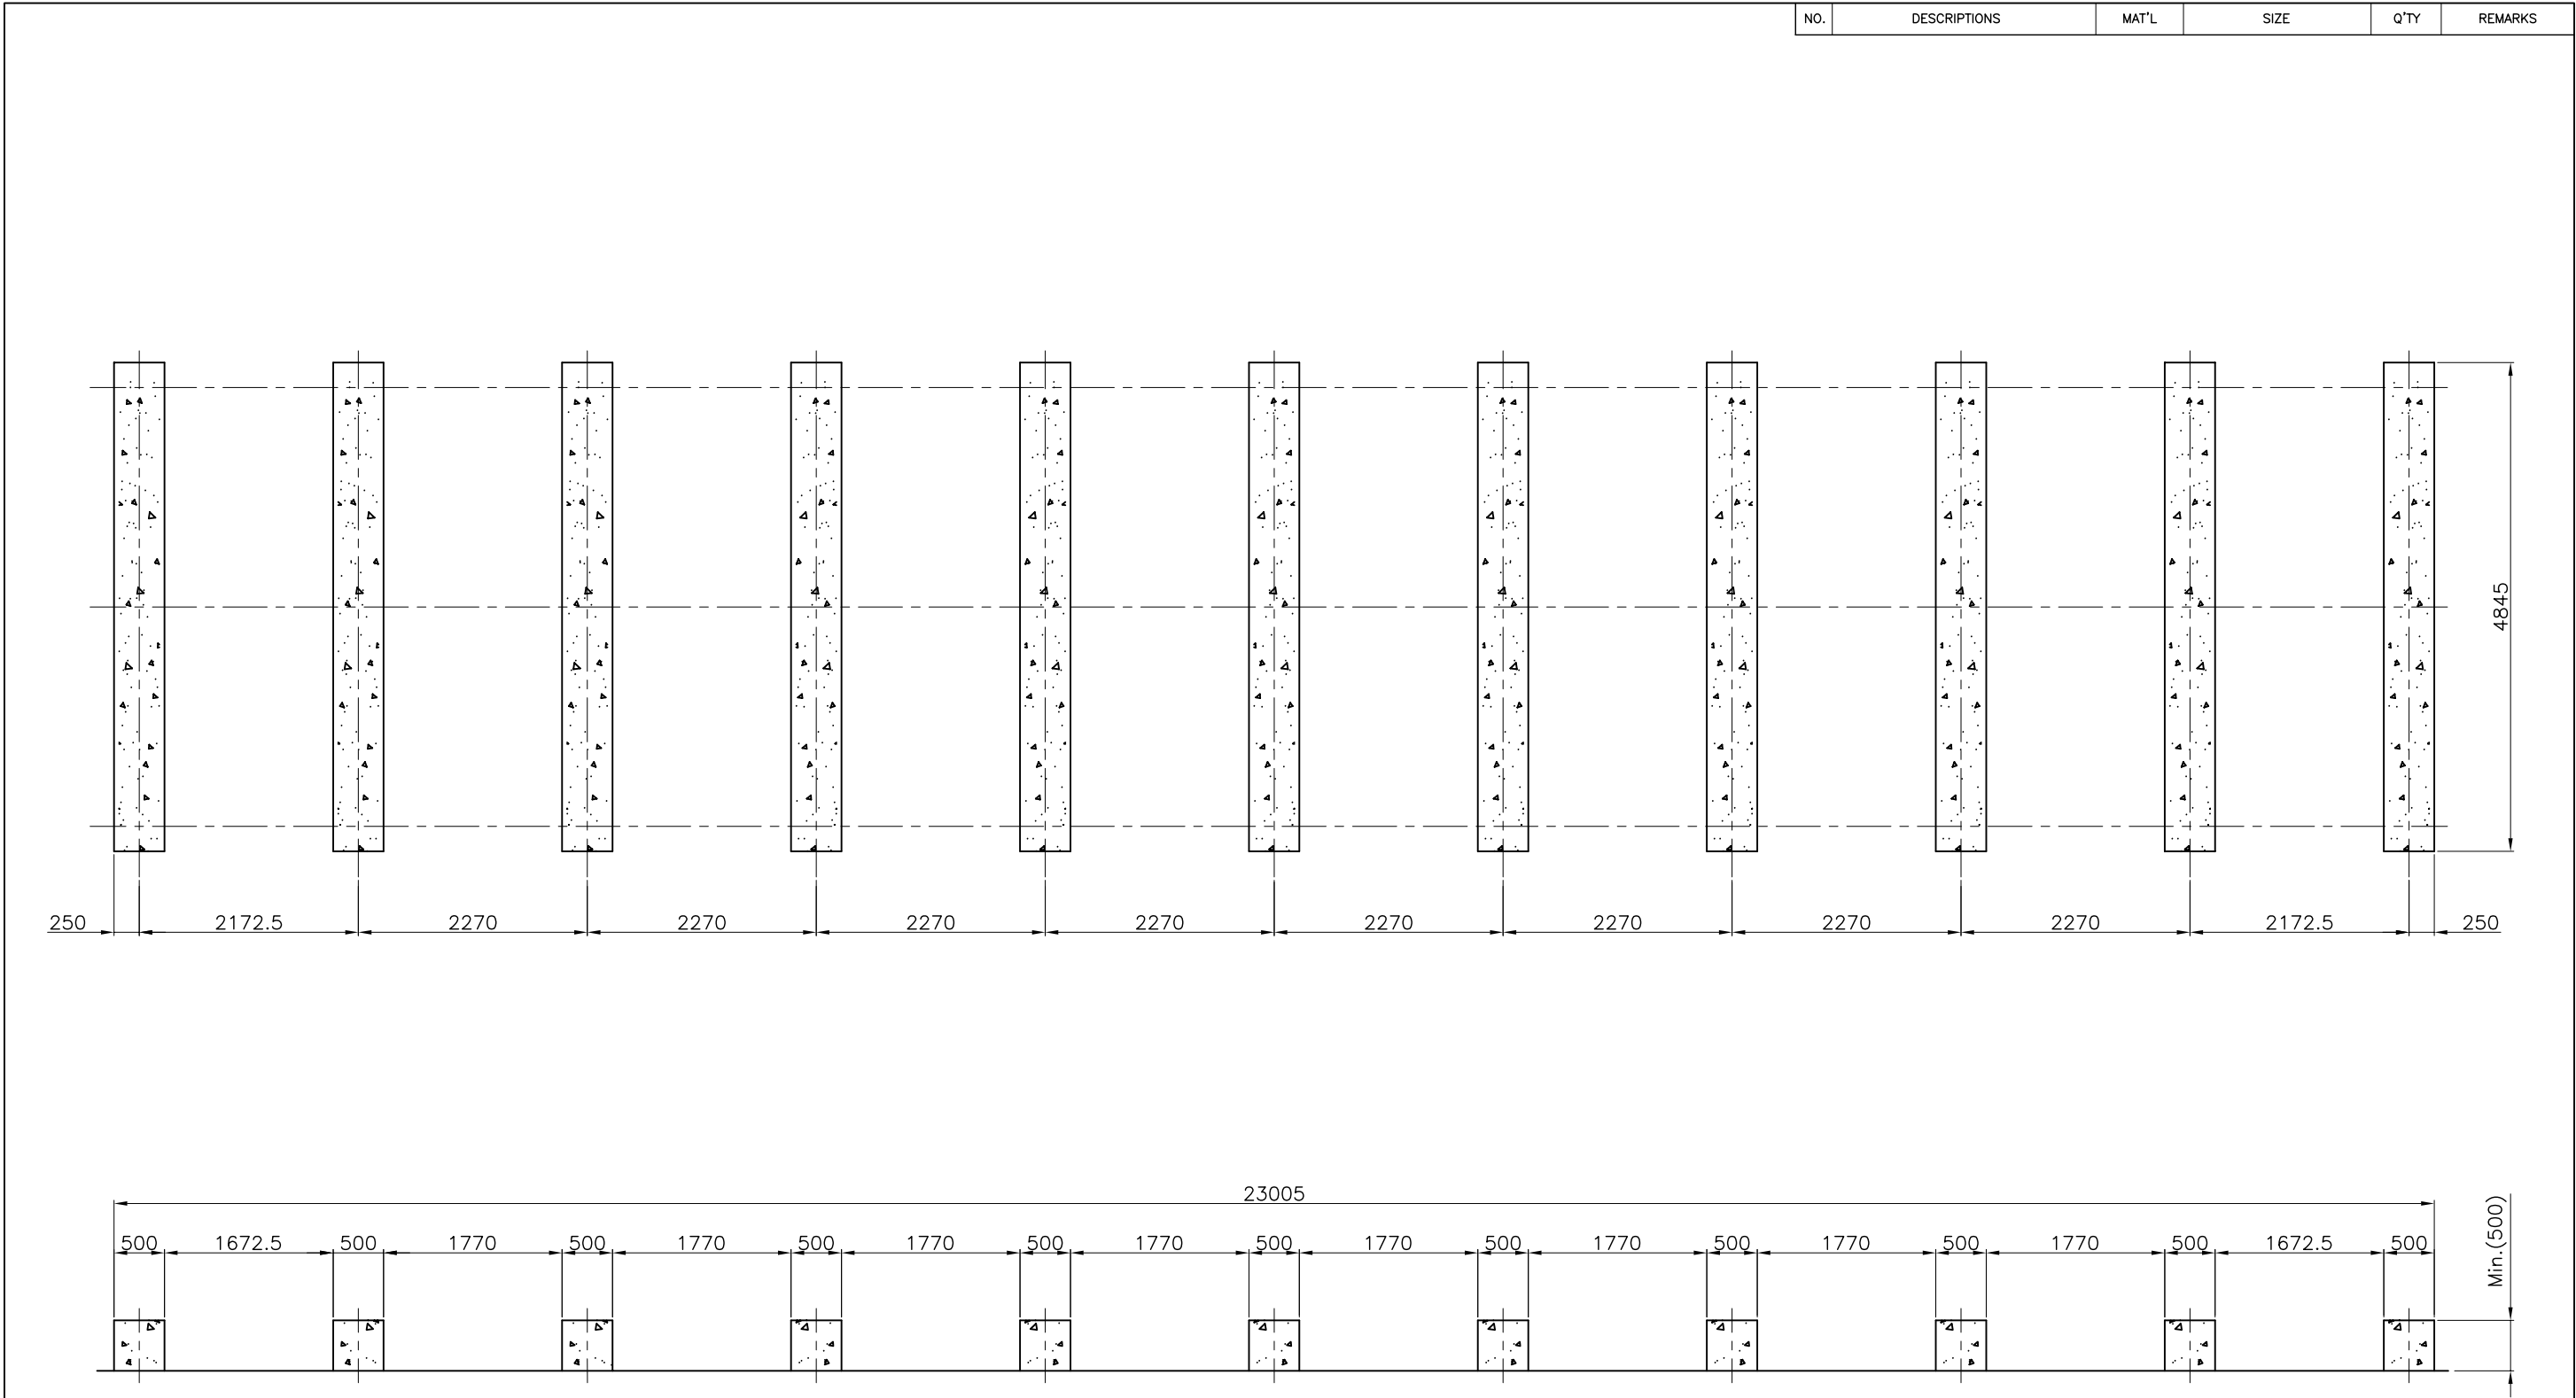

NO.	DATE	REVISIONS	REVIEWED	CHECKED	APPROVED

NO.	DESCRIPTIONS				MAT'L	SIZE		Q'TY	REMARKS		
 DAEIL AQUA CO., LTD. COOLING TOWER (주) 대 일 아 쿠 아					TITLE FOUNDATION (500 CT x 5 CELLS)					PROJECTION	
											
DWG.	DSN.	CHK.	APPR.	SCALE	1 / 65	P.J.T NAME		REV.NO.			
S.C.I.	S.S.H.	J.J.M.	R.H.H.	UNIT	mm	REF. NO.					
				DATE		DWG. NO.		DI-LCP-500-5-02			